

Device handbook

LINAX PQ5000-RACK

Operating instructions (2022-02)



GMC INSTRUMENTS

Camille Bauer Metrawatt AG
Aargauerstrasse 7
CH-5610 Wohlen / Switzerland
Phone: +41 56 618 21 11
Telefax: +41 56 618 35 35
E-Mail: info@cbmag.com
<https://www.camillebauer.com>




Legal information



CAMILLE BAUER

Warning notices

In this document warning notices are used, which you have to observe to ensure personal safety and to prevent damage to property. Depending on the degree of danger the following symbols are used:



Qualified personnel

The product described in this document may be handled by personnel only, which is qualified for the respective task. Qualified personnel have the training and experience to identify risks and potential hazards when working with the product. Qualified personnel are also able to understand and follow the given safety and warning notices.

Intended use

The product described in this document may be used only for the application specified. The maximum electrical supply data and ambient conditions specified in the technical data section must be adhered. For the perfect and safe operation of the device proper transport and storage as well as professional assembly, installation, handling and maintenance are required.

Disclaimer of liability

The content of this document has been reviewed to ensure correctness. Nevertheless, it may contain errors or inconsistencies and we cannot guarantee completeness and correctness. This is especially true for different language versions of this document. This document is regularly reviewed and updated. Necessary corrections will be included in subsequent version and are available via our webpage <https://www.camillebauer.com>.

Feedback

If you detect errors in this document or if there is necessary information missing, please inform us via e-mail to: customer-support@camillebauer.com

Contents

1. Introduction	5
1.1 Purpose of this document	5
1.2 Scope of supply	5
1.3 Further documents	5
2. Safety notes	6
3. Device overview	6
3.1 Brief description	6
3.2 Device overview	7
3.2 Available measurement data	8
4. Mechanical mounting	9
5. Electrical connections	10
5.1 General safety notes	10
5.2 Possible cross sections and tightening torques	11
5.3 Power supply	11
5.4 Inputs	11
5.5 Digital inputs	19
5.6 Digital output	19
5.7 Analog outputs	19
5.8 Modbus interface RS485	20
5.9 Uninterruptible power supply (UPS)	20
5.10 GPS time synchronization	21
5.11 IRIG-B time synchronization	22
6. Commissioning	23
6.1 Parametrization of the device functionality	23
6.2 Installation check	23
6.3 Ethernet installation	25
6.3.1 Settings	25
6.3.2 Connection of the standard interface	28
6.3.3 Connection of the IEC61850 interface	28
6.3.4 MAC addresses	28
6.4 Communication tests	28
6.5 3G/4G Router	29
6.6 IEC 61850 interface	29
6.7 Simulation of analog / digital outputs	29
6.8 Security system	30
6.8.1 RBAC management	30
6.8.2 User log in / out via website	33
6.8.3 User log in / out via local display	34
6.8.4 Whitelisting clients	35
6.8.5 Secure communication using https	35
6.8.6 Audit log (SYSLOG)	36
7. Operating the device	38
7.1 Operating elements	38
7.2 Selecting the information to display	38
7.3 Measurement displays and used symbols	39
7.4 Resetting measurement data	40
7.5 Configuration	41
7.5.1 Local configuration at the device	41
7.5.2 Configuration via web browser	43
7.6 PQ monitoring	45

7.6.1	PQ events	45
7.6.2	PQ statistic.....	47
7.6.3	Provision of PQ data	48
7.7	Alarming.....	49
7.7.1	Limit values on base quantities	49
7.7.2	Monitoring functions	50
7.7.3	Summary alarm.....	51
7.8	Data recordings.....	52
7.8.1	Periodic data	52
7.8.2	Events	55
7.8.3	PQ events	56
7.8.4	PQ statistic.....	59
7.9	Measurement information in file format.....	63
7.9.1	Predefined tasks	63
7.9.2	Creating periodic file data	64
7.9.3	Accessing file information via webpage	65
7.9.4	Periodical sending to a SFTP Server	66
7.9.5	Evaluation of the PQDIF files.....	67
7.10	Display timeouts.....	67
8.	Service, maintenance and disposal	68
8.1	Calibration and new adjustment.....	68
8.2	Cleaning.....	68
8.3	Battery.....	68
8.4	Disposal	68
9.	Technical data.....	69
10.	Dimensional drawings.....	75
Annex.....		76
A	Description of measured quantities.....	76
A1	Basic measurements	76
A2	Harmonic analysis.....	80
A3	System imbalance.....	81
A4	Mean values and trend	82
A5	Meters	83
B	Display matrices	84
B0	Used abbreviations for the measurements	84
B1	Display matrices for single phase system.....	90
B2	Display matrices for split-phase (two-phase) systems.....	91
B3	Display matrices for 3-wire system, balanced load.....	92
B4	Display matrices for 3-wire systems, unbalanced load	93
B5	Display matrices for 3-wire systems, unbalanced load, Aron	94
B6	Display matrices for 4-wire systems, unbalanced load	95
C	Logic functions	96
D	FCC statement	97
INDEX.....		98

1. Introduction

1.1 Purpose of this document

This document describes the universal measurement device for heavy-current quantities LINAX PQ5000. It is intended to be used by:

- Installation personnel and commissioning engineers
- Service and maintenance personnel
- Planners

Scope

This handbook is valid for all hardware variants of the PQ5000 rack version. Some of the functions described in this document are available only, if the necessary optional components are included in the device.

Required knowledge

A general knowledge in the field of electrical engineering is required. For assembly and installation of the device knowledge of applicable national safety regulations and installation standard is required.



1.2 Scope of supply

- Measurement device
- Quick installation and set-up guide
- Battery pack (optional, for devices with UPS only)

1.3 Further documents

This document is accessible via device website (menu **Service | Device information | Download manual**). Further documents are available via our homepage <https://www.camillebauer.com>.

2. Safety notes



Device may only be disposed in a professional manner!

The installation and commissioning should only be carried out by trained personnel.

Check the following points before commissioning:

- that the maximum values for all the connections are not exceeded, see "Technical data" section,
- that the connection wires are not damaged, and that they are not live during wiring,
- that the power flow direction and the phase rotation are correct.

The instrument must be taken out of service if safe operation is no longer possible (e.g. visible damage). In this case, all the connections must be switched off. The instrument must be returned to the factory or to an authorized service dealer.

It is forbidden to open the housing and to make modifications to the instrument. The instrument is not equipped with an integrated circuit breaker. During installation check that a labeled switch is installed and that it can easily be reached by the operators.

Unauthorized repair or alteration of the unit invalidates the warranty.

3. Device overview

3.1 Brief description

The devices of the LINAX PQ series are comprehensive instruments for the universal measurement and monitoring in power systems. They provide a wide range of functions, which may be extended using optional components. The nameplate on the device gives further details about the present version. A connection to the process environment may be established by means of communication interfaces, via digital I/O's, analog outputs or relays. The parameterization of the device is possible directly at the device or via web browser.

The LINAX PQ5000 is an independently certified measurement devices of class A according to IEC 61000-4-30 Ed. 3. It provides reliable and comparable information for regulatory authorities, negotiations with energy suppliers or internal quality control.

Continuous monitoring analyses breakdowns immediately and eliminates their causes in a sustainable manner. In addition, long-term acquisition permits the early recognition of changes in order to improve supply security and thus system availability.

The flexible approach without any software excels both in autarchy and flexible software integration options. It is based on standardized interfaces, generates compliance reports directly via the device website and excels with a comprehensive cyber security concept.

3.2 Device overview



	PQ5000R-2...	PQ5000R-3...
Voltage inputs	5	2 x 5
Input channels current	4 (5 A or 3 V)	2 x 4 (5 A or 3 V)
Function class acc. IEC 61000-4-30	Class A	Class A
Device type acc. IEC 62586-1	PQI-A F11	PQI-A F11
PQ COMPLIANCE MONITORING		
Power frequency	▪	▪
Voltage / current variations	▪	▪
Unbalance voltage / current	▪	▪
THDS of voltages	▪	▪
Harmonics voltage / current	▪	▪
Flicker Pst / Plt	▪	▪
Mains signalling voltages	▪	▪
Interharmonics voltage / current	▪	▪
PQ EVENT RECORDING		
Voltage dip	▪	▪
Voltage interruption	▪	▪
Voltage swell	▪	▪
Rapid voltage changes (RVC)	▪	▪
Homopolar voltage (unbalance)	▪	▪
Current swell	▪	▪
Frequency anomaly	▪	▪
Ripple control sequences	▪	▪
State change of digital inputs	▪	▪
MEASUREMENT UNCERTAINTY		
Voltage, current	±0,1%	±0,1%
Active, reactive, apparent power	±0,2%	±0,2%
Active energy (IEC 62053-22)	Class 0.2S	Class 0.2S
COMMUNICATION		
Ethernet: Modbus/TCP, Webserver, NTP	(Standard)	(Standard)
IEC 61850	(Option)	–
RS485: Modbus/RTU	(Option)	(Option)
Extension modules (optional)	4 analog outputs, 12 digital inputs, 1 relay	2 x 4 analog outputs, 2 x 12 digital inputs, 2 x 1relay
POWER SUPPLY		
	100-230V AC/DC	100-230V AC/DC
Consumption	≤40 VA	≤60 VA
DESIGN		
Colour display	TFT 3,5" (320x240px)	2 x TFT 3,5" (320x240px)
Dimensions	482,6 x 132,6 x 270,1 mm	482,6 x 132,6 x 270,1 mm
Montage	Installation in 19" rack	Installation in 19" rack

3.2 Available measurement data

MEASURED VALUE GROUP	APPLICATION
INSTANTANEOUS VALUES <ul style="list-style-type: none"> • U, I, IMS, P, Q, S, PF, LF, QF ... • Angle between voltage phasors • Min/max of instantaneous values with time stamp 	<ul style="list-style-type: none"> » Transparent monitoring of present system state » Fault detection, connection check, sense of rotation check » Determination of grid variable variance with time reference
EXTENDED REACTIVE POWER ANALYSIS <ul style="list-style-type: none"> • Total reactive power, fundamental frequency, harmonics • $\cos\phi$, $\tan\phi$ of fundamental frequency with min values in all quadrants 	<ul style="list-style-type: none"> » Reactive power compensation » Verification of specified power factor
HARMONICS ANALYSIS (ACCORDING TO IEC 61000-4-7) <ul style="list-style-type: none"> • Total harmonics content THD U/I and TDD I • Individual harmonics / interharmonics U/I 	<ul style="list-style-type: none"> » Evaluation of the thermic load of equipment » Analysis of system perturbation and consumer structure
IMBALANCE ANALYSIS <ul style="list-style-type: none"> • Symmetrical components (positive, negative, zero sequence system) • Imbalance (derived from symmetrical components) • Deviation from U/I mean value 	<ul style="list-style-type: none"> » Equipment overload protection » Failure/earth fault detection
ENERGY BALANCE ANALYSIS <ul style="list-style-type: none"> • Meter for acquisition/supply of active/reactive energy, high/low-rate tariff, meter with selectable base variable • Power mean values active/reactive power, demand and supply, freely definable mean values (e.g. phase power, voltage, current and much more) • Mean value trends 	<ul style="list-style-type: none"> » Preparation of (internal) energy billing » Determination of energy consumption versus time (load profile) for energy management or energy efficiency verification » Energy consumption trend analysis for load management
OPERATING HOURS <ul style="list-style-type: none"> • 3 operating hour counters with programmable running condition • Operating hours of the device 	<ul style="list-style-type: none"> » Monitoring of service and maintenance intervals

The device provides measurements in the following subcategories:

- a) **Instantaneous values:** Present TRMS values and associated min/max values
- b) **Energy:** Power mean-values with trend and history as well as energy meters. Mean-value progressions (load profiles) and periodic meter readings are also available.
- c) **Harmonics:** Total harmonic distortion THD/TDD, individual harmonics and their maximum values, phase angle of the harmonics
- d) **Phasor diagram:** Overview of all current and voltage phasors and phase sequence check
- e) **Waveform** of current and voltage inputs
- f) **Events:** State list of monitored alarms, chronological lists of PQ events and self-defined alarms / events as well as operator events.
- g) **PQ statistic:** Data of the statistical power quality analysis with the possibility to create reports (PQ-Easy Report).

4. Mechanical mounting



Please ensure that the [operating temperature limits](#) are not exceeded when determining the place of mounting (place of measurement).



By installing, the device becomes part of an electrical power installation that must be designed, operated and maintained in accordance with country-specific regulations so that the installation is safe and provides prevention against fire and explosion as far as possible.



It is the task of this installation to ensure that dangerous connections of the device cannot be touched during operation and that the spread of flames, heat and smoke from the interior is prevented. This may be done by providing an enclosure (e.g. case, cabinet) or using a room accessible to qualified personal only and compliant with local fire safety standards.

5. Electrical connections




Ensure under all circumstances that the leads are free of potential when connecting them!

5.1 General safety notes




Please observe that the data on the type plate must be adhered to!

The national provisions have to be observed in the installation and material selection of electric lines, e.g. in Germany VDE 0100 "Erection of power installations with nominal voltages up to 1000 V"!

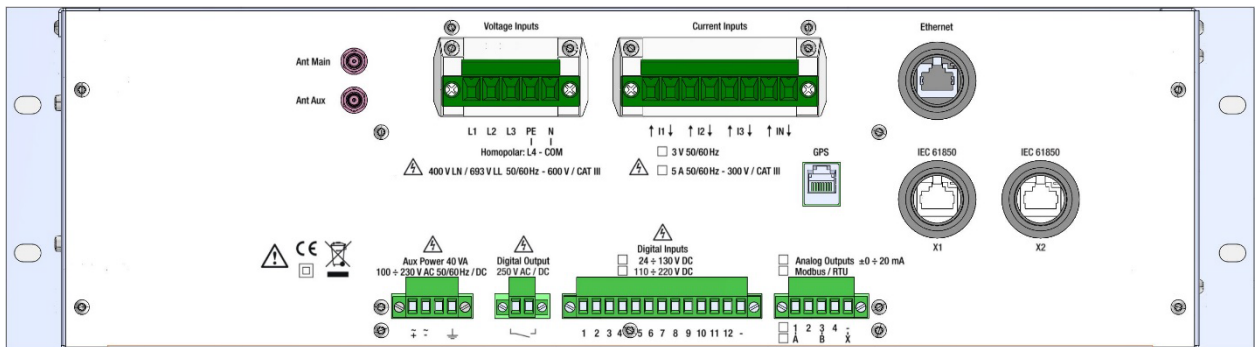

Backplane, single rack, with I/O extension, antenna connectors for 3G/4G router and IEC61850 interface

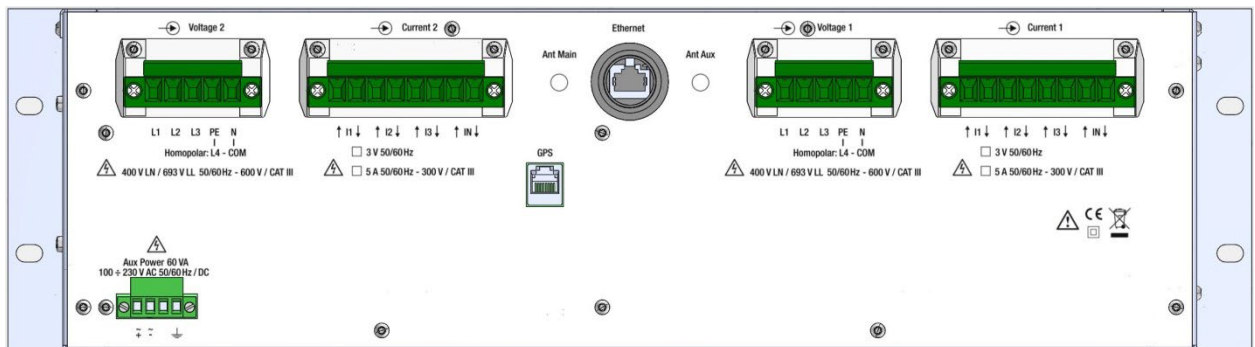

Backplane, double rack, without I/O extension and antenna connectors for 3G/4G router

Symbol	Meaning
	Device may only be disposed of in a professional manner!
	Double insulation, device of protection class 2
	CE conformity mark. The device fulfills the requirements of the applicable EU directives.
	Caution! General hazard point. Read the operating instructions.
	Warning, hazard of electrical shock.
CAT III	Measurement category CAT III
	Earth connector

5.2 Possible cross sections and tightening torques

Inputs L1, L2, L3, PE(L4), N(COM), I1, I2, I3, IN	
Single wire	<ul style="list-style-type: none"> • 1 x 0.2 ÷ 4.0mm² or 2 x 0.2 ÷ 2.5mm² • 1 x 24 AWG ÷ 11 AWG or 2 x 24 AWG ÷ 14 AWG
Multiwire with end splices	<ul style="list-style-type: none"> • 1 x 0.2 ÷ 4.0mm² or 2 x 0.2 ÷ 2.5mm² • 1 x 24 AWG ÷ 11 AWG or 2 x 24 AWG ÷ 14 AWG
Tightening torque	<ul style="list-style-type: none"> • 0.5 ÷ 0.6 Nm • 4.42 ÷ 5.31 lbf in
Aux Power, I/O's, Modbus	
Single wire	<ul style="list-style-type: none"> • 1 x 0.2 ÷ 2.5mm² or 2 x 0.2 ÷ 1.0mm² • 1 x 24 AWG...14 AWG or 2 x 23 AWG...17 AWG
Multiwire with end splices	<ul style="list-style-type: none"> • 1 x 0.25 ÷ 2.5mm² or 2 x 0.2 ÷ 1.5mm² • 1 x 23 AWG ÷ 14 AWG or 2 x 20 AWG ÷ 16 AWG
Tightening torque	<ul style="list-style-type: none"> • 0.5 ÷ 0.6 Nm • 4.42 ÷ 5.31 lbf in

5.3 Power supply



Connect the earth terminal to protection earth before connecting the supply voltage.



A marked and easily accessible current limiting switch in accordance with IEC 60947-2 has to be arranged in the vicinity of the device for turning off the power supply. Fusing should be 10 Amps or less and must be rated for the available voltage and fault current.

5.4 Inputs



All voltage measurement inputs must originate at circuit breakers or fuses rated 5 Amps or less. This does not apply to the neutral connector. You have to provide a method for manually removing power from the device, such as a clearly labeled circuit breaker or a fused disconnect switch in accordance with IEC 60947-2 or IEC 60947-3.

When using **voltage transformers** you have to ensure that their secondary connections never will be short-circuited.



No fuse may be connected upstream of the **current measurement inputs!**

When using **current-to-current transformers** (e.g. x/5 A) their secondary connectors must be short-circuited during installation and before removing the device. Never open the secondary circuit under load.





Devices with 3V 50/60Hz current inputs

- The current sensors including the conductor isolation must guarantee in total a reinforced or double insulation between the mains circuit connected on the primary side and the measuring inputs of the device.
- The connections ↓ of the current inputs are internally connected. If the 3V current sensors has to be earthed the common connection should be used for that.

Further hints

- The connection of the inputs depends on the configured system (connection type).
- In the connection diagrams on the next pages conventional current-to-current CTs (x/5 A) are used. If the device is equipped with 3V current inputs, the connection of the CTs has to be performed in the same way but using current-to-voltage sensors.
- In the connection diagrams on the next pages conventional voltage transformers are used. If a voltage transformer with **extra windings** for measuring the homopolar voltage is applied, connections should be as shown below.

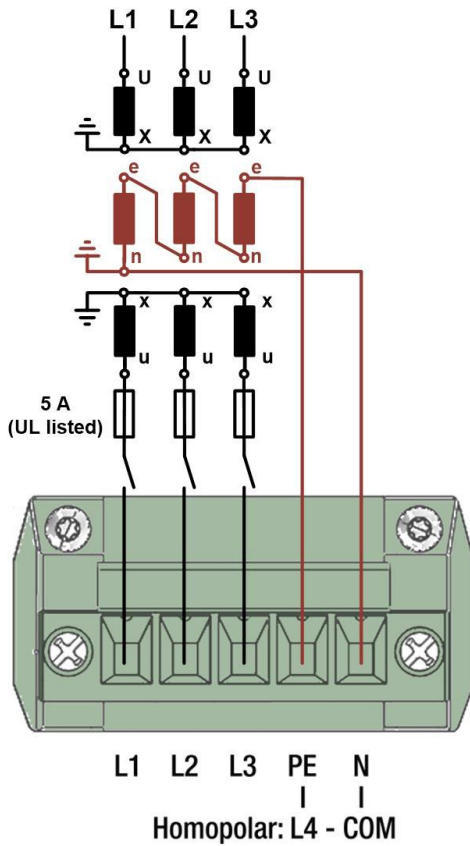


 400 V LN / 693 V LL 50/60Hz - 600 V / CAT III



In order for the homopolar voltage U_{4C} to be measured, the item „Measure homopolar voltage“ must be set to „Yes“ in the settings of the measurement. This item is only available for 3-wire system types.

Single-phase AC mains

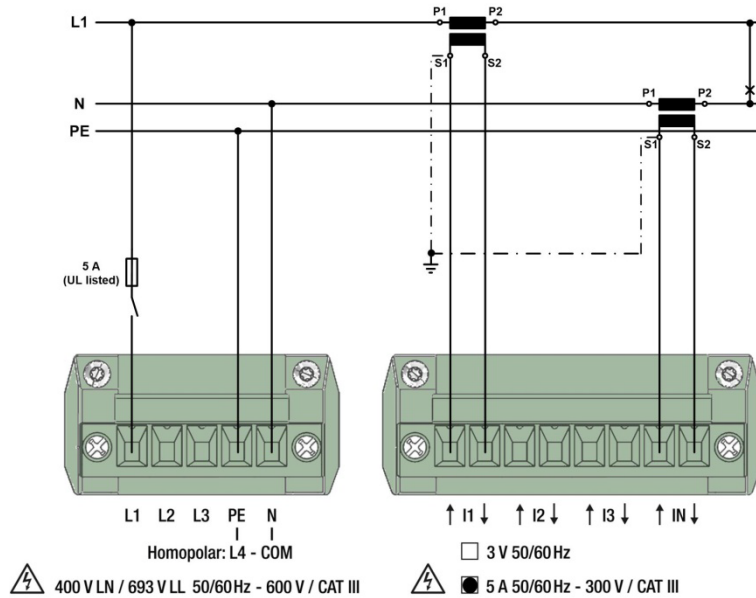

With current transformers


If current I_N does not need to be measured, the corresponding transformer can be omitted.

If voltage U_{NE} does not need to be measured, connection of PE can be omitted.

Direct current measurement

If only currents up to 7.5 A need to be measured no current transformers are required, but restrictions apply:


⚠ Maximum permissible rated voltage 300V to ground!

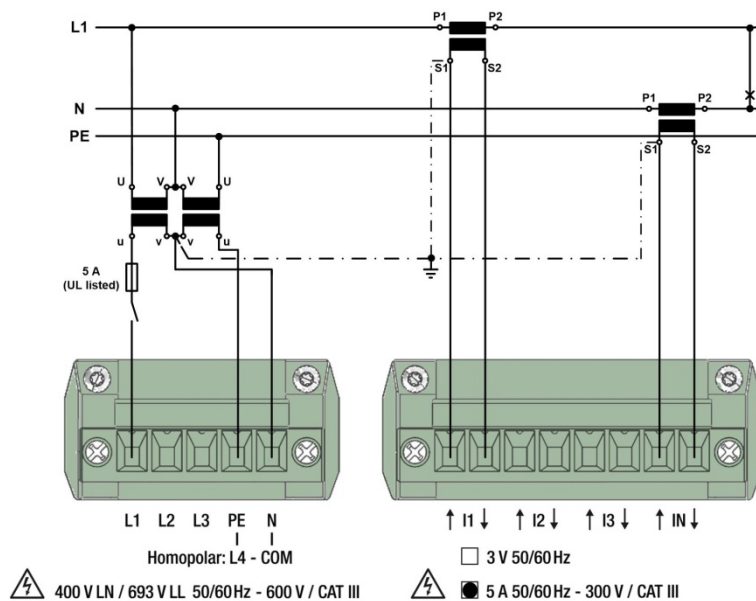

With current and voltage transformer

If current I_N or voltage U_{NE} does not need to be measured, the corresponding transformers can be omitted.


Three wire system, balanced load, current measurement via L1

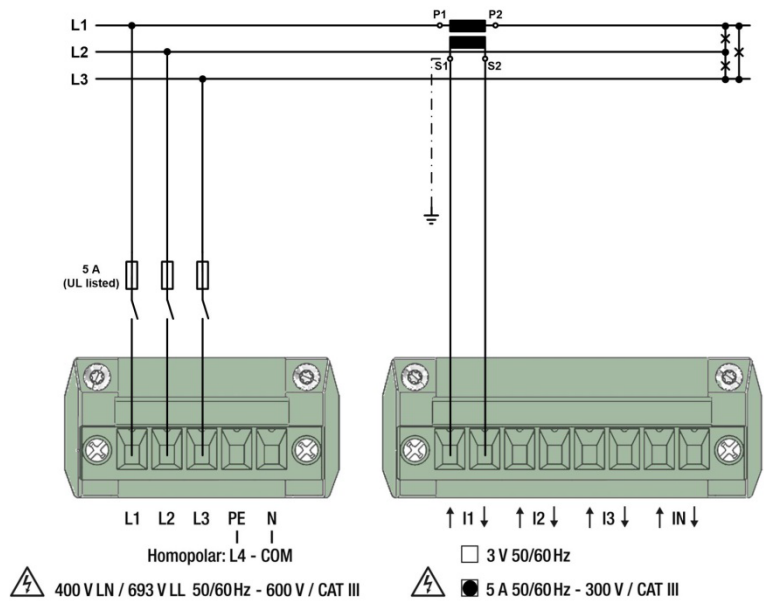

With current transformer

If only currents up to 7.5 A need to be measured no current transformer is required, but restrictions apply:

Maximum permissible rated voltage 300V to ground (520V ph-ph)!

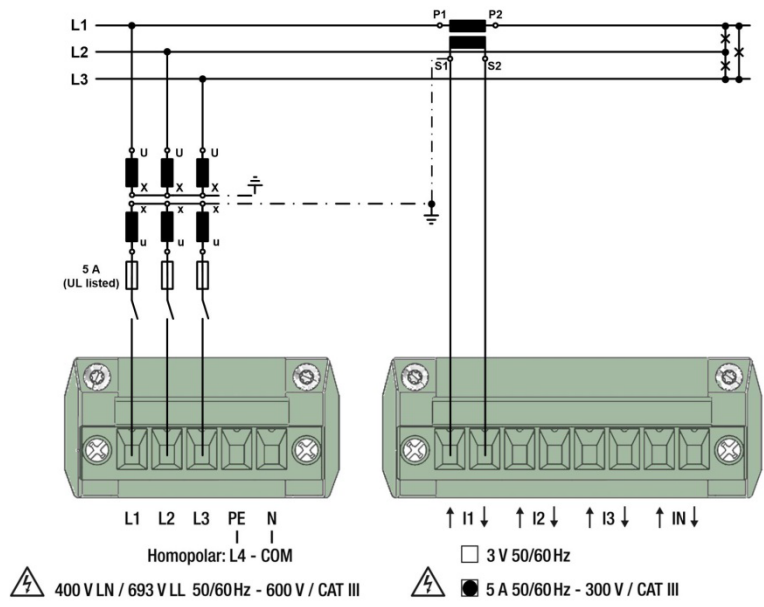


With current and voltage transformers

In case of current measurement via L2 or L3 connect the device according to the following table:

Terminals	↑ I1	I1 ↓	L1	L2	L3
Current meas. via L2	I2(S1)	I2(S2)	L2	L3	L1
Current meas. via L3	I3(S1)	I3(S2)	L3	L1	L2

By rotating the voltage connections the measurements U_{12} , U_{23} and U_{31} will be assigned interchanged!


Three wire system, unbalanced load

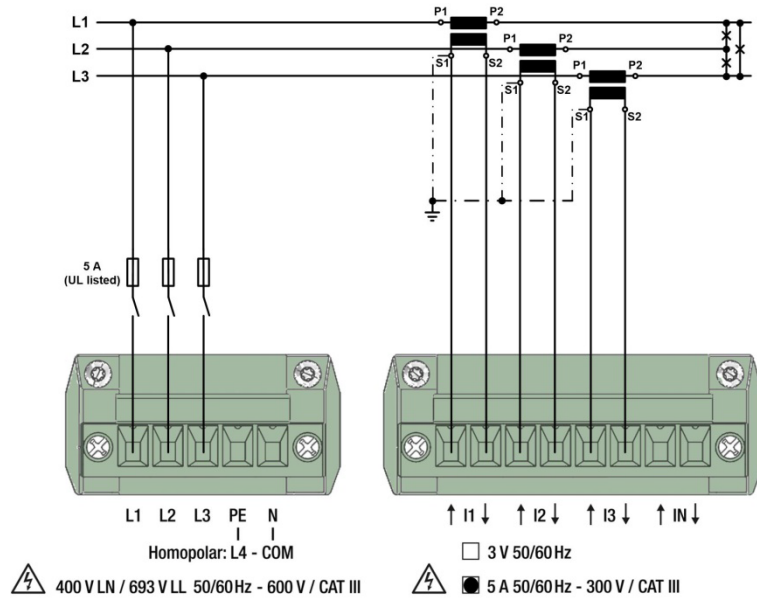

With current transformers


If only currents up to 7.5 A need to be measured no current transformers are required, but restrictions apply:

⚠ Maximum permissible rated voltage
 300V to ground (520V ph-ph)!

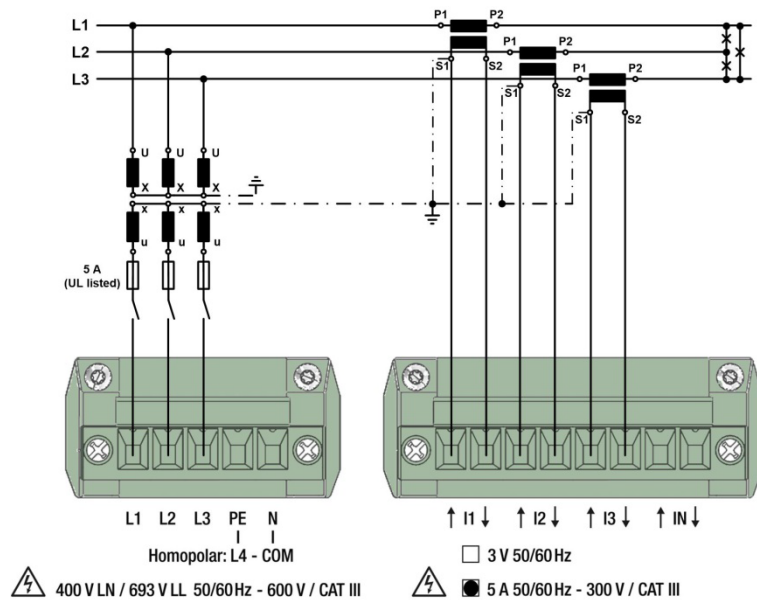


With current and 3 single-pole isolated voltage transformers


Three wire system, unbalanced load, Aron connection

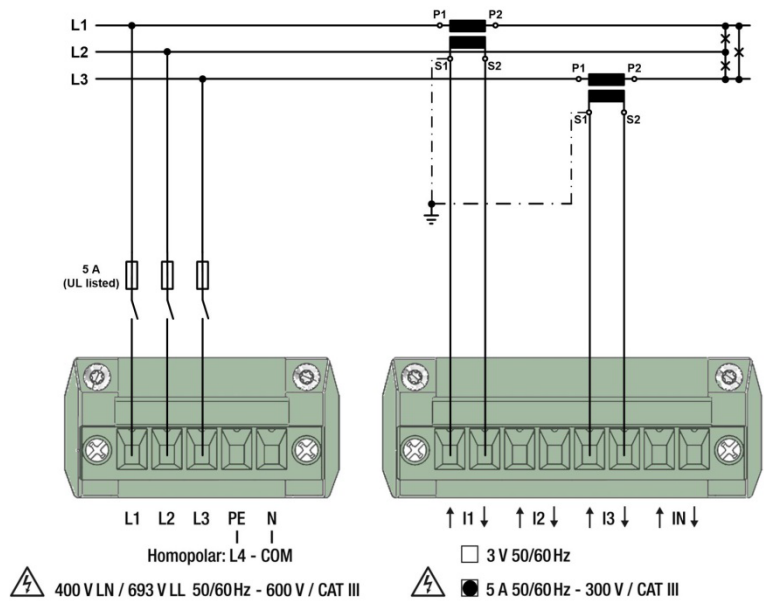

With current transformers


If only currents up to 7.5 A need to be measured no current transformers are required, but restrictions apply:


 Maximum permissible rated voltage 300V to ground (520V ph-ph)!

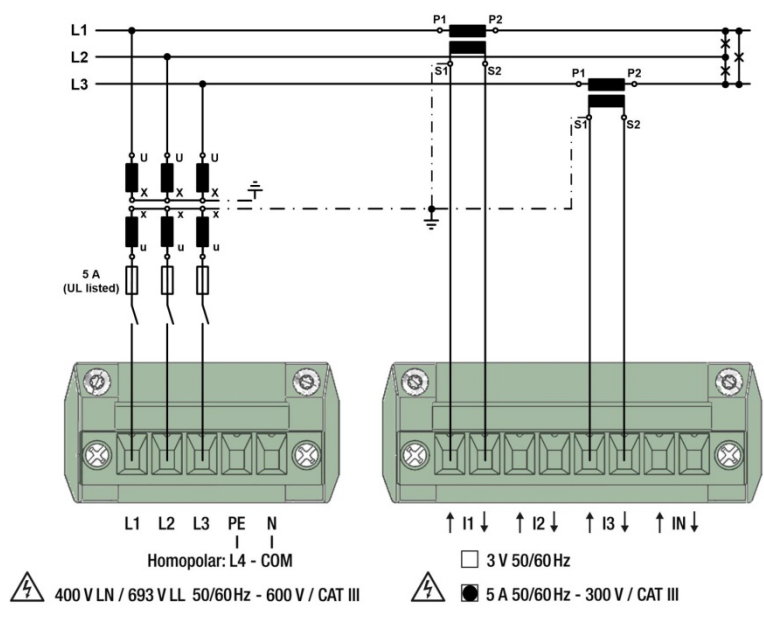

With current and 3 single-pole isolated voltage transformers

Four wire system, unbalanced load

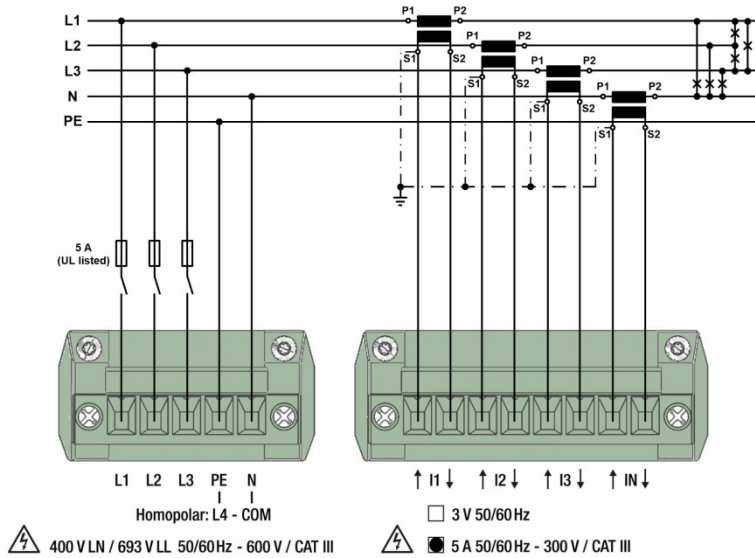


With current transformers

If voltage U_{NE} does not need to be measured, connection of PE can be omitted.
 If current I_N does not need to be measured, the corresponding transformer can be omitted.

Direct current measurement

If only currents up to 7.5 A need to be measured no current transformers are required, but restrictions apply:


Maximum permissible rated voltage
 300V to ground (520V ph-ph)!

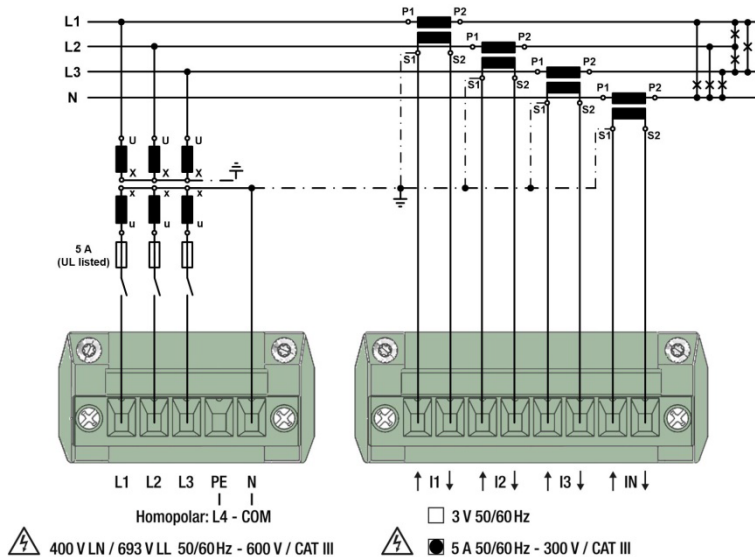

With current and voltage transformer

If current I_N does not need to be measured, the corresponding transformer can be omitted.

Split-phase ("two phase system"), unbalanced load

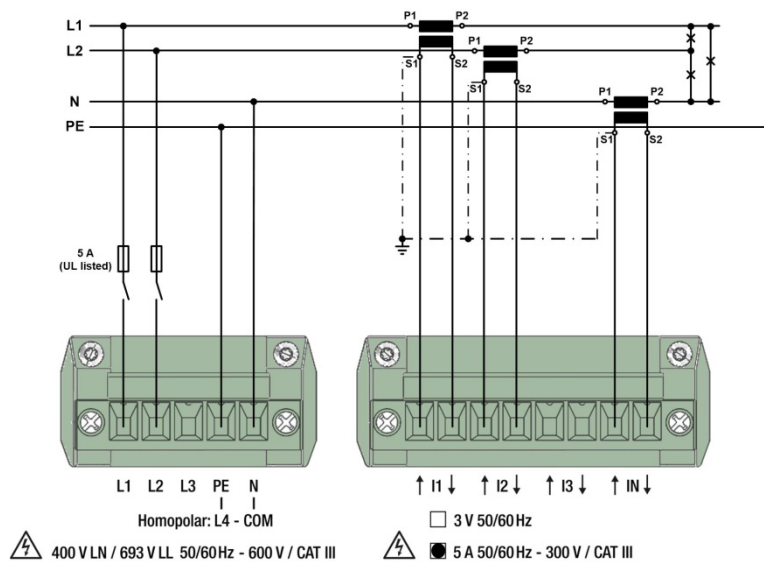


With current transformers

If voltage U_{NE} does not need to be measured, connection of PE can be omitted.
 If current I_N does not need to be measured, the corresponding transformer can be omitted.

Direct current measurement

If only currents up to 7.5 A need to be measured no current transformers are required, but restrictions apply:

⚠ Maximum permissible rated voltage 300V to ground (600V ph-ph)!

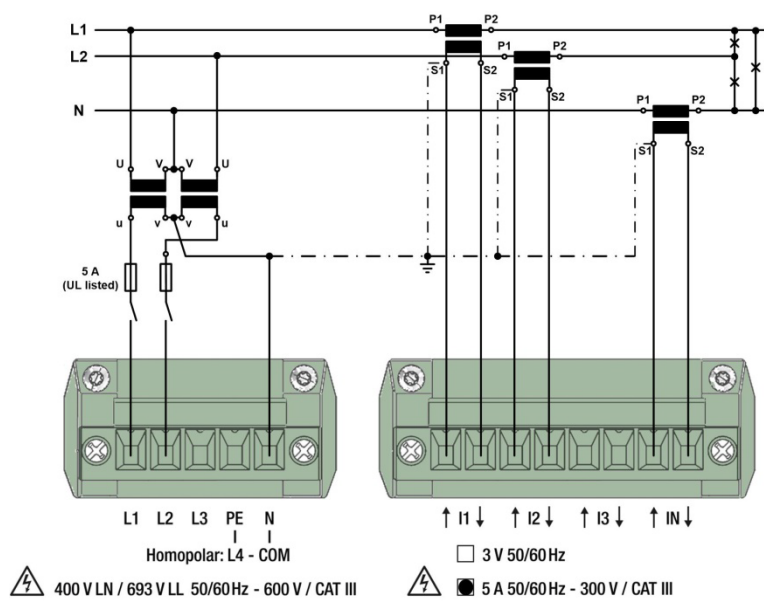

With current and voltage transformer


In systems without a primary neutral conductor a voltage transformer with a secondary center tap can also be used.


5.5 Digital inputs

Usage of the (optional) digital inputs

- ▶ Triggering power quality recordings
- ▶ Trigger and release signal for monitoring functions
- ▶ Operating feedback of loads for operating time counters
- ▶ Registration of external state transitions

Passive inputs (external power supply with 24 ÷ 130V DC required)

 The power supply shall not exceed 130 V DC !

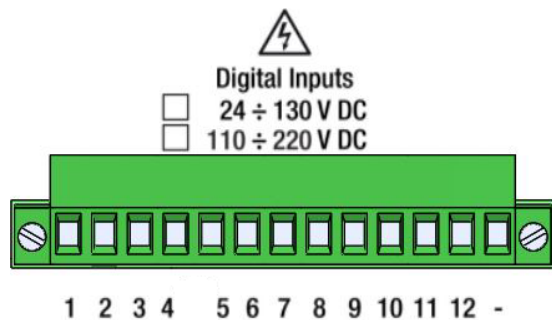


5.6 Digital output

The (optional) relay output can be used with a voltage up to 250V AC/DC.


Usage as digital output

- ▶ Status of internal system warnings/alarms
- ▶ Pending over/under voltage/current event

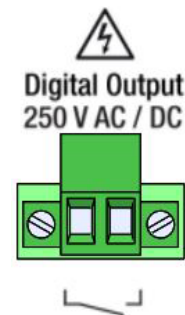

5.7 Analog outputs

Analog Outputs $\pm 0 \div 20$ mA
 Modbus / RTU

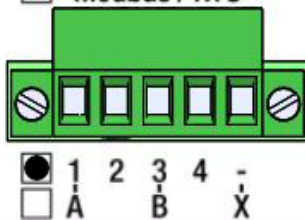


Connection to an analog input card of a PLC or a control system

The device is an isolated measurement device. The module outputs are galvanically connected, but the modules isolated from each other. To reduce the influence of disturbances shielded a twisted-pair cables should be used. The shield should be connected to earth on both opposite ends. If there are potential differences between the ends of the cable the shield should be earthed on one side only to prevent from equalizing currents.

Under all circumstances consider as well appropriate remarks in the instruction manual of the system to connect.

5.8 Modbus interface RS485

Via the optional Modbus interface measurement data may be provided for a superior system. However, the Modbus interface cannot be used for device parameterization.

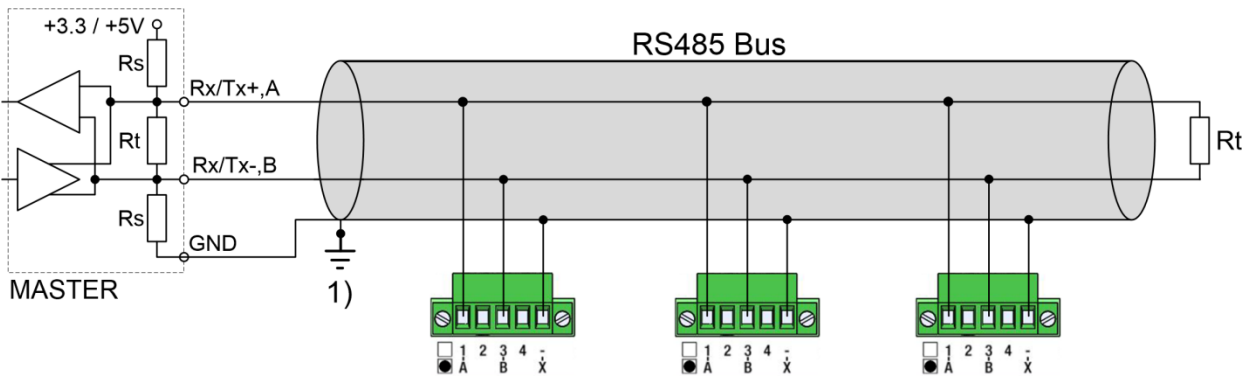

1) One ground connection only. This is possibly made within the master (PC).

Rt: Termination resistors: 120 Ω each for long cables (> approx. 10 m)

Rs: Bus supply resistors, 390 Ω each

The signal wires (A, B) have to be twisted. GND (X) can be connected via a wire or via the cable shield. In disturbed environments shielded cables must be used. Supply resistors (Rs) have to be present in bus master (PC) interface. Stubs should be avoided when connecting the devices. A pure line network is ideal. You may connect up to 32 Modbus devices to the bus.

Modbus RTU enabled	no
Baud rate	115.2kBd
Parity	none parity
Stop bits	2
Device address	1

A proper operation requires that all devices connected to the bus have equal communication settings (baud rate, transmission format) and unique device addresses. Use the appropriate menu in the settings of communication.

If a Modbus/RTU interface is present but not required, communication may be disabled for security reasons.


The bus system is operated half duplex and may be extended to a maximum length of 1200 m without repeater.

5.9 Uninterruptible power supply (UPS)

The [battery pack](#) for the optional uninterruptible power supply is supplied separately. Please note that compared to the storage temperature range of the base unit the [storage temperature range](#) of the battery pack is restricted.

Ensure that devices with uninterruptible power supply are used in an environment in accordance with the [specification](#). The battery pack may not be recharged if the device is used outside this operating temperature range.


Due to aging the capacity of the battery decreases. To ensure a successful operation of the device during power interruptions the battery needs to be replaced every 3 up to 5 years.



Potential for Fire or Burning. Do not disassemble, crush, heat or burn the removed battery pack.

Replace battery pack with a [battery pack of the same type](#) only. Use of another battery may present a risk of fire or explosion.

5.10 GPS time synchronization



The device may be equipped with a connector for connecting a GPS receiver as a very accurate time synchronization source for the measurement device. The GPS receiver is used as outdoor antenna to process data from multiple GPS satellites simultaneously.

GPS receiver

Only use the receiver **Garmin GPS 16x-LVS** (article no. 181'131), offered as an accessory. This device is preconfigured by us and provides the required time information (sentences) without further configuration effort.

- Protection: IPx7 (waterproof)
- Operating temperature: -30...80°C
- Storage temperature: -40...80°C
- 1Hz pulse accuracy: 1µs
- Connector: RJ45



Choosing a mounting location


For a correct operation the GPS receiver requires data from at least 3 satellites at the same time. Therefore, position the receiver so that the clearest possible view of the sky and horizon in all direction is obtained. This can be on the roof of a building, at best without reception being restricted by other buildings or obstacles. Avoid mounting the receiver next to large areas of conductible material, as this may cause poor signal reception. It should be also not closer than 1 meter away from any other antenna.



If lightning protection is required, this must be provided by the user.

Mounting the GPS receiver

- The GPS receiver **Garmin GPS 16x-LVS** can be flush mounted by means of 3 M4 screws.
- 120° distribution over a circle of $\varnothing 71.6\text{mm}$
- Thread length max. 8mm. Using longer screws may damage the GPS receiver.

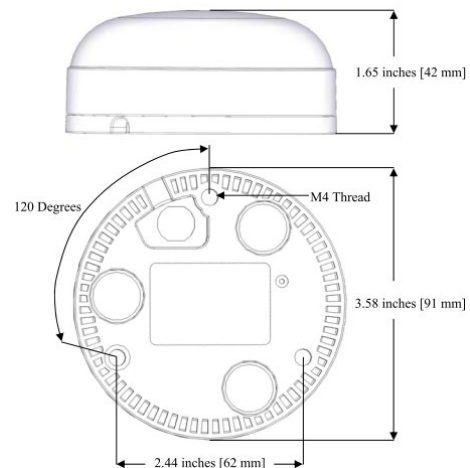

Connecting the GPS receiver



Never connect the RJ45 socket of the connecting cable directly to a network device such as a router or switch. These devices could be damaged.

The GPS receiver is plugged directly into the GPS connector. The connection cable has a length of 5 m. It may be extended using an RJ45 coupling and an Ethernet cable. The connection cable should not be laid in parallel to live conductors. Twisting or sharp kinking of the cable should be avoided.

Commissioning

- In the settings menu change time synchronization to „NTP server / GPS“
- Check the time synchronization status

```
> Service > Device information > Device state

Min/max values reset      Device version
Meter contents set/reset  Device license
Operating hours           Device state
Device information
Factory reset
Firmware update
Communication Tests
Device reboot

-----
interfases -----
1) eth0
MAC:          00:12:34:1A:00:05
State:        Up
Link:         Yes
Speed:        100Mb/s
IP address:   192.168.62.142 [static]
Broadcast addr.: 192.168.63.255 [static]
Subnet mask:  255.255.248.0 [static]
Gateway addr.: 192.168.56.4 [static]

Name servers -----
DNS server 1: 192.168.56.55 [static]

Time sources -----
Source 1:     pool.ntp.org
Source 2:     Local clock
Source 3:     GPS

Time Synchronisation -----
synchronised to GPS at stratum 1
time correct to within 1 ms
polling server every 16 s

GPS Status -----
Number of satellites: 04
GPS quality: Differential fix
```

- The time synchronization can be restarted by switching the time synchronization off and on again.
- Time synchronization via GPS and NTP server may work in parallel. If both synchronization sources are available, the system uses the more accurate time source, which is normally GPS.



When connecting a GPS receiver for the first time or when it has been out of operation for a long time, it may take up to 1 hour for finding enough satellites for GPS receiver operation and thus for a reliable time synchronization.

5.11 IRIG-B time synchronization



The device may be equipped with a BNC connector for connecting the signal of an IRIG-B time server. The input supports IRIG-B004, unmodulated on TTL level.

6. Commissioning



Before commissioning you have to check if the connection data of the device match the data of the plant (see nameplate).

If so, you can start to put the device into operation by switching on the power supply and the measurement inputs.

6.1 Parametrization of the device functionality

A full parameterization of all functions of the device is possible directly at the device or via web browser. This assumes that user has the required access rights.

For security reasons, the security features “Users and Permissions” (RBAC) and “Web security” (HTTPS) are activated in the factory settings. So, before the device webpage can be displayed using https, you have to [install a root certificate](#), which is provided via our homepage. Once the certificate is downloaded to the local computer the certificate can be installed manually. Just double-click on the file, and install the certificate as a trusted root certification authority.


See: [Configuration \(7.5\)](#)

6.2 Installation check

The correct connection of the current and voltage inputs can be checked in two ways.

- a) **Sense of rotation check:** Using the sequence of the current and voltage phasors the sense of rotation is determined and compared to the configured one. The phase rotation indicator is arranged in the menu “Phasor diagram”.

Test requirement: Magnitude of all connected voltages at least 5% of nominal, magnitude of all connected currents at least 0.2% of nominal.

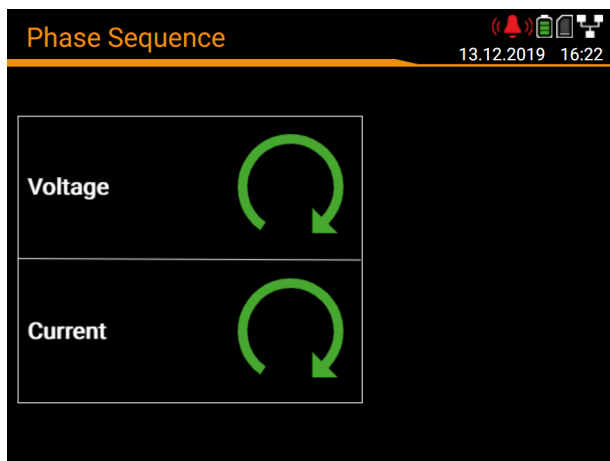

Possible results



Correct sense of rotation








Wrong sense of rotation



Missing phase or magnitude too small

b) **Phasor verification:** The phasor diagram shows a technical visualization of the current and voltage phasors, using a counter-clockwise rotation, independent of the real sense of rotation.

 **The diagram is always built basing on the voltage of the reference channel (direction 3 o'clock)**

 <p>50V/div 20A/div</p>	<table border="1"> <thead> <tr> <th>L1</th> <th>L2</th> <th>L3</th> <th></th> </tr> </thead> <tbody> <tr> <td>230.60</td> <td>230.64</td> <td>230.54</td> <td>V</td> </tr> <tr> <td>0.00</td> <td>-119.97</td> <td>120.03</td> <td>*</td> </tr> <tr> <td>85.97</td> <td>86.03</td> <td>85.86</td> <td>A</td> </tr> <tr> <td>-22.9</td> <td>-21.7</td> <td>-20.0</td> <td>*</td> </tr> <tr> <td>0.921</td> <td>0.929</td> <td>0.940</td> <td>PF</td> </tr> </tbody> </table>	L1	L2	L3		230.60	230.64	230.54	V	0.00	-119.97	120.03	*	85.97	86.03	85.86	A	-22.9	-21.7	-20.0	*	0.921	0.929	0.940	PF	<p>Correct installation (expectation)</p> <ul style="list-style-type: none"> Voltage sequence in clock-wise order L1 → L2 → L3 ($0^\circ \rightarrow -120^\circ \rightarrow 120^\circ$) Current sequence in clock-wise order L1 → L2 → L3 Similar angle between voltage and current phasors in all phases (approx. -20°)
L1	L2	L3																								
230.60	230.64	230.54	V																							
0.00	-119.97	120.03	*																							
85.97	86.03	85.86	A																							
-22.9	-21.7	-20.0	*																							
0.921	0.929	0.940	PF																							
 <p>50V/div 20A/div</p>	<table border="1"> <thead> <tr> <th>L1</th> <th>L2</th> <th>L3</th> <th></th> </tr> </thead> <tbody> <tr> <td>230.58</td> <td>230.63</td> <td>230.53</td> <td>V</td> </tr> <tr> <td>0.00</td> <td>-119.97</td> <td>120.03</td> <td>*</td> </tr> <tr> <td>85.96</td> <td>86.04</td> <td>85.87</td> <td>A</td> </tr> <tr> <td>-22.9</td> <td>158.4</td> <td>-20.0</td> <td>*</td> </tr> <tr> <td>0.921</td> <td>-0.930</td> <td>0.940</td> <td>PF</td> </tr> </tbody> </table>	L1	L2	L3		230.58	230.63	230.53	V	0.00	-119.97	120.03	*	85.96	86.04	85.87	A	-22.9	158.4	-20.0	*	0.921	-0.930	0.940	PF	<p>What's wrong?</p> <ul style="list-style-type: none"> Voltage sequence: L1 → L2 → L3 Current sequence: L1 → L3 → L2; Current L2 is out of the expected sequence Angle U-I: Angle between U_{L2} and I_{L2} is approx. 180° wrong <p>Required correction Reversing the polarity of current I_2</p>
L1	L2	L3																								
230.58	230.63	230.53	V																							
0.00	-119.97	120.03	*																							
85.96	86.04	85.87	A																							
-22.9	158.4	-20.0	*																							
0.921	-0.930	0.940	PF																							
 <p>50V/div 20A/div</p>	<table border="1"> <thead> <tr> <th>L1</th> <th>L2</th> <th>L3</th> <th></th> </tr> </thead> <tbody> <tr> <td>230.59</td> <td>230.49</td> <td>230.70</td> <td>V</td> </tr> <tr> <td>0.00</td> <td>120.04</td> <td>-119.99</td> <td>*</td> </tr> <tr> <td>85.97</td> <td>86.02</td> <td>85.86</td> <td>A</td> </tr> <tr> <td>-22.9</td> <td>98.3</td> <td>-140.0</td> <td>*</td> </tr> <tr> <td>0.921</td> <td>-0.145</td> <td>-0.766</td> <td>PF</td> </tr> </tbody> </table>	L1	L2	L3		230.59	230.49	230.70	V	0.00	120.04	-119.99	*	85.97	86.02	85.86	A	-22.9	98.3	-140.0	*	0.921	-0.145	-0.766	PF	<p>What's wrong?</p> <ul style="list-style-type: none"> Voltage sequence: L1 → L3 → L2; L3 and L2 seems to be interchanged Current sequence: L1 → L2 → L3 Angle U-I: Angles between U_{L2} / I_{L2} and U_{L3} / I_{L3} do not correspond to the expectations <p>Required correction Exchanging the connections of the voltages L2 and L3</p>
L1	L2	L3																								
230.59	230.49	230.70	V																							
0.00	120.04	-119.99	*																							
85.97	86.02	85.86	A																							
-22.9	98.3	-140.0	*																							
0.921	-0.145	-0.766	PF																							
 <p>50V/div 20A/div</p>	<table border="1"> <thead> <tr> <th>L1</th> <th>L2</th> <th>L3</th> <th></th> </tr> </thead> <tbody> <tr> <td>230.58</td> <td>230.49</td> <td>230.68</td> <td>V</td> </tr> <tr> <td>0.00</td> <td>120.04</td> <td>-119.99</td> <td>*</td> </tr> <tr> <td>85.97</td> <td>86.04</td> <td>85.86</td> <td>A</td> </tr> <tr> <td>-22.9</td> <td>-81.6</td> <td>-140.0</td> <td>*</td> </tr> <tr> <td>0.921</td> <td>0.145</td> <td>-0.766</td> <td>PF</td> </tr> </tbody> </table>	L1	L2	L3		230.58	230.49	230.68	V	0.00	120.04	-119.99	*	85.97	86.04	85.86	A	-22.9	-81.6	-140.0	*	0.921	0.145	-0.766	PF	<p>What's wrong?</p> <ul style="list-style-type: none"> Voltage sequence: L1 → L3 → L2; L3 and L2 seems to be exchanged Current sequence: L1 → L3 → L2; Current L2 is out of the expected sequence Angle U-I: Angles between U_{L2} / I_{L2} and U_{L3} / I_{L3} do not correspond to the expectations <p>Required correction Exchanging the connections of the voltages L2 and L3 and reversing the polarity of the current input I_2</p>
L1	L2	L3																								
230.58	230.49	230.68	V																							
0.00	120.04	-119.99	*																							
85.97	86.04	85.86	A																							
-22.9	-81.6	-140.0	*																							
0.921	0.145	-0.766	PF																							
 <p>50V/div 20A/div</p>	<table border="1"> <thead> <tr> <th>L1</th> <th>L2</th> <th>L3</th> <th></th> </tr> </thead> <tbody> <tr> <td>230.45</td> <td>230.48</td> <td>230.58</td> <td>V</td> </tr> <tr> <td>0.00</td> <td>-120.02</td> <td>119.98</td> <td>*</td> </tr> <tr> <td>85.96</td> <td>86.00</td> <td>85.86</td> <td>A</td> </tr> <tr> <td>-143.0</td> <td>-141.6</td> <td>-140.0</td> <td>*</td> </tr> <tr> <td>-0.798</td> <td>-0.784</td> <td>-0.766</td> <td>PF</td> </tr> </tbody> </table>	L1	L2	L3		230.45	230.48	230.58	V	0.00	-120.02	119.98	*	85.96	86.00	85.86	A	-143.0	-141.6	-140.0	*	-0.798	-0.784	-0.766	PF	<p>What's wrong?</p> <ul style="list-style-type: none"> Voltage sequence: L1 → L2 → L3 Current sequence: L3 → L1 → L2 Angle U-I: The U-I angles do not correspond to the expectation, but are similar <p>Required correction Cyclical exchange of the voltage connections: $L1 \rightarrow L3$, $L2 \rightarrow L1$, $L3 \rightarrow L2$. As an alternative the sequence of all currents may be changed as well (more effort required).</p>
L1	L2	L3																								
230.45	230.48	230.58	V																							
0.00	-120.02	119.98	*																							
85.96	86.00	85.86	A																							
-143.0	-141.6	-140.0	*																							
-0.798	-0.784	-0.766	PF																							

6.3 Ethernet installation

6.3.1 Settings

Before devices can be connected to an existing Ethernet network, you have to ensure that they will not disturb the normal network service. The rule is:



None of the devices to connect is allowed to have the same IPv4/6 address than another device already installed.

The device supports both IPv4 and IPv6 communication. IPv4 communication is activated by default; IPv6 can be activated additionally via configuration.

IPv4 communication

Depending on the device version, there may be multiple involved network devices with different default IPv4 addresses.

Interface	Application	Default IPv4	Settings via menu
Standard 1	Configuration Device 1	192.168.1.101	Settings Communication Ethernet
Standard 2	Configuration Device 2 (double rack only)	192.168.1.102	Settings Communication Ethernet
IEC 61850	IEC61850 communication	192.168.1.111	Settings IEC61850 Ethernet

IPv6 communication

Depending on the device version, there may be multiple involved network devices with different default IPv6 addresses, once the IPv6 communication is activated.

Interface	Application	Default IPv6	Settings via menu
Standard 1	Configuration Device 1	fd2d:bb44:97f1:3976::1	Settings Communication Ethernet
Standard 2	Configuration Device 2 (double rack only)	fd2d:bb44:97f1:3976::2	Settings Communication Ethernet
IEC 61850	IEC61850 communication	fd2d:bb44:97f1:3976::B	Settings IEC61850 Ethernet

Network settings (Communication | Ethernet)

The following settings have to be arranged with the network administrator:

• IPv4/6: IP address	Must be unique , i.e. may be assigned in the network only once
• IPv4: Subnet mask	Defines how many devices are directly addressable in the IPv4 network. This setting is equal for all the devices. Examples
• IPv4/6: Gateway address	Is used to resolve addresses during communication between different networks. It should contain a valid address within the directly addressable network
• IPv4/6: DNS-Server x	Is used to resolve a domain name into an address, if e.g. a name (pool.ntp.org) is used for the NTP server. Further information
• IPv6: Prefix length	Is comparable to the subnet mask in IPv4 networks; it is the number of the leftmost bits of the site prefix which need to be identical for direct communication.
• Hostname	Individual designation for each device. Via the hostname the device can be uniquely identified in the network. Therefore for each device a unique name should be assigned.
• NTP-Server x	NTP servers are used as base for time synchronization

IPv4: Mode	Static
IPv4: IP address	192.168.62.25
Subnet mask	255.255.248.0
IPv4: Gateway address	192.168.56.5
IPv4: DNS server 1	192.168.56.55
IPv4: DNS server 2	192.168.56.155
IPv6: Mode	Static
IPv6: IP address	fd2d:bb44:97f1:3976::3
IPv6: Prefix length	64
IPv6: Gateway address	fd2d:bb44:97f1:3976::5:1
IPv6: DNS server 1	
IPv6: DNS server 2	
Host name	PQ5000Exxxx
Clock synchronization	NTP server / GPS
NTP server 1	pool.ntp.org
NTP server 2	

Network settings of Standard Ethernet interface

IP address	192.168.62.103
Subnet mask	255.255.248.0
Gateway address	192.168.56.5
DNS server 1	192.168.56.55
DNS server 2	192.168.56.155
Host name	PQ5000-IEC61850-RR
Clock synchronization	NTP server
NTP server 1	pool.ntp.org
NTP server 2	

Network settings of IEC61850 interface

IPv4: Subnet mask

For a direct communication between device and PC both devices need to be in the same network when the subnet mask is applied:

Example 1	decimal	binary
IP address	192.168. 1.101	11000000 10101000 00000001 01100101
Subnet mask	255.255.255.224	11111111 11111111 11111111 11100000
	variable range	xxxxxx
First address	192.168. 1. 96	11000000 10101000 00000001 01100000
Last address	192.168. 1.127	11000000 10101000 00000001 01111111

► The device 192.168.1.101 can access directly the devices 192.168.1.96 ... 192.168.1.127


Example 2	decimal	binary
IP address	192.168. 57. 64	11000000 10101000 00111001 01000000
Subnet mask	255.255.252. 0	11111111 11111111 11111100 00000000
	variable range	xx xxxxxxxx
First address	192.168. 56. 0	11000000 10101000 00111000 00000000
Last address	192.168. 59.255	11000000 10101000 00111011 11111111

► The device 192.168.57.64 can access directly the devices 192.168.56.0 ... 192.168.59.255

IPv4: Mode >> DHCP

If a DHCP server is available, alternatively to the static mode „DHCP“ or „DHCP, addresses only“ can be selected. The device then gets all necessary information from the DHCP server. The difference between the two modes is that for “DHCP” also the DNS server address is obtained.

The settings obtained from the DHCP server can be retrieved locally via the service menu.

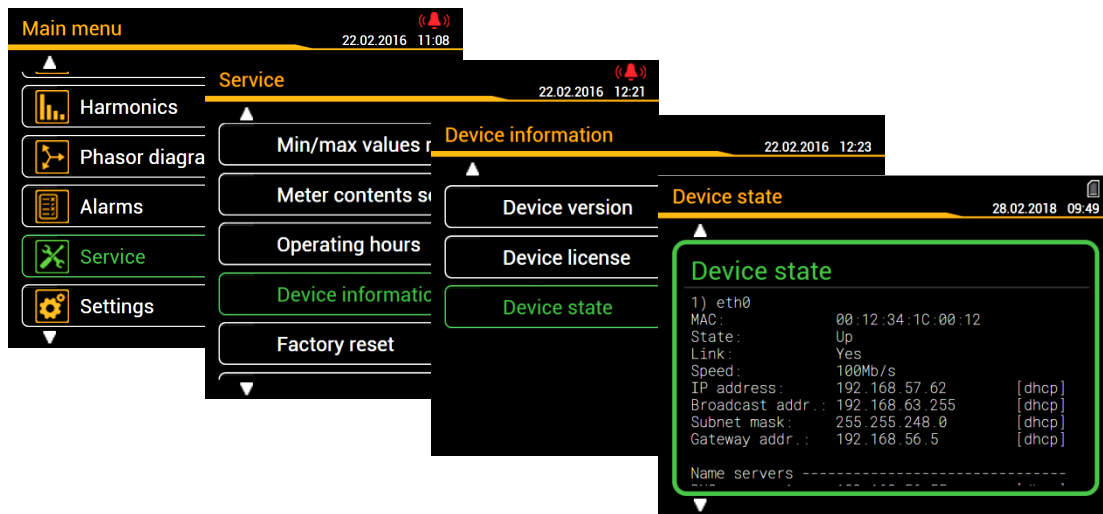

Depending on the settings of the DHCP server the provided IPv4 address can change on each reboot of the device. Thus, it's recommended to use the DHCP mode during commissioning only.

Time synchronization via NTP protocol

For the *time synchronization* of devices via Ethernet *NTP* (Network Time Protocol) is the standard. Corresponding time servers are used in computer networks, but are also available for free via Internet. Using NTP it's possible to hold all devices on a common time base.

Two different NTP servers may be defined. If the first server is not available the second server is used for trying to synchronize the time.

If a public NTP server is used, e.g. “pool.ntp.org”, a name resolution is required. This normally happens via a **DNS server**. So, the IP address of the DNS server must be set in the communication settings of the Ethernet interface to make a communication with the NTP server, and thus time synchronization, possible. Your network administrator can provide you the necessary information.

The time synchronization of the Standard interface can be performed via a [GPS receiver](#) or an [IRIG-B time server](#) as well.

TCP ports

The TCP communication is done via so-called ports. The number of the used port allows determining the type of communication. As a standard Modbus/TCP communication is performed via TCP port 502, NTP uses port 123. However, the port for the Modbus/TCP communication may be modified. You may provide a unique port to each of the devices, e.g. 503, 504, 505 etc., for an easier analysis of the communication traffic. Independent of these setting a communication via port 502 is always supported. The device allows at least 5 connections to different clients at the same time.

Firewall

Due to security reasons nowadays each network is protected by means of a firewall. When configuring the firewall you have to decide which communication is desired and which have to be blocked. The TCP port 502 for the Modbus/TCP communication normally is considered to be unsafe and is often disabled. This may lead to a situation where no communication between networks (e.g. via Internet) is possible.

6.3.2 Connection of the standard interface

The standard Ethernet interface is available via both a RJ45 connector on the front and on the back of the device.

- Interface: RJ45 socket, Ethernet 100BaseTX
- Mode: 10/100 MBit/s, full / half duplex, Auto-negotiation
- Protocols: http, https, Modbus/TCP, NTP

6.3.3 Connection of the IEC61850 interface

The two ports (RJ45) of the IEC61850 interface are available via back of the device. Both ports are equivalent and internally connected via a switch.

- Interface: RJ45 sockets, Ethernet 100BaseTX
- Mode: 10/100 MBit/s, full / half duplex, auto-negotiation
- Protocols: IEC61850, NTP

6.3.4 MAC addresses

For uniquely identifying Ethernet connections in a network, a unique MAC address is assigned to each connection. Compared to the IP address, which may be modified by the user at any time, the MAC address is static. The corresponding MAC addresses are given on the nameplate and may be displayed also via Service | Device information | Device state or IEC61850 status respectively.

6.4 Communication tests

Via the service menu on the device website you may check if the selected network structure is valid. The device must be able to reach the DNS server via gateway. The DNS server then allows resolving the URL of the NTP server to an IP address. The Standard Ethernet interface serves as interface for the communication tests.

- Ping: Connection test to any network device (initial: gateway address)
- DNS: Test, if the name resolution via DNS works (initial: URL of NTP server)
- NTP: Test, if the selected NTP-Server is in fact a time server (stratum x)
- SFTP: Test, if access to SFTP server works. A test file will be copied to the base directory of the server.

```
Testing NTP 'pool.ntp.org'
=====
server 176.10.99.200, stratum 2, offset -0.000689, delay
0.03264
server 162.159.200.123, stratum 3, offset 0.000510, delay
0.03139
server 84.16.67.12, stratum 1, offset -0.000664, delay
0.03560
server 5.148.175.134, stratum 2, offset -0.000103, delay
0.03174
23 Apr 14:29:06 ntpdate[5257]: adjust time server
84.16.67.12 offset -0.000664 sec
```

NTP server test

6.5 3G/4G Router

The optional 3G/4G router provides access to device data via the mobile communication network.

- Type: RUT240, LTE CAT4 Industrial Cellular Router
- Manufacturer: Teltonika
- Instructions available via: https://wiki.teltonika.lt/view/RUT240_Manual
- Default IP address for configuration: 192.168.1.1

SIM card

The router is delivered without SIM card. To insert a SIM card, you have to open the top cover of the rack housing by removing the 6 fixing screws first.



Ensure that all leads already connected to the device are free of potential before opening the cover!

The router is mounted on the left side wall (seen from the back).

1. Push the SIM holder button with the SIM needle
2. Pull out the SIM holder
3. Insert your SIM card into the SIM holder
4. Slide the SIM holder back into the router



6.6 IEC 61850 interface

The features of the optional IEC61850 interface are described in a separate document:


>> IEC61850 interface SINEAX AMx000/DM5000, LINAX PQx000, CENTRAX CUx000

This document is available via: <https://www.camillebauer.com/>

6.7 Simulation of analog / digital outputs

To check if subsequent circuits will work properly with output values provided by the device, using the service menu **Simulation** analog or digital outputs may be simulated. This is done by either entering analog output values or selecting a discrete state for the digital output.

Simulation is possible via webpage and as well via the local display.

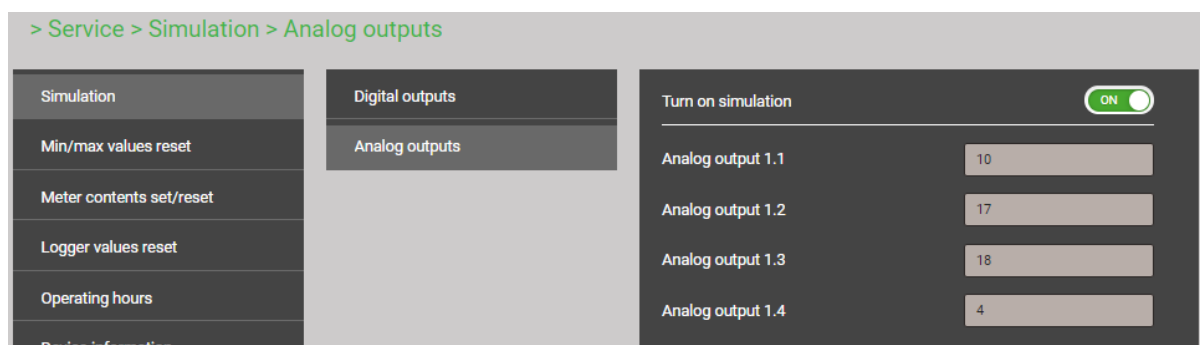

Simulation of analog outputs via device webpage

6.8 Security system

There are several security mechanism implemented in the device which can be activated to provide a comprehensive access protection to all device data.

- The **role-based access control (RBAC)** system allows restricting the access to measured data, configuration settings and service functions to the rights granted to the present user. For access via website or local display this is done by reducing the available menus and / or providing only read access rights to specific services. For accessing data via external applications an API (Application Programming Interface) key is required, which needs to be implemented as a special user.
- **HTTPS** provides encrypted communication using TLS (Transport Layer Security)
- Via **client whitelist** access to the device can be restricted to specific clients with definable IP addresses
- **Communication blocking:** Communication services, such as Modbus/RTU, Modbus/TCP or SYSLOG are blocked by default and must be actively enabled via configuration. This way unauthorized access may be prevented and possible intruding points eliminated.
- **Audit log:** The device stores all security related messages in a separate list accessible via the service menu. The content of this list can also be transferred to a central log-server using the **SYSLOG** protocol for security auditing.

If the device is equipped with a display, restrictions defined in the security system also take effect when operating the device via the local display. It is also possible to restrict users to local access only.

6.8.1 RBAC management

Each access to device data via website, local display or external software applications can be comprehensively protected using the role-based access control (RBAC) system. This way, access to measured value information, the change of configuration parameters or the resetting / deletion of measurement data can be individually adapted to the role of the active user.

Note: All settings of the security system are stored in the device in encrypted form only; login credentials are never transmitted in plain text.

A maximum of 8 users is supported

- **3 pre-defined standard users**
 - *admin*: A user with administrator rights (Default setting password: „CBM_1234“)
 - *localgui*: The standard user for the local display. Its permissions determine what can be displayed or changed via the built-in display without a user having to log in.
 - *anonymous*: The standard user for access via device website. Its permissions determine what can be displayed or changed via the website without a user having to log in.
- **Up to 5 definable users or API keys**


Users or API keys may be created by each user with write access to the settings of the security system. In any case, each user with a web login can change the password of its own account. Application programming interface (API) keys are used to allow applications to access device data via REST interface (communication via http/https protocol). Such keys are timely unlimited and have either read-only permissions, all permissions or all permissions except security.

The pre-defined administrator or any other user with full access rights to the settings of the security system can:


 - Change its own credentials (user name and/or password)
 - Change the credentials (user name and/or password) of any other user
 - Freely define the permissions of the standard users *localgui* and *anonymous*; both users are standard users without login credentials
 - Create new users up to a maximum of 5
 - Restrict users to local operation only (no login via website)

Adding users / API keys

In addition to the 3 predefined users a maximum of 5 users or API keys may be created. To do so, use “Add user / API key” and select the type of user to be created.

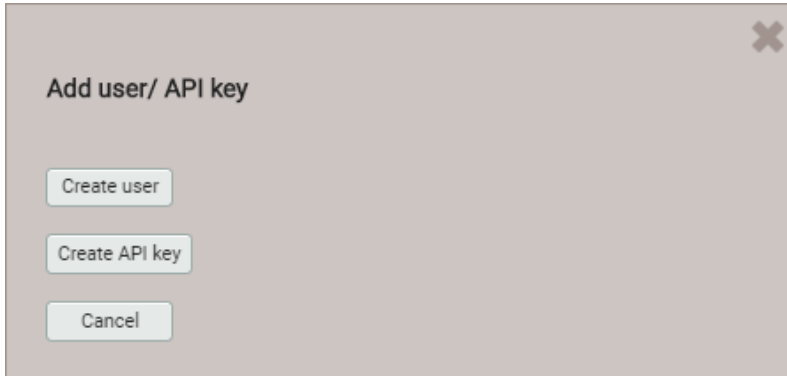

Users: During password definition the requirements for a secure password are checked and the result is displayed. Each new user can be created based on the permission template of an already existing user, but all of these permissions may be changed later.

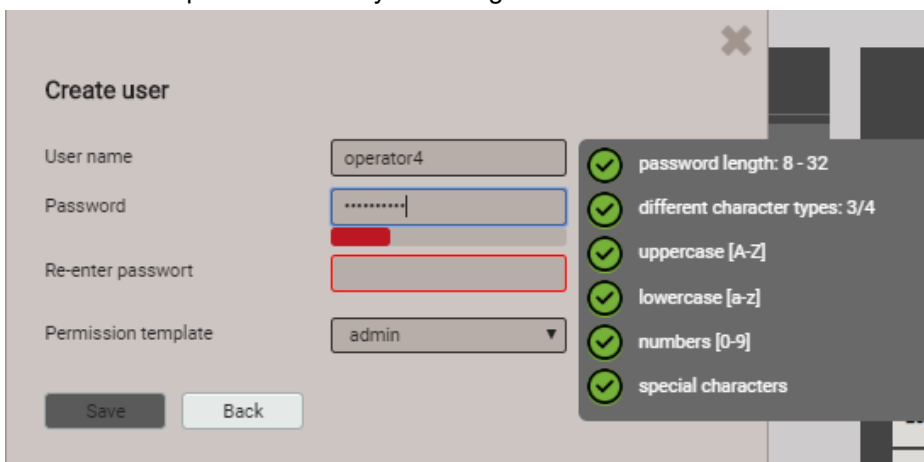

When defining / changing passwords the following restrictions must be considered:





- Password length 8 up to 32 characters
- At least three different types of characters must be used (uppercase, lowercase, numbers, special characters)



CAUTION: If login credentials (user name and / or password) of users with write access to the security system are changed, this information must be kept safe. For security reasons resetting the RBAC system can only be done at the factory, no backdoor is implemented.

API key: Along with the key name you have to define the permissions to be granted to the application using the key via REST interface. The resulting access rights cannot be changed afterwards.

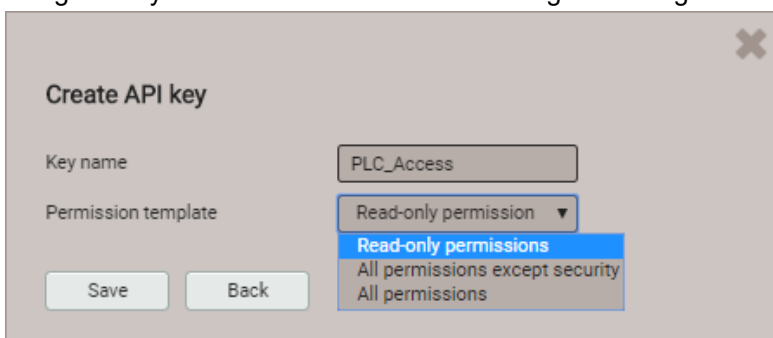

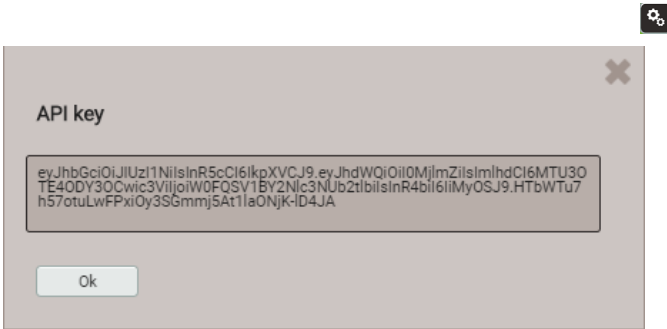

When the application wants to communicate via REST interface with the device, it has to provide the API key and the session token via the cookie field in the request header, e.g.:

Cookie:

```
AccessToken=eyJhbGciOiJIUzI1NiIsInR5cCI6IkpXVCJ9.eyJhdWQiOiIiIiwiaWF0IjoxNTc5MTU0MTUzOjE4ODY3ODcic3VlcnI6ImZlbyI6ImMyOSJ9.HTbWTU7h57otuLwFPxiOy3S5mmj5At1la0Njk-ID4JA
sessionToken={5d1ca47c-8d38-4a08-85d5-feb941fa20}
```

Further information is provided in the document "http interface SINEAX PQx000"

Assignment of user rights

The assignment of the user rights granted for operation is done via the menu Settings | Security system | Users and permissions:


	admin	localgui	anonymous	operator1	operator2	operator3	[API]AccessToken
Local account (no weblogin)	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Instantaneous values							
Energy							
Harmonics							
Phasor diagram							
Waveform							
Events							
PQ statistic							
Service							
Reset values							
Reset/Update device							
Audit Log							
Use IO simulation							
Settings							
Basic device settings							
Measurement							
Communication							
Security system							

- Measurements or settings can be displayed
- Measurements or settings cannot be displayed
- Settings can be changed
- Settings cannot be changed
- Field not selectable
- Change a user's login credentials



Overview of the access rights of each possible user

6.8.2 User log in / out via website

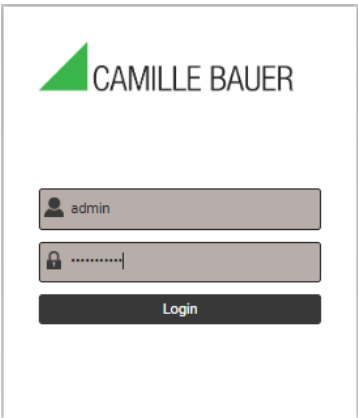


a) If “anonymous” has no granted permissions

Via website	Remarks
	<ol style="list-style-type: none">1) Enter user name and password2) Press <ENTER> or select “Login” If successful, depending on the permissions of the user logged in, the appropriate website is displayed

b) If “anonymous” has granted permissions


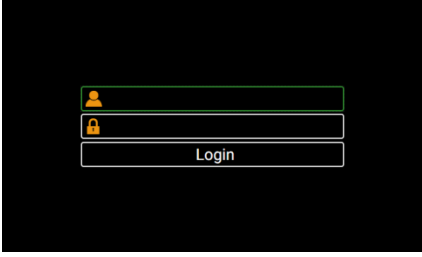
Via website	Remarks
	<ol style="list-style-type: none">1) Click on the symbol 2) Enter user name and password. On first login use the default settings admin / CBM_1234.3) Press <ENTER> or select “Login” If successful, depending on the permissions of the user logged in, the appropriate website is displayed

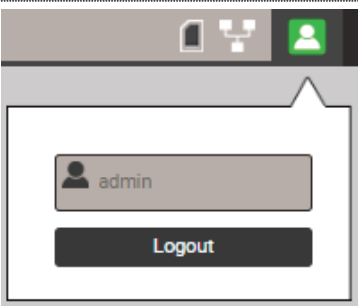c) If another user is already logged in


Via website	Remarks
	Log out the current user by selecting “Logout”
	<ol style="list-style-type: none">1) Click on the symbol 2) Enter user name and password3) Press <ENTER> or select “Login” If successful, depending on the permissions of the user logged in, the appropriate website is displayed

6.8.3 User log in / out via local display



a) If “localgui” has no granted permissions

Locally	Remarks
	<p>No information is displayed on the screen. Press <ESC> to enter the login screen.</p> <ol style="list-style-type: none"> 1) Press <OK> to enter the user name 2) Proceed to password using ▼ 3) Press <OK> to enter the password 4) Proceed to Login and press <OK> <p>If successful, depending on the permissions of the user logged in, the appropriate menu is displayed.</p>
	


b) If localgui has granted permissions

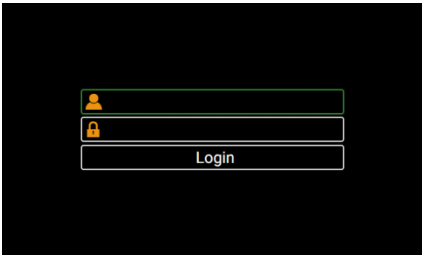Locally	Remarks
	<p>Repeatedly press <ESC> until the login screen is displayed.</p> <ol style="list-style-type: none"> 1) Press <OK> to enter the user name 2) Proceed to password using ▼ 3) Press <OK> to enter the password 4) Proceed to Login and press <OK> <p>If successful, depending on the permissions of the user logged in, the appropriate menu is displayed</p>

c) If another user is already logged in

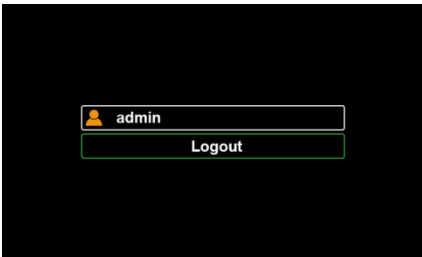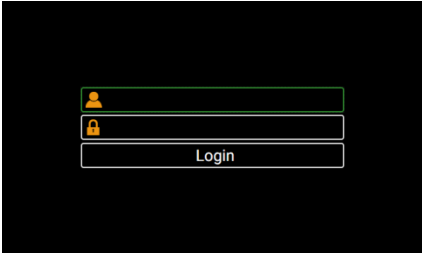Locally	Remarks
	<p>Repeatedly press <ESC> until the login screen is displayed.</p> <p>Log out the current user by selecting “Logout”</p> <p>Depending on the permissions of localgui either a menu or the lock symbol is displayed</p> <p>Repeatedly press <ESC> until the login screen is displayed.</p> <ol style="list-style-type: none"> 1) Press <OK> to enter the user name 2) Proceed to password using ▼ 3) Press <OK> to enter the password 4) Proceed to Login and press <OK> <p>If successful, depending on the permissions of the user logged in, the appropriate menu is displayed.</p>
	

6.8.4 Whitelisting clients

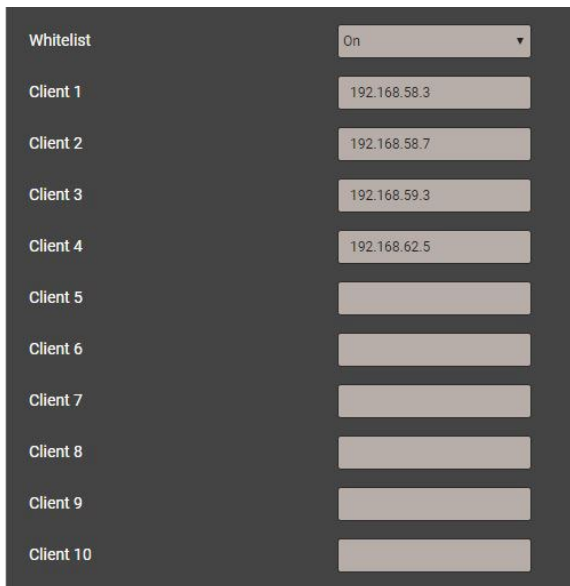

It is possible to define a list of IPv4 and/or IPv6 addresses of up to 10 clients allowed to have access to the device. All other clients will be blocked. Enable the whitelist via the *Settings* of the *Security system* in the item *Whitelist*.




If a DHCP server is used in the system, clients may get different IP addresses on each startup, losing this way access to the device.

If a device is no longer accessible you can reset its IP address (LAN), deactivating the whitelist at the same time.

6.8.5 Secure communication using https

The https communication is activated by default. This protocol provides encrypted communication using TLS (Transport Layer Security). Such as bidirectional encryption of communications between a client and server protects against eavesdropping and tampering of the communication, by creating a secure channel over an insecure network.


Before HTTPS communication can be used a root certificate needs to be installed. The user can either use a Camille Bauer certificate (default setting) or its own customer certificate. This may be changed when defining the Settings of the Security system.

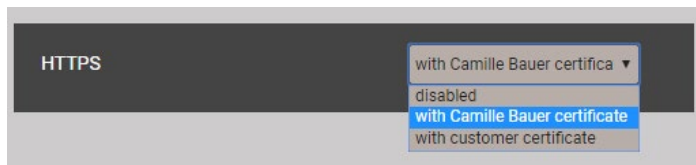

Camille Bauer certificate


The Camille Bauer Metrawatt root certificate is provided via <https://camillebauer.com/pq5000r-en>). It needs to be installed before the browser is started.

Once the certificate is downloaded to the local computer the certificate can be installed manually. Just double-click on the file. **Install certificate**, then select **Place all certificates in the following store**, **Browse** and select **Trusted Root Certification Authorities**. **Finish** the Import Wizard.

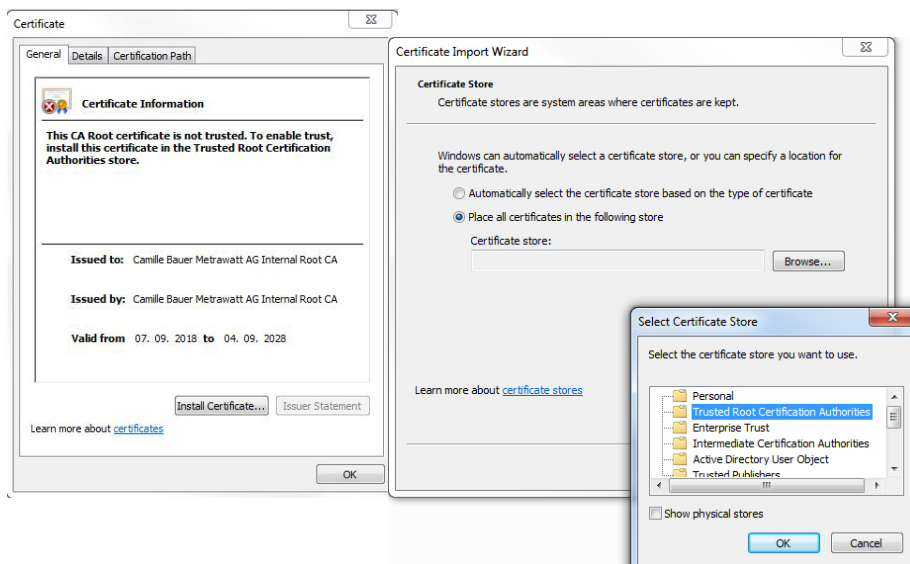


The imported certificate is valid for all devices of the PQ, AM, DM and CU series.

Agree to install the certificate if the below security warning appears:

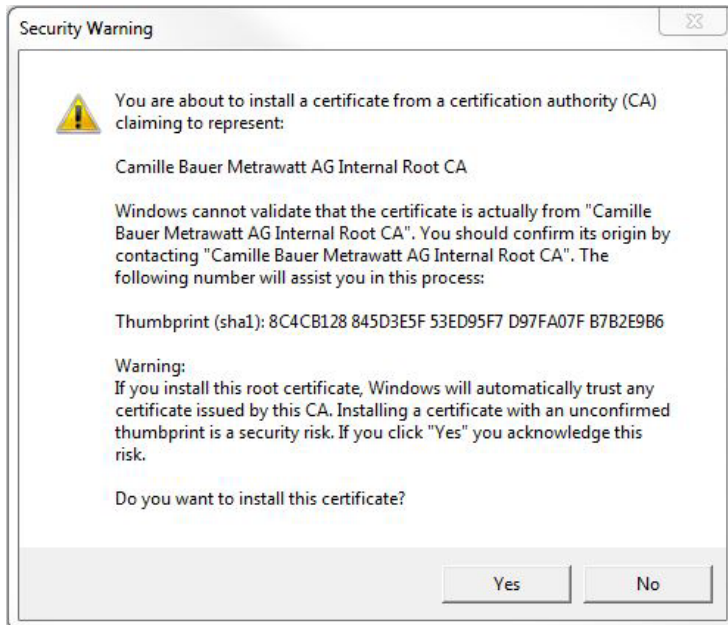

Customer certificate

You may also use a customer server certificate with a private key, but for that you first need to change the *Settings* of the *Security system* in the item *Web Security*.

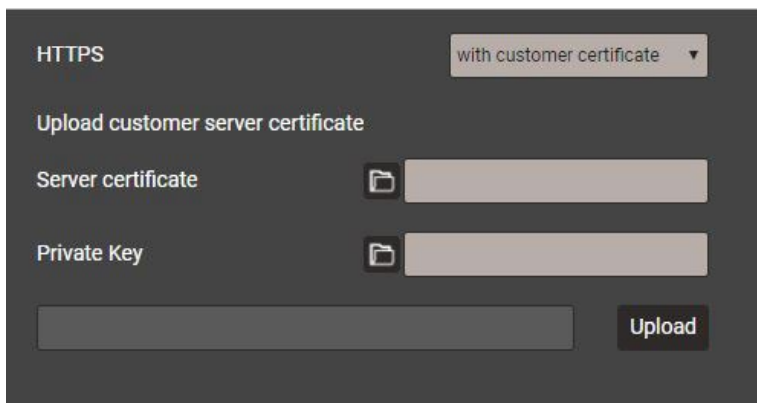

You may use https communication also by ignoring any browser warning and establishing an **unsecure** connection to the device. However, for security reasons you should not work like that in the intended network environment.

6.8.6 Audit log (SYSLOG)

Security related events, such as ...

- a computer establishing a connection to the device
- a user logged in /out
- a failed login attempt
- each changing of the device configuration
- the view of the security log by a user
- etc.

are logged in a security log accessible via the service menu.

Results per page

Filter

Time	PID	Priority	IP address	User name	Message
17.01.2020, 09:35:59	cb-gui[2126]	Notice	192.168.57.65:54375	admin	User reviewed latest security event log (allow)
17.01.2020, 09:35:54	cb-gui[2126]	Notice	192.168.57.65:54375	admin	User logged in successfully
17.01.2020, 08:33:30	sshd[2436]	Info	192.168.58.58:11348	root	Accepted password ssh2
17.01.2020, 08:31:18	sshd[2420]	Info	192.168.58.58:11318	root	Accepted password ssh2
17.01.2020, 08:31:17	sshd[2416]	Info	192.168.58.58:11315	root	Accepted password ssh2
17.01.2020, 08:24:56	cb-gui[2126]	Info	192.168.57.65:53539	admin	User logged out successfully
17.01.2020, 08:04:45	cb-gui[2126]	Notice	192.168.57.65:53387	admin	User reviewed latest security event log (allow)
17.01.2020, 08:02:59	cb-pq3000[2120]	Notice			The device was power off on Fri Jan 17 07:57:31 2020
17.01.2020, 08:02:59	cb-pq3000[2120]	Notice			The device was power on Fri Jan 17 07:57:31 2020
17.01.2020, 08:02:59	cb-pq3000[2120]	Notice			Firmware update was on Fri Jan 17 08:01:07 2020


Example of a security log: The severity of each message is shown in a color code, which may also serve as filter criteria.

Each entry into this list may, if activated, also be transferred to a central log-server using the **SYSLOG** protocol for security auditing. This transfer may be performed based on UDP, TCP or TLS. The settings of the Syslog server are available via Settings | Communication | Syslog server:

Syslog protocol	<input type="text" value="TCP"/>
Host	<input type="text" value="tenserv.camillebauer.com"/>
Port	<input type="text" value="514"/>

7. Operating the device

7.1 Operating elements

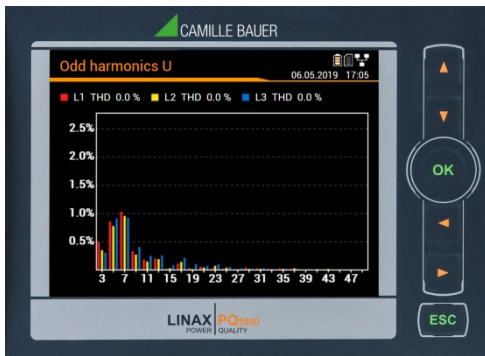

The operation of the device is performed by means of 6 keys:



- OK for **selection** or confirmation
- ESC for **menu display**, terminate or cancel

The **function** of the operating keys changes in some measurement displays, during parameterization and in service functions.

7.2 Selecting the information to display



Information selection is performed via menu. Menu items may contain further sub-menus.

Displaying the menu

Press **ESC**. Each time the key is pressed a change to a higher menu level is performed, if present.

Displaying information





Return to measurement display

After 2 min. without interaction the menu is automatically closed and the last active measurement display is shown.

7.3 Measurement displays and used symbols


For displaying measurement information the device uses both numerical and numerical-graphical measurement displays.

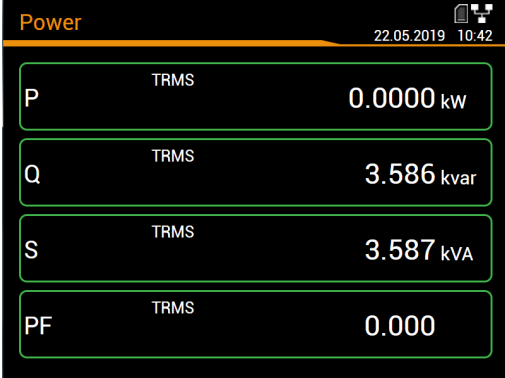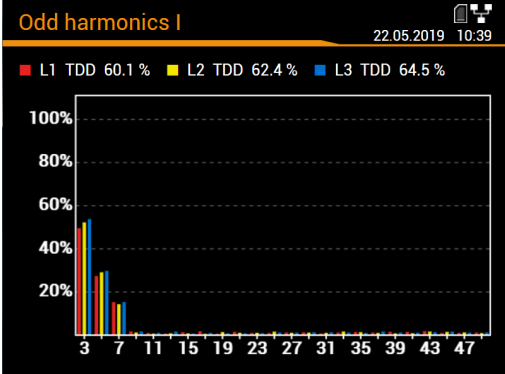Examples	Measurement information
	<p>4 measured quantities</p>
	<p>Graphical measurement display Further examples</p>

Incoming / outgoing / inductive / capacitive








The device provides information for all four quadrants. Quadrants are normally identified using the roman numbers I, II, III and IV, as shown in the adjacent graphic. Depending on whether the system is viewed from the producer or consumer side, the interpretation of the quadrants is changing: The energy built from the active power in the quadrants I+IV can either be seen as delivered or consumed active energy.

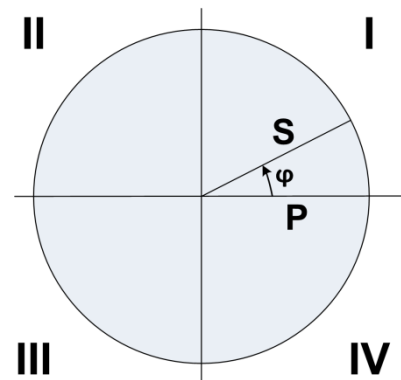By avoiding terms like incoming / outgoing energy and inductive or capacitive load when displaying data, an independent interpretation of the 4-quadrant information becomes possible. Instead the quadrant numbers I, II, III or IV, a combination of them or an appropriate graphical representation is used. You can select your own point of view by selecting the reference arrow system (load or generator) in the settings of the measurement.




Used symbols


For defining a measurement uniquely, a short description (e.g. U_{IN}) and a unit (e.g. V) are often not sufficient. Some measurements need further information, which is given by one of the following symbols or a combination of these symbols:

	Mean-value	ΣHT	Meter (high tariff)
	Mean-value trend	ΣLT	Meter (low tariff)
	Bimetal function (current)	\blacktriangle	Maximum value
	Energy quadrants I+IV	\blacktriangledown	Minimum value
	Energy quadrants II+III	TRMS	True root-mean-square value
	Energy quadrants I+II	RMS	Root-mean square value (e.g. fundamental or harmonic content only)
	Energy quadrants III+IV	(H1)	Fundamental component only
I,II,III,IV	Quadrants	\emptyset	Average (of RMS values)


Examples

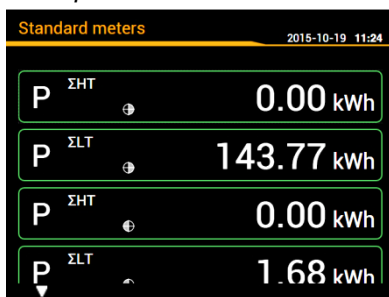

Meters with tariff and quadrant information

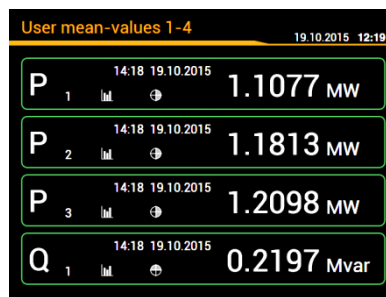

User mean values: Last values

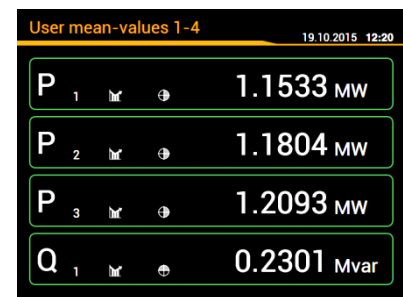

User mean values: Trend

7.4 Resetting measurement data

- **Minimum and maximum values** may be reset during operation. The reset may be performed in groups using the service menu.

Group	Values to be reset
1	Min/max values of voltages, currents and frequency
2	Min/max values of Power quantities (P,Q,Q(H1),D,S); min. load factors
3	Min/max values of power mean-values, bimetal slave pointers and free selectable mean-values
4	Maximum values of harmonic analysis: THD U/I, TDD I, individual harmonics U/I
5	All imbalance maximum values of voltage and current

- **Meter contents** may be individually set or reset during operation using the service menu
- **Recorded logger data** can be individually reset via the service menu "Logger values reset". This makes sense whenever the configuration of the quantities to record has been changed.

7.5 Configuration

7.5.1 Local configuration at the device

With the exception of the security system a full parameterization of the device can be performed via the menu “Settings”.

Modifications will not take effect before the user accepts the query “Store configuration changes” when leaving the settings menu. Changings in the “Country and clock” menu have immediate effect (e.g. a different operating language is used), but nevertheless must be stored.

- **Country and clock:** display language, date format, time zone, clock synchronization, time/date
- **Display:** Refresh rate, brightness, screen saver
- **Communication:** Settings of the communication interfaces [Ethernet](#) and [Modbus/RTU](#). In addition, a [SFTP server](#) may be defined, to push user definable data files to.
- **Measurement:** System type, sense of rotation, nominal values of U / I / f, sampling, [reference arrow system](#) etc.

Hints

- *U / I transformer: The primary to secondary ratio is used only for converting the measured secondary to primary values, so e.g. 100 / 5 is equivalent to 20 / 1. The values do not have any influence on the display format of the measurements.*
- *Nominal voltage: Is used as the 100% reference for monitoring power quality events and corresponds to the declared input voltage U_{din} in accordance with IEC 61000-4-30*
- *Nominal current: Rated current the system is designed for*
- *Max demand load current: Reference for scaling the harmonic content [TDD](#) of the currents*
- *Max short circuit current: Is used is used for calculating the limits for current harmonics and TDD when testing IEEE 519 compliance*
- *Maximum primary values U/I: These values are used only for fixing the display format of the measurements. This way the resolution of the displayed values can be optimized, because there is no dependency to installed transformers.*
- *Synchronous sampling: yes=sampling is adjusted to the measured system frequency to have a constant number of samplings per cycle; no=constant sampling based on the selected system frequency*
- *Reference channel: The measurement of the system frequency is done via the selected voltage or current input*
- *Voltage neutral-earth / neutral current: These quantities may be measured or calculated. Of course, if “measured” is selected the appropriate terminals must be connected.*
- **Power quality:** Definition of parameters for monitoring the PQ events voltage dip, voltage interruption, voltage swell, rapid voltage changes and mains signalling voltage. User-specific limits for the evaluation of the PQ statistic can also be set.
- **Mean-values | standard quantities:** Interval time and synchronization source for the predefined power mean values
- **Mean-values | user defined quantities:** Up to 12 quantities (10 pre-defined, 2 selectable) for determining their mean-values and selection of their common interval and synchronization source
- **Bimetal current:** Selection of the response time for determining [bimetal currents](#)
- **Meters | Standard meters:** Tariff switching ON/OFF, [meter resolution](#)
- **Meters | User defined meters:** Base quantities (Px,Qx,Q(H1)x,Sx,lx), Tariff switching ON/OFF, [meter resolution](#)
- **Meters | Meter logger:** Selection of the reading interval
- **Limit values:** Selection of up to 12 quantities to monitor, [limit values](#) for ON/OFF, event text ¹⁾
- **Digital inputs:** Debounce time (minimum pulse width) and polarity of the optional [digital inputs](#)
- **Monitoring functions:** Definition of up to 8 [monitoring functions](#) with up to three inputs each, delay times for ON / OFF and event text ¹⁾
- **Summary alarm:** Selection of the monitoring functions to be used for triggering the [summary alarm](#) and selection of a possible source for resetting



- **Operating hours:** Selection of the running condition for up to 3 operating hour counters
- **Digital output:** Definition of the state source for the optional [digital output](#)
- **Analog outputs:** Type of output, source, transfer characteristic, upper/lower range limit
- **Security system:** Definition of the [security system](#) (RBAC, https, whitelist)
- **Device tag:** Definition of different texts ¹⁾ mainly used for report generation, such as device tag, document title, device location and others.
- **Data export scheduler:** Via [website](#) you can setup tasks to be performed regularly. Each time such a task is running, it creates a data file to be transferred to a SFTP server and/or to be stored locally on the device. Via local configuration tasks can be enabled or disabled only.

¹⁾ In user-defined event and description texts all Unicode characters (UTF8) are allowed with the exception of the following:

- ASCII control characters (0x00 - 0x1F)
- The quotation mark " (0x22)
- The character & (0x26)
- The apostrophe ' (0x27)
- The asterisk * (0x2A)
- The slash / (0x2F)
- The colon : (0x3A)
- The «less than» character < (0x3C)
- The «bigger than» character > (0x3E)
- The question mark ? (0x3F)
- The backslash \ (0x5C)
- The vertical line | (0x7C)

At the device itself only «normal» characters of the ASCII character set can be input. Entering language specific character or texts is possible via the website of the device only.


7.5.2 Configuration via web browser



	It's recommended to use either Google Chrome or Firefox as browser.
	Internet Explorer works with limitations only (partly missing texts, firmware update not possible)


As soon as the [root certificate](#) is installed you can start the browser and display the device website using:

- IPv4 communication: `https://IPv4_addr`, e.g. `https://192.168.1.101`
- IPv6 communication: `https://[IPv6_addr]`, e.g. `https://[fd2d:bb44:97f1:3976::1]`

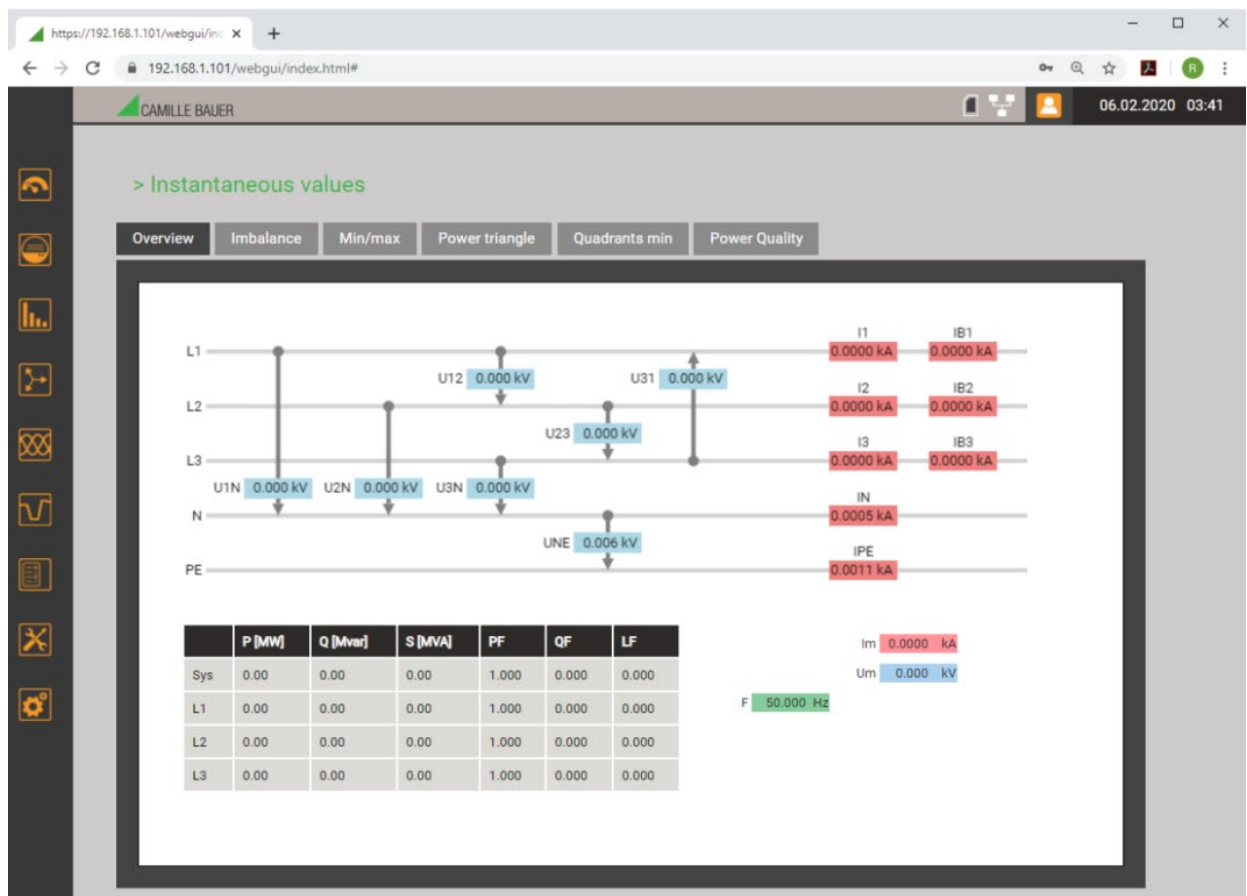
This request works only if device and PC are in the same network segment. Depending on the device version, there may be multiple network devices with different [default IP addresses](#).



	The locker symbol shows that a secure connection is established
	There are three information here: <ul style="list-style-type: none"> • The SD-card is present and stores data • A network connection is established • No user with credentials has logged in so far. Information granted to the default user 'anonymous' is displayed.

 Via WEB-GUI you can make the same settings as via the [local GUI](#) using the Settings menu. In addition, it is possible to setup the [security system](#) and the [Data export scheduler](#) and to enter user-defined event or description texts in UTF8 format.

In addition, it is possible to setup the and to setup the. Possibly modifications needs to be saved in the device, before all parameters have been set. In such a case the following message appears:

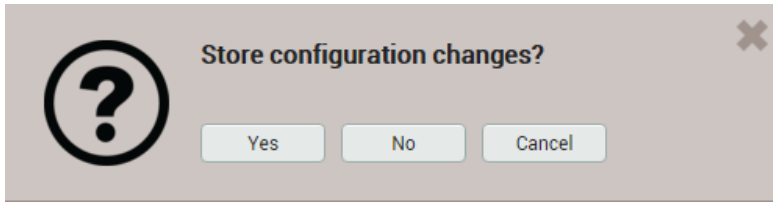
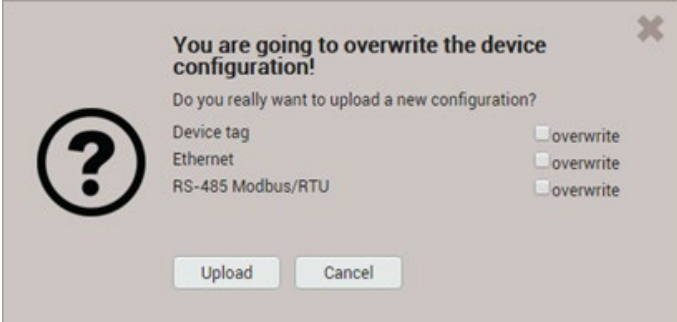




If this request is not confirmed, unsaved modifications of the present device configuration may get lost.

Loading / saving configuration files

The user can save the present device configuration on a storage media and reload it from there. The storage or load procedure varies depending on the used browser.

The settings of the security system are not part of the configuration file. There is no possibility to transfer security settings from one device to another.

	<p>Loading a configuration file from a storage media</p> <p>The configuration data of the selected file will be directly loaded into the device. The values in the WEB-GUI will be updated accordingly. Normally devices differ in the settings of network and Modbus parameters and device name. Thus when loading the file you can choose, whether the appropriate settings of the device should be retained or overwritten by the values in the file to be uploaded.</p> 
	<p>Storing the current parameter settings of the WEB-GUI into the device</p>
	<p>Saving the device configuration to a storage media</p> <p>Attention: Modifications in the WEB-GUI, which haven't been stored in the device, will not be written to the storage media.</p>

7.6 PQ monitoring

Power quality monitoring provides both a statistical evaluation, allowing an assessment of compliance with standards (e.g. EN 50160) or supply contracts, as well as records of events in the grid (e.g. power voltage dip). This facilitates the analysis of causes and effects. Conformity reports may also be created directly via the website of the device.

7.6.1 PQ events

The device monitors all voltage events in accordance with IEC 61000-4-30. The default values of the trigger thresholds correspond to the common values of the EN 50160 for a public low-voltage distribution system, but can be changed by the user to individual needs.

In addition to the requirements of IEC 61000-4-30 the device can monitor current swells, voltage unbalance and frequency anomalies.

Monitored events	Threshold	Hysteresis	Reference value
Voltage dip	90%	2%	Nominal voltage
Voltage interruption	10%	2%	
Voltage swell	110%	2%	
Rapid voltage change	6%	50% ¹⁾	
Homopolar voltage	50%	2%	
Current swell	120%	2%	Nominal current
Frequency anomaly	lower: 99% upper: 101%	0.5%	Nominal frequency
Digital input events ²⁾	Any state change		

¹⁾ Related to the respective threshold

²⁾ For device versions with digital inputs, the states of these inputs during the event are displayed along with the values of voltages and currents. State changes of digital inputs can also trigger an event recording



The device does not verify the user-defined event parameters. If these values are not plausible, events may be not recognized correctly or misclassified. In particular, the trigger threshold for RVC events should not be greater than half of the difference of the threshold values of voltage swell and voltage dip.

Recordings

If any of the above events occurs, the device records both the half-cycle RMS values and the samples of all voltage and current channels. The event recording times can be configured using the menu *Settings* | *Power quality* | *Event recording*:

RMS(1/2): Pretrigger recording	s	1.000
RMS(1/2): Event recording (max.)	s	180.000
Samples: Pretrigger recording	s	1.000
Samples: Event recording	s	4.000

Possible recording times

$\leq 1.0s$

$\leq 180.0s$

$\leq 1.0s$

$\leq 5.0s$

Note: The event recording time "RMS(1/2): After triggering" is a maximum recording time. It is reduced to the real event duration + 1s, if the event duration is shorter than the configured time.

Recorded PQ events can be [visualized](#) either via the local display or the webpage of the device.

Mains signalling voltage

The device monitors mains signalling voltages, which are transmitted in the supply system for load control purposes, and records them as events. Typically these are ripple control signals. The user can define the frequency of the signalling voltage, the threshold and hysteresis (related to the nominal voltage) as well as the recording duration in multiples of the measurement interval of 10/12 cycles. The recording duration must not exceed 120s. The ripple control frequency is typically below 3 kHz and can be requested from the local energy provider.

Reference channel		U1
Ripple control frequency	Hz	375
Trigger threshold	%	2
Trigger hysteresis	%	1
Rec. duration (10/12 cycles)	#	50

7.6.2 PQ statistic



Power quality (PQ) is assessed by a comparison between the PQ parameters measured by the device and the limits of a contract agreed upon. The assessment period is usually at least one week to take into account possible variations between weekdays and weekends.

Via its website the device can perform an assessment of the measured PQ parameters in accordance with the following standards:

- EN 50160 (2010), low voltage, interconnected systems
- EN 50160 (2010), low voltage, island systems
- EN 50160 (2010), medium voltage, interconnected systems
- EN 50160 (2010), medium voltage, island systems
- EN 50160 (2010), high voltage, interconnected systems
- EN 50160 (2010), high voltage, island systems
- IEC 61000-2-2 (2002), public low voltage systems
- IEC 61000-2-4 (2002), industrial and non-public systems up to 35 kV, class 1
- IEC 61000-2-4 (2002), industrial and non-public systems up to 35 kV, class 2
- IEC 61000-2-4 (2002), industrial and non-public systems up to 35 kV, class 3
- IEC 61000-2-12 (2003), public medium voltage systems
- GB/T
- IEEE 519
- User specific limit sets

The assessment of the PQ statistic is shown in the chapter [Data recording | PQ statistic](#), including the creation of conformity reports.

Recorded PQ parameter groups

Measurement	Averaging time	Applied limits
Power frequency	10 s	<p><i>The applied limits and time conditions of the preset standards can be seen via the device website.</i></p> <p><i>They can be displayed via the following menu:</i></p> <pre> Settings Power Quality Custom threshold limits (Standard) </pre> <p> <i>Within the same menu user data sets with specific limits and evaluation criteria can be defined</i></p> <p> <i>User specific data sets can also be deleted again.</i></p>
Voltage magnitude	10 min.	
Flicker P _{st}	10 min.	
Flicker P _{it}	2 h	
Mains signalling voltage	3 s	
Supply voltage unbalance	10 min.	
THDS of voltages	10 min.	
Voltage harmonics	10 min.	
Voltage interharmonics	10 min.	
Current magnitude	10 min.	
Current unbalance	10 min.	
Current harmonics	10 min.	
Current interharmonics	10 min.	

7.6.3 Provision of PQ data

The device can create PQ related data, such as PQ events or PQ statistic, using the standard format PQDIF (**P**ower **Q**uality **D**ata **I**nterchange **F**ormat). The automatic or event-driven generation of such files can be defined via the [Data export scheduler](#) in the Settings menu. By default, daily PQDIF will be created periodically after midnight for the past day and provided in a hierarchical time structure (year, month, day) for [download](#).

PQDIF files may also be generated manually via web interface. This may be done either for the present day (including data since midnight) or contiguous, selectable time ranges of up to 7 days. The file(s) is added in the time structure of the end day. Days with existing files are marked with a red dot.

> Service > Local data storage > Generate PQDIF

Simulation

Min/max values reset

Meter contents set/reset

Logger values reset

Operating hours

Device information

Local data storage

Factory reset

Audit Log

Firmware update

Communication Tests

Device reboot

Generate PQDIF

Download data


March 2021

Mo	Tu	We	Th	Fr	Sa	Su
1	2	3	4	5	6	7
8	9	10	11	12	13	14
15	16	17	18	19	20	21
22	23	24	25	26	27	28
29	30	31	1	2	3	4
5	6	7	8	9	10	11

Generate PQDIF

```
> Found 10 events on Wed Mar 24 2021
> Event 'Voltage dip' at 2021-03-24T13:45:23.549+01:00
> Event 'Voltage dip' at 2021-03-24T13:48:16.953+01:00
> Event 'Voltage dip' at 2021-03-24T13:48:53.748+01:00
> Event 'Voltage dip' at 2021-03-24T13:50:05.536+01:00
> Event 'Voltage dip' at 2021-03-24T13:51:05.008+01:00
> Event 'Voltage dip' at 2021-03-24T13:51:44.569+01:00
> Event 'Voltage dip' at 2021-03-24T13:54:33.099+01:00
> Event 'Voltage dip' at 2021-03-24T14:01:54.240+01:00
> Event 'Voltage dip' at 2021-03-24T14:07:14.922+01:00
> Event 'Voltage dip' at 2021-03-24T14:08:48.014+01:00
> PQ data stored in file 'PQ1000-1216324003_20210324.pqd'
> PQ data generation done
```


If for the selected time range PQDIF files are already stored in the device the below warning will be displayed.

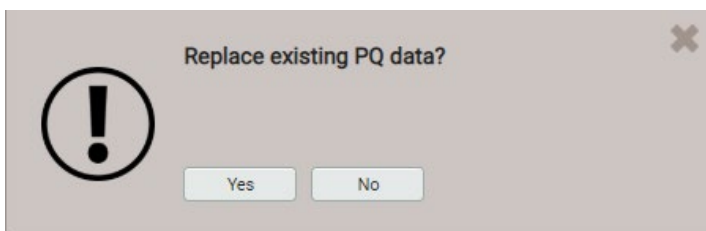

7.7 Alarming

The device supports an alarming concept independent of power quality events. Depending on the user requirements, simple or more advanced monitoring tasks may be realized. The most important objects are limit values on base quantities, monitoring functions and the summary alarm.

7.7.1 Limit values on base quantities

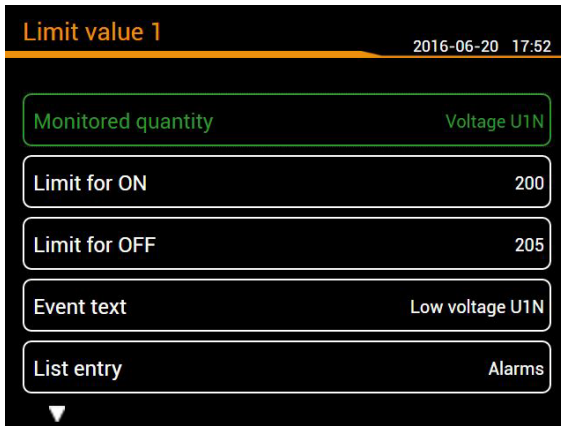


Using limit values either the exceeding of a given value (upper limit) or the fall below a given value (lower limit) is monitored.

Limits values are defined by means of two parameters: Limit for ON / OFF. The hysteresis corresponds to the difference between these two values.


Both state transitions OFF→ON and ON→OFF can be recorded as event or alarm in the appropriate lists.

Upper limit: $\text{Limit for ON} \geq \text{Limit for OFF}$

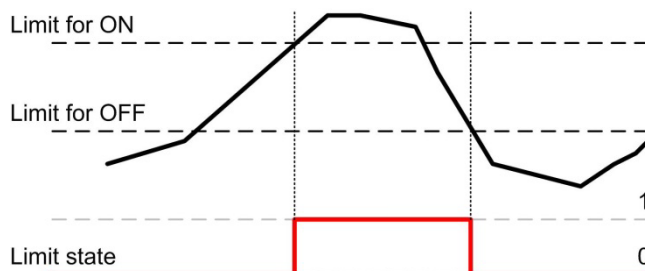

- ▶ The limit value becomes active (1) as soon as the limit for ON state is exceeded. It remains active until the associated measured quantity falls below the limit for OFF state again.
- ▶ The limit value is inactive (0) if either the limit for ON is not yet reached or if, following the activation of the limit value, the associated measured quantity falls below the limit for OFF state again.

Lower limit: $\text{Limit for ON} < \text{Limit for OFF}$

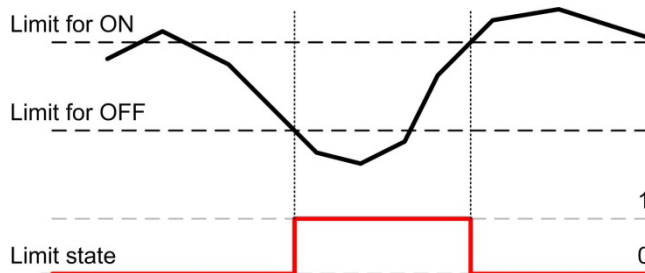

- ▶ The limit value becomes active (1) as soon as the associated measured quantity falls below the limit for ON state. It remains active until the associated measured quantity exceeds the limit for OFF state again.
- ▶ The limit value is inactive (0) if either the associated measured quantity is higher than the limit for ON state or if, following the activation of the limit value, it exceeds the limit for OFF state again.



If the limit for ON state and the limit for OFF state are configured to the same value, the limit value will be treated as an upper limit value without hysteresis.

Limit value states can:

- ... be used as logic input for a monitoring function
- ... be recorded as event or alarm in the appropriate lists on each state transition


7.7.2 Monitoring functions

By means of monitoring functions the user can define an extended condition monitoring, e.g. for triggering an over-current alarm, if one of the phase currents exceeds a certain limit value.

The states of all monitoring functions

...will be shown in the alarm list (“Events” via main menu)

...build the [summary alarm](#) state

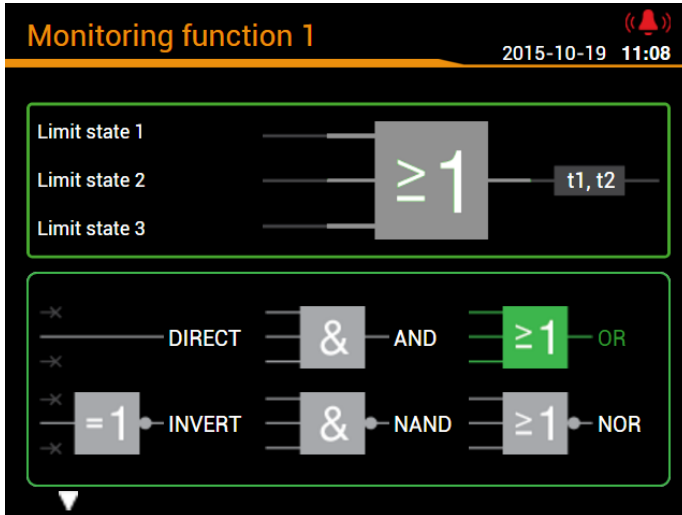

Logic inputs

Up to three states of limit values, logic inputs or other monitoring functions. Unused inputs will automatically be initialized in a way that they do not influence the output.

Logic function

For the logical combination of the inputs the function AND, NAND, OR, NOR, DIRECT and INVERT are available. These logical functions are described in [Appendix C](#).

Delay time on

The time a condition must be present until it is forwarded

Delay time off

Time to be waited until a condition, which is no longer present, will be released again

Description

This text will be used for visualization in the alarm list

List entry


- *Alarm / event*: Each state transition will be recorded in the appropriate list
- *none*: No recording of state transitions

Possible follow-up actions

- Visualization of the present state in the alarms overview
- Combining the states of all monitoring functions to create a [summary alarm](#)
- Recording of state transitions as alarm or event in the appropriate lists

7.7.3 Summary alarm


The summary alarm combines the states of all [monitoring functions](#) MFx to a superior alarm-state of the overall unit. For each monitoring function you may select if it is used for building the summary alarm state. If at least one of the used functions is in the alarm state, the summary alarm is also in the alarm state.

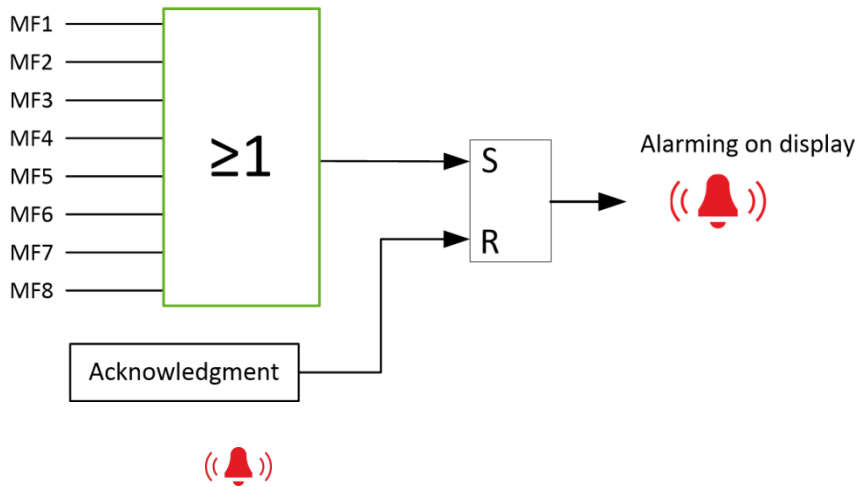

The symbol arranged in the status bar signals if there are active alarms or not.

Acknowledgment: By acknowledging the summary alarm, the user confirms that he has recognized that an alarm state is present. The acknowledgment is done automatically as soon as the user selects the alarm list to be displayed locally or via web browser or if the alarm state no longer exists. By acknowledging only the flashing of the alarm symbol stops, the symbol itself remains statically displayed until none of the monitoring functions is in the alarm state.

Alarm state display (via menu Events | Alarms)

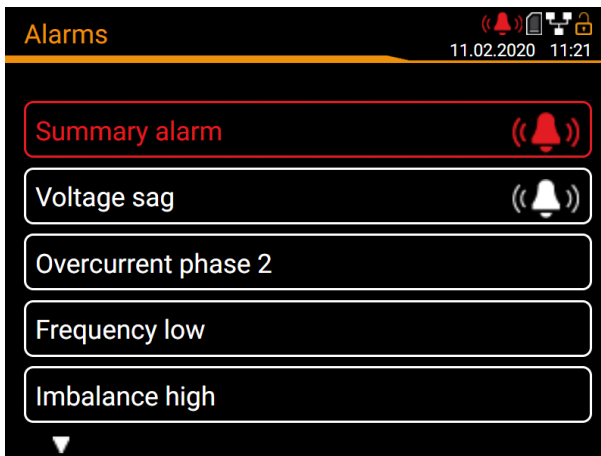






This display serves to identify the source of the summary alarm.

7.8 Data recordings

The device stores long-term recordings of measurement progressions, events and PQ statistics. Some of these recordings provide predefined contents; some is based on user-defined contents.

In addition, file-based information may be periodically created using the [data export scheduler](#). This data may be saved internally and / or send securely to a SFTP server.

In general, recordings are done in endless mode. The oldest data will be deleted, as soon as the associated memory is used for more than 80%.

Group	Data type	Request	
Periodic data	<ul style="list-style-type: none"> • Mean-values versus time, predefined (5) and user-specific (12) quantities • Periodic meter readings, predefined (4) and user-specific (12) quantities 	 Energy	<ul style="list-style-type: none"> • Mean value logger • Meter logger
Events	In form of a logbook with time information: <ul style="list-style-type: none"> • Event list: Every state transition of monitoring functions or limit values, classified as event • Alarm list: Every state transition of monitoring functions or limit values, classified as alarm 	 Events	<ul style="list-style-type: none"> • Event and alarm list
PQ events	The occurrence of PQ events will be registered in the PQ event list. By selecting the entries for voltage events: <ul style="list-style-type: none"> • the course of the RMS values of all U/I • the wave shape of all U/I during the disturbance will be displayed	 Events	<ul style="list-style-type: none"> • PQ events and Mains Signalling
Security events	<ul style="list-style-type: none"> • Security log (SYSLOG) 	 Service	<ul style="list-style-type: none"> • Log of the security system
PQ statistic	For a selectable weekly interval, the evaluation of the PQ statistic is displayed, depending on the selected standard. In addition, daily trends of the monitored PQ variables can be displayed. By means of PQ-Easy Report, conformity reports can be created directly via website.		

7.8.1 Periodic data

Configuration of the periodic data recording

Via the settings menu the user can individually configure:


- The averaging interval of the standard mean-values P(I+IV), P(II+III), Q(I+II), Q (III+IV), S
- The averaging interval of up to 12 user-defined mean-values
- The reading interval of standard meters P(I+IV), P(II+III), Q(I+II), Q (III+IV)
- The reading interval of up to 12 user-defined meters

The recording of all mean-values and meters is started automatically on device start. The recording of the mean-values is done when the appropriate averaging interval expires.

Displaying the chronology of the mean values

The chronology of the mean values is available via the menu **Energy** and is divided in two groups:

- Pre-defined power mean values
- User-defined mean values

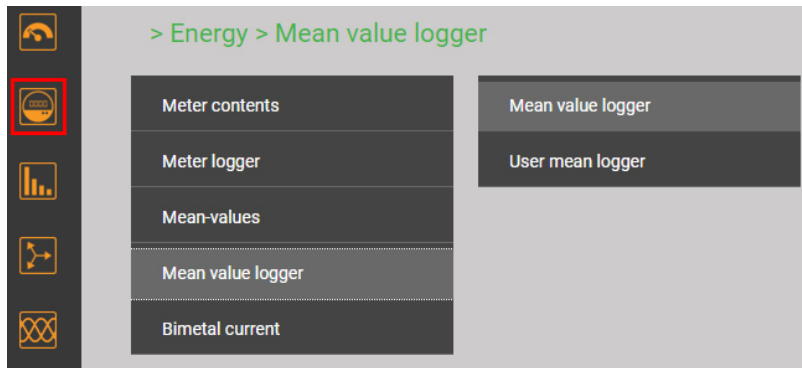


Selection of the mean values group



The selection of the mean-value quantity to display can be performed via choosing the corresponding register. Three different kind of displays are supported:

- Daily profile: Hourly mean-values will be shown, independently of the real averaging time
- Weekly profile
- Table: Listing of all acquired mean-values in the sequence of the real averaging interval

The graphical representation allows comparing directly the values of the previous day or week.

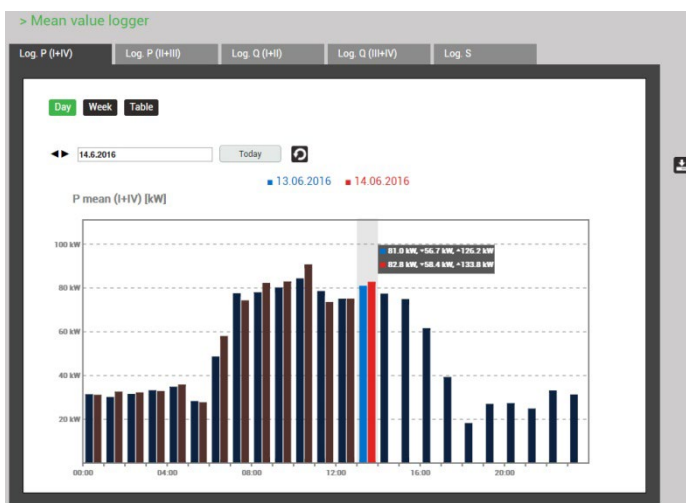

By selecting the bars you may read the associated values:

- Mean-value
- Min. RMS value within the interval
- Max. RMS value within the interval



Weekly display



Weekly display: Reading

#	time	mean	min(interval)	max(interval)
1	14.06.2016, 14:33:00.000	78.89 kW	65.75 kW	109.42 kW
2	14.06.2016, 14:32:00.000	93.65 kW	74.96 kW	125.97 kW
3	14.06.2016, 14:31:00.000	86.42 kW	74.48 kW	104.69 kW
4	14.06.2016, 14:30:00.000	80.17 kW	67.35 kW	106.59 kW
5	14.06.2016, 14:29:00.000	88.62 kW	75.01 kW	111.77 kW
6	14.06.2016, 14:28:00.000	80.96 kW	69.96 kW	116.12 kW
7	14.06.2016, 14:27:00.000	81.96 kW	68.81 kW	108.47 kW
8	14.06.2016, 14:26:00.000	80.98 kW	69.05 kW	102.54 kW
9	14.06.2016, 14:25:00.000	88.52 kW	68.12 kW	123.43 kW


Mean values in table format

Displaying the chronology of meter contents

The chronology of meters is available via the menu **Energy** and is divided in two groups:

- Pre-defined meters
- User-defined meters

From the difference of two successive meter readings the energy consumption for the dedicated time range can be determined.

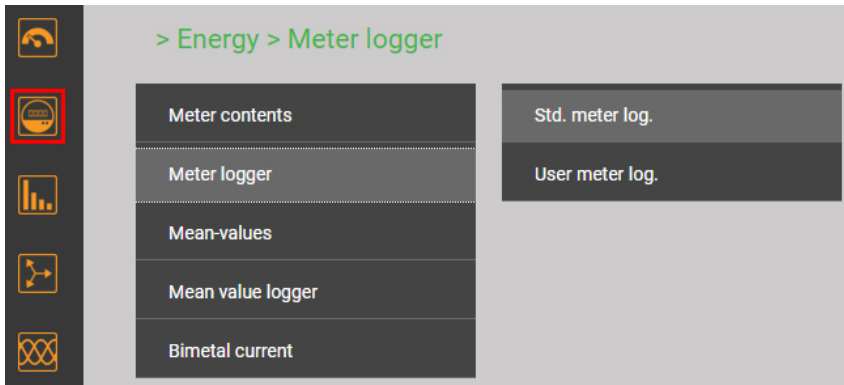

Selection of the meter logger group

> Std. meter log.

Log. $\Sigma P(I+IV)$ Log. $\Sigma P(II+III)$ Log. $\Sigma Q(I+II)$ Log. $\Sigma Q(III+IV)$

«Previous 1 2 3 4 5 Next» Results per page 25

#	time	$\Sigma P(I+IV), \Sigma IT$	$\Sigma P(II+III), \Sigma HT$
1	15.06.2016, 14:00:00.000	0 kWh	33276.80 kWh
2	15.06.2016, 13:00:00.000	0 kWh	33203.10 kWh
3	15.06.2016, 12:00:00.000	0 kWh	33137.40 kWh
4	15.06.2016, 11:00:00.000	0 kWh	33069.10 kWh
5	15.06.2016, 10:00:00.000	0 kWh	32996 kWh
6	15.06.2016, 09:00:00.000	0 kWh	32919.70 kWh
7	15.06.2016, 08:00:00.000	0 kWh	32849.90 kWh
8	15.06.2016, 07:00:00.000	0 kWh	32784 kWh
9	15.06.2016, 06:00:00.000	0 kWh	32735.30 kWh
10	15.06.2016, 05:00:00.000	0 kWh	32719.10 kWh
11	15.06.2016, 04:00:00.000	0 kWh	32687.10 kWh


Meter content readings in table form


Displaying data locally

The selection works in the same way as with the WEB-GUI. There are the following differences:

- The individual measured quantities are arranged in a display matrix and can be selected via navigation.
- The number of displayable meter readings is limited to 25
- The time range of the mean values is limited to the present day or the present week. There is no possibility for navigation.

Manual data export as CSV file

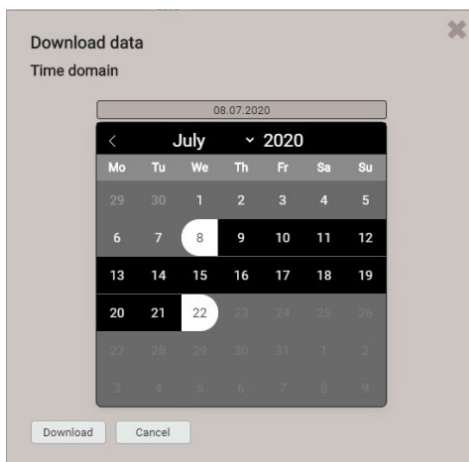

Via  in the display of the mean values or meter logger the time range of the data to export can be selected. A CSV (Comma separated value) file will be generated. This can be imported as a text file to Excel, with comma as a separator.

The same file contains data for all quantities of the respective group.

7.8.2 Events



Configuration of events

- For all [monitoring functions](#) and [limit values](#) for which state transitions need to be recorded, the parameter “list entry” must be set to either events or alarms.
- Threshold values for PQ events can be adapted via the menu Settings | Power Quality

Displaying of event entries

Event lists are a kind of logbook. The occurrence of monitored events is recorded in the appropriate list with the time of its occurrence. There are the following lists:

- Alarm and event list
- PQ events ([see 7.8.4](#))
- [Security log](#) (via service menu)

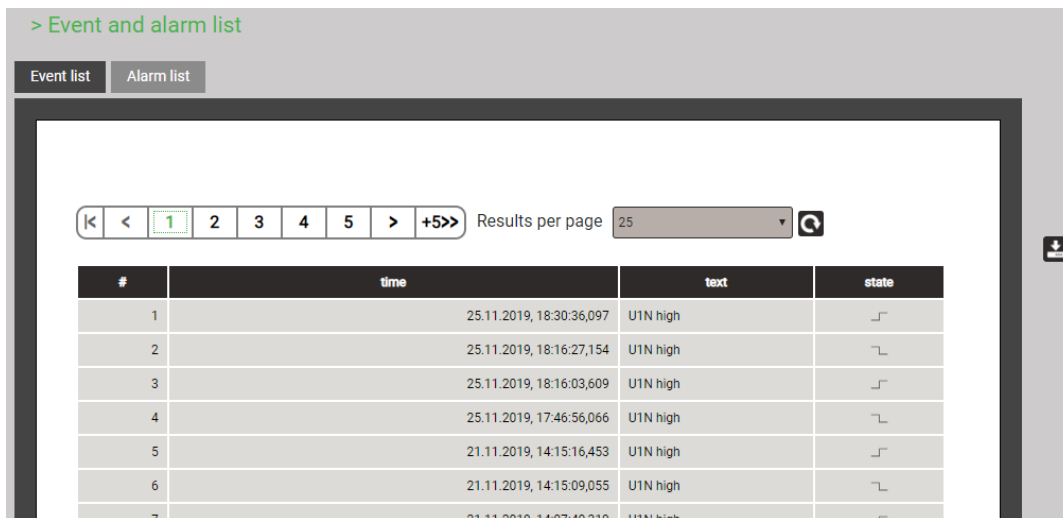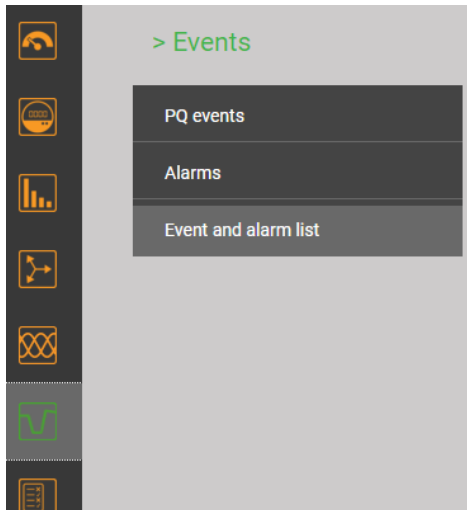

Example of an event list

Displaying data locally

The selection works in principle in the same way as with the WEB-GUI. There is the following difference:

- The number of displayable events is limited to 25

7.8.3 PQ events


Configuration of the events to record

[See 7.6](#)

Display of PQ event recordings (locally)

Recorded events are available in the form of a logbook, mains signalling events are stored in a separated list. Each detected event is entered into the PQ event list with the time of its occurrence, the remaining voltage and the duration of the event. By selecting a list entry, the graphical display of the measured values during this event is entered. The following presentations are available:

- Half cycle RMS curves of all voltages, all currents, all voltages and currents
- Wave shapes of all voltages, all currents, all voltages and currents
- State changes of digital inputs (for device versions with optional digital inputs only)

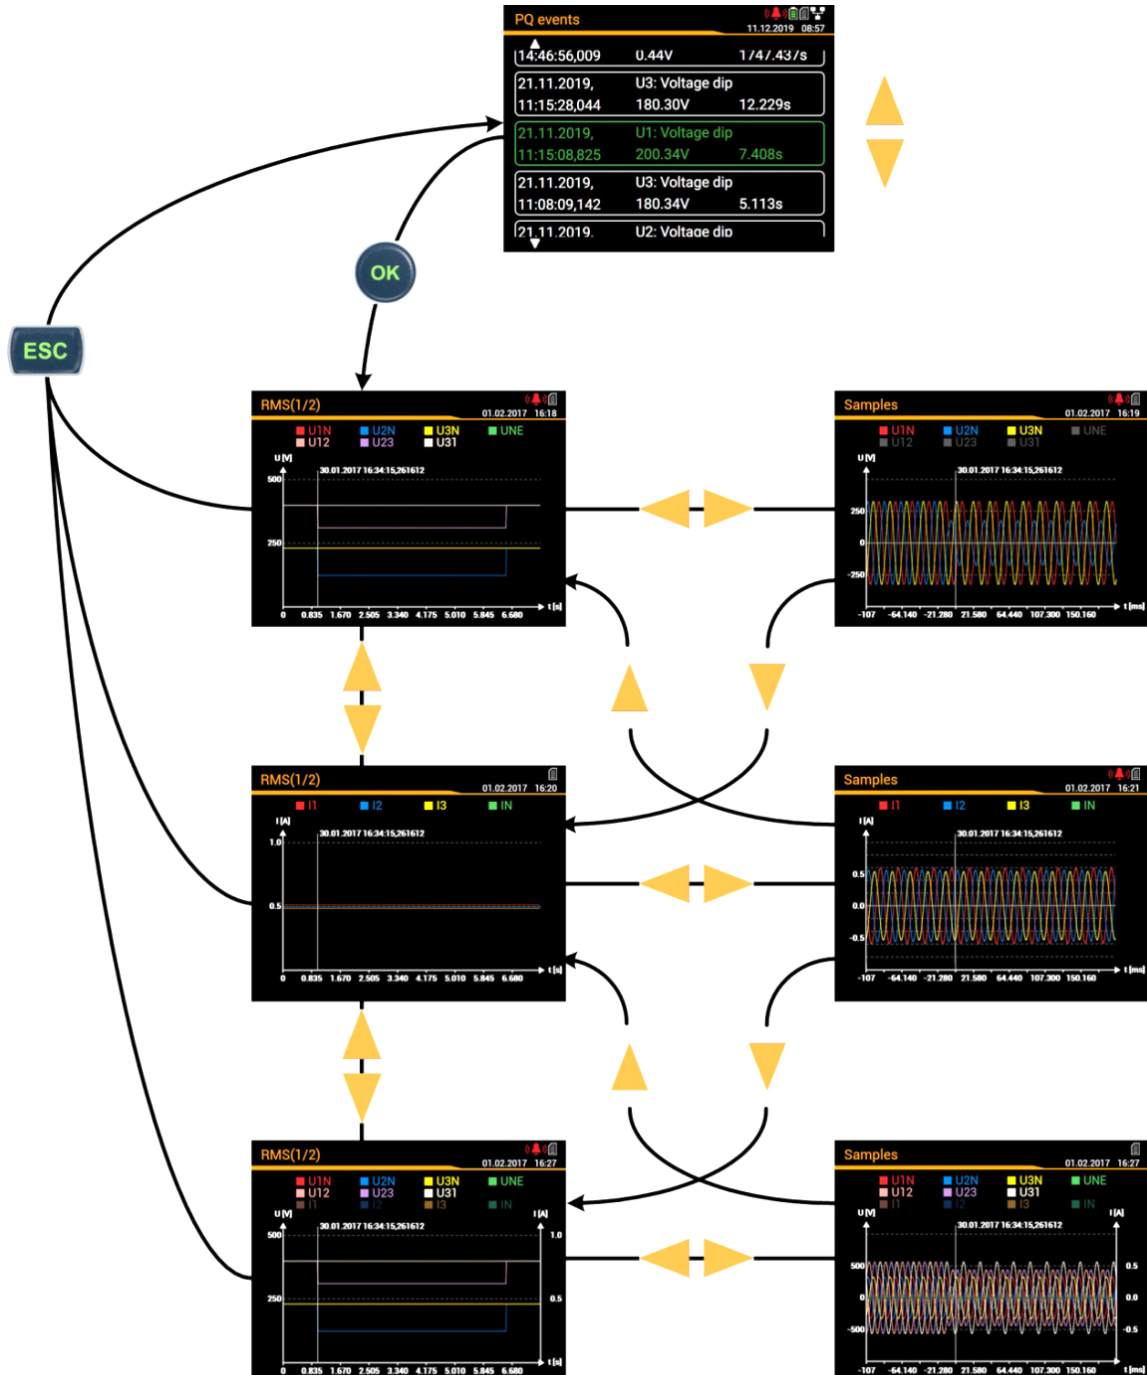


Display matrix on the local display


Restriction of the quantities to display on the local display

The user can adapt the displayed information to its needs. Once the graphic is displayed, the setting window for the selection of the quantities to be displayed is entered by pressing <OK>.


Voltage display

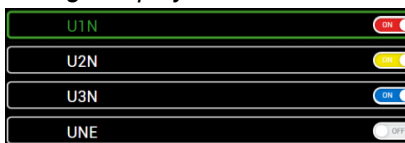

Current display

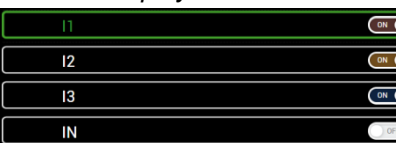


Mixed display

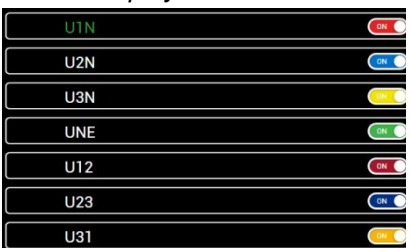


Display of PQ events (WEB-GUI)

As with the local GUI, recorded events are available in the form of a logbook. Events may be filtered by event type and event date.

By selecting a list entry, the graphical display of the measured values during this event is entered.

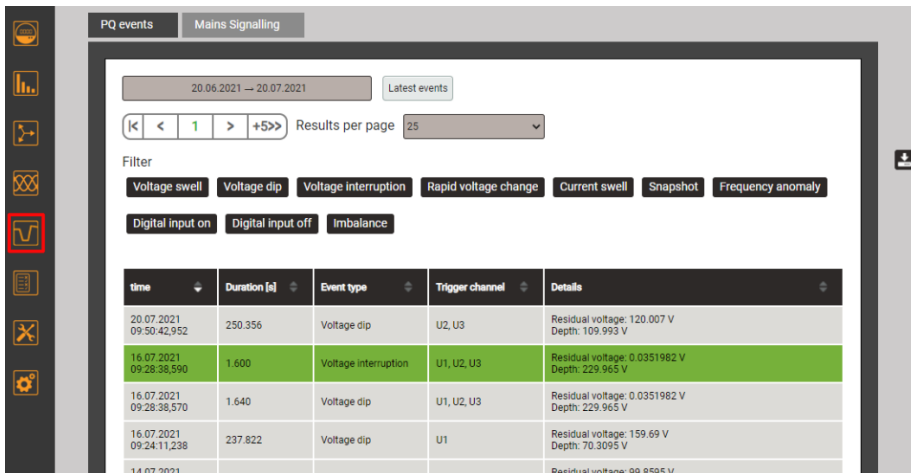

List of PQ events

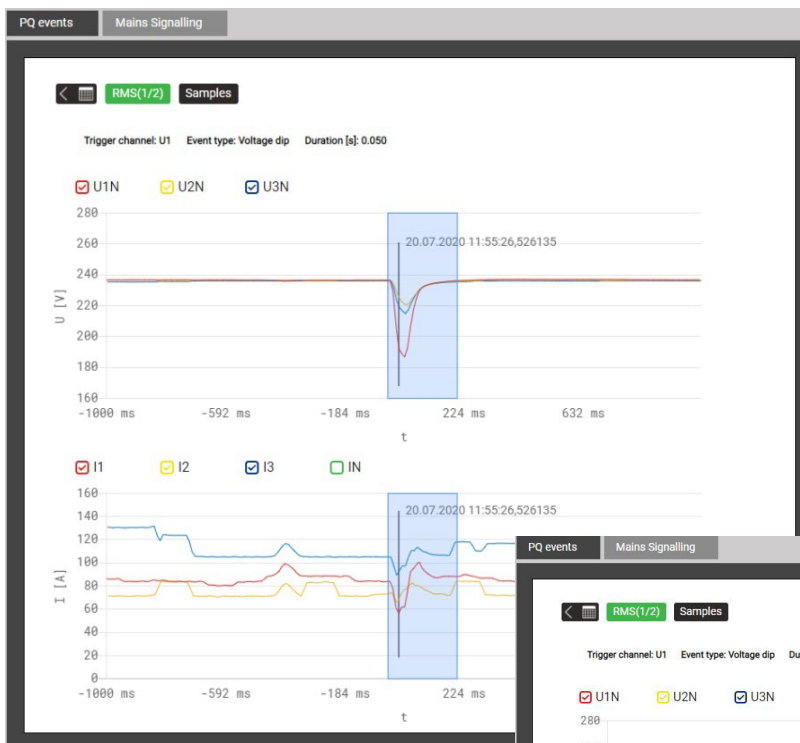

Graphical display of a PQ event




By selecting a time range via left mouse key, the graphical event display may be zoomed.




Zoomed PQ event

7.8.4 PQ statistic

From the PQ statistic it is very easy to see whether the limits of the [monitored criteria](#) are respected or not. Each criterion is represented by a bar, which itself may be composed of multiple color components:

-  Requirement fulfilled
-  Missing data
-  Requirement not fulfilled


Example for monitoring voltage variations:

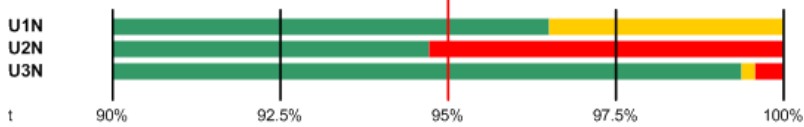

- Limit to be respected is marked with a red line (95% of the time range)
- U1N: Requirement fulfilled, because green bar > 95%
- U2N: Requirement not fulfilled, because green bar < 95%
- U3N: Requirement fulfilled, because green bar > 95%

Display of PQ statistic (WEB-GUI)

Selection via the menu PQ statistic


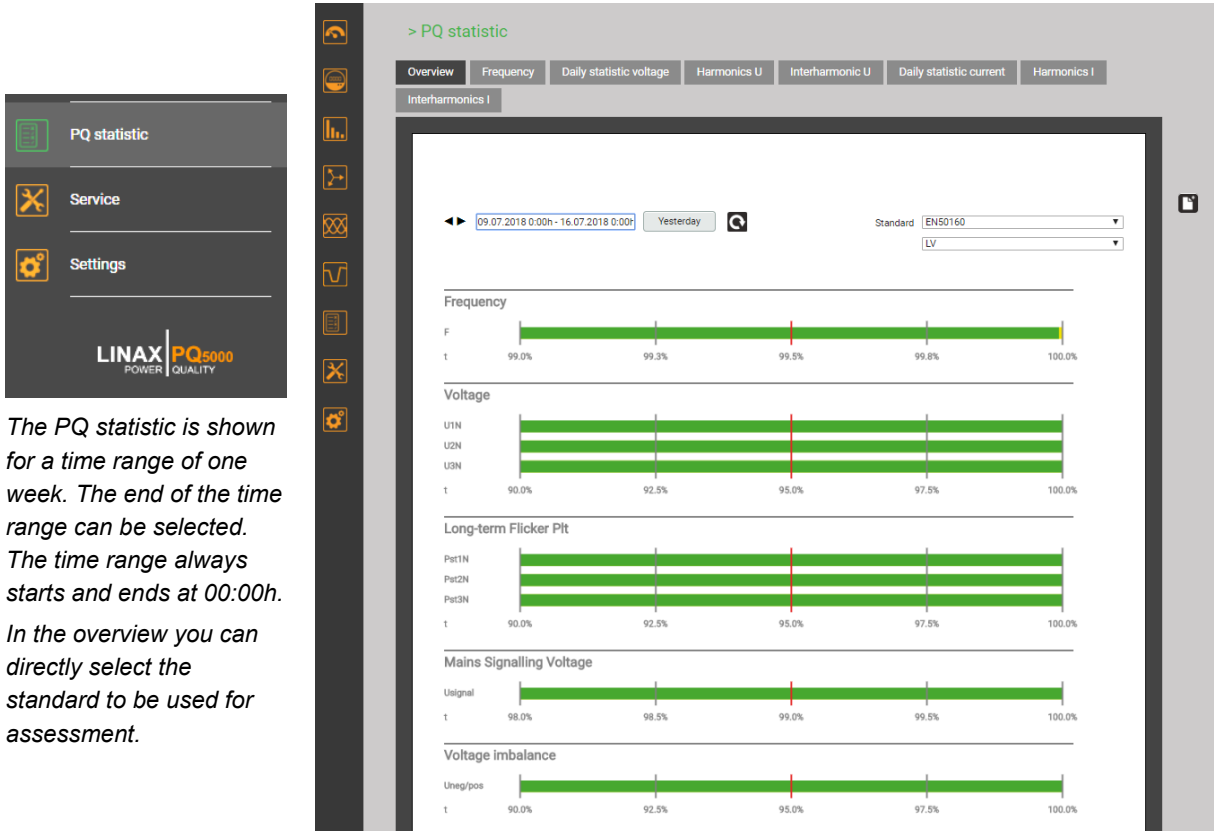


The screenshot shows the LINAX PQ5000 WEB-GUI interface. On the left is a navigation menu with options for 'PQ statistic', 'Service', and 'Settings'. The main area displays the 'PQ statistic' for 'Interharmonics I'. The time range is set to '09.07.2018 0:00h - 16.07.2018 0:00h' with a 'Yesterday' button. The standard is set to 'EN50160' and the voltage level is 'LV'. The chart displays several metrics: Frequency (F), Voltage (U1N, U2N, U3N), Long-term Flicker PIt (Pst1N, Pst2N, Pst3N), Mains Signalling Voltage (UoSignal), and Voltage imbalance (Uneg/pos). All metrics show green bars indicating that the requirements are fulfilled, with a red vertical line at the 95% mark.

The PQ statistic is shown for a time range of one week. The end of the time range can be selected. The time range always starts and ends at 00:00h. In the overview you can directly select the standard to be used for assessment.

Display of PQ statistic (locally)

Selection via Main menu | PQ statistic

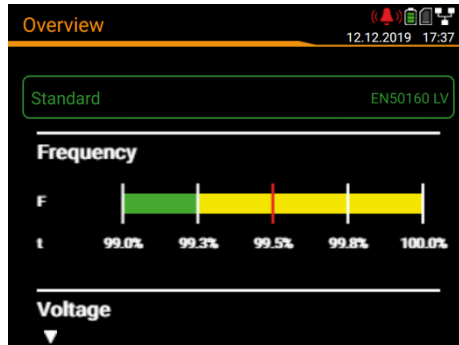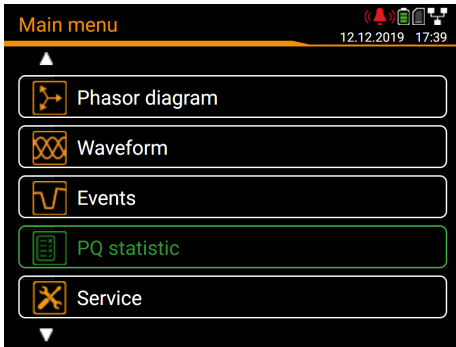


The PQ statistic is always displayed for the past seven days. Another time range cannot be selected.

The standard to be used for the assessment of the statistic can be changed by selecting the entry "Standard".


Display of PQ statistic details

For the recorded PQ quantities details can be displayed on a daily basis. On the local display this feature is limited to the past day.

...	Frequency	Daily statistic U	Harmonics U	Interharmonics U	Daily statistic I	Harmonics I	Interharmonics I
	Distribution	Voltage	Harmonics U1x	Interharmonics U1x	Current	Harmonics I1	Interharmonics I1
	Daily statistic	Flicker Pst	Harmonics U2x	Interharmonics U2x	Imbalance I	Harmonics I2	Interharmonics I2
		Flicker Plt	Harmonics U3x	Interharmonics U3x	TDD I	Harmonics I3	Interharmonics I3
		Imbalance U					
		THD U					

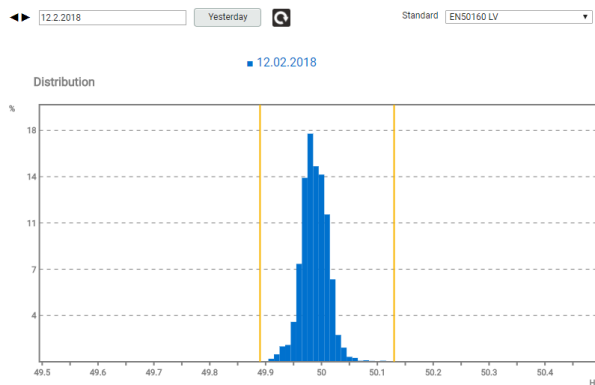



Statistical distribution of 10-s frequency values

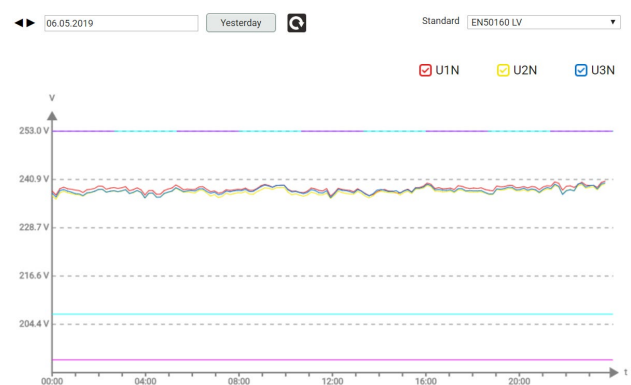


Course of 10-min voltage values

Creating a conformity report via the device website – PQ-Easy Report


Via  a conformity report in PDF format can be created.

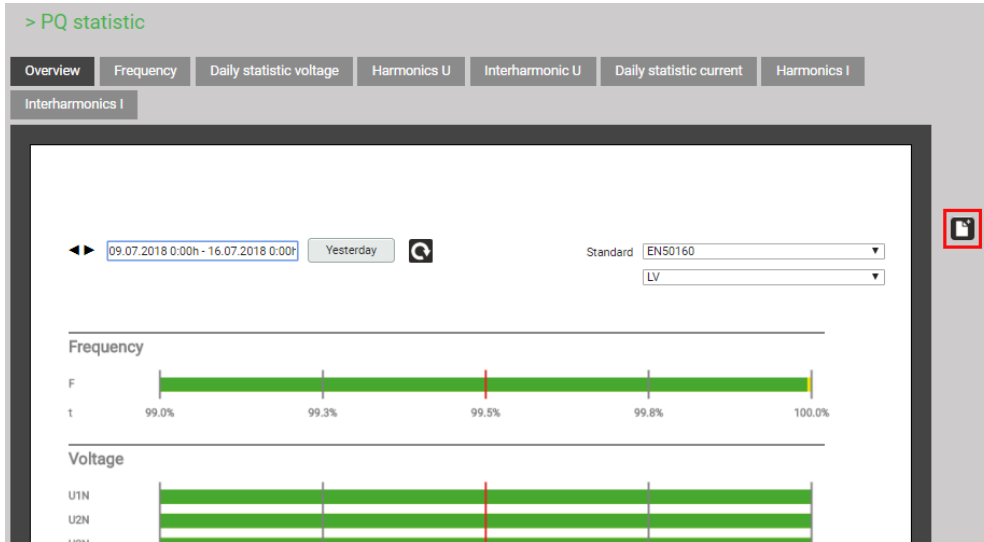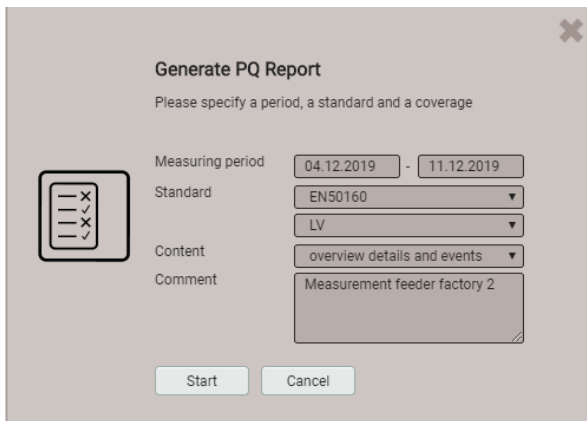1. Select assessment period: At least 1 week
2. Select standard for which conformity needs to be proven
3. Select content of report (3 levels)
4. Enter a comment, which needs to be shown on the first page of the report
5. Start report generation...

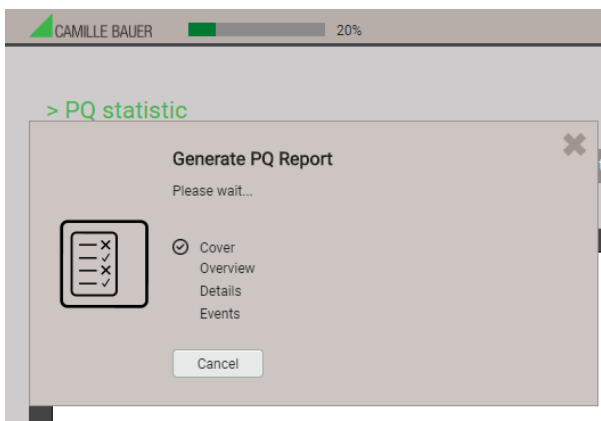

During report generation a progress bar is shown at the upper side of the screen. The duration of the report generation depends on the selected content, the assessment period and the number of recorded PQ events.

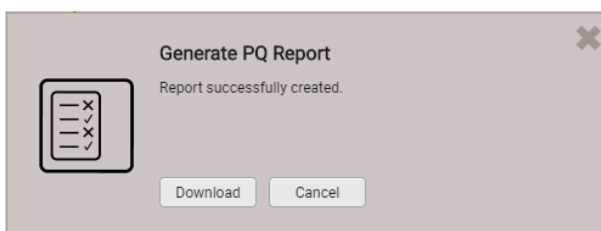


The generated report can be downloaded.

Depending on the browser and its settings, you can either choose where to save the file or the report will be saved in the default download directory.

Example of a conformity report


a) Overview

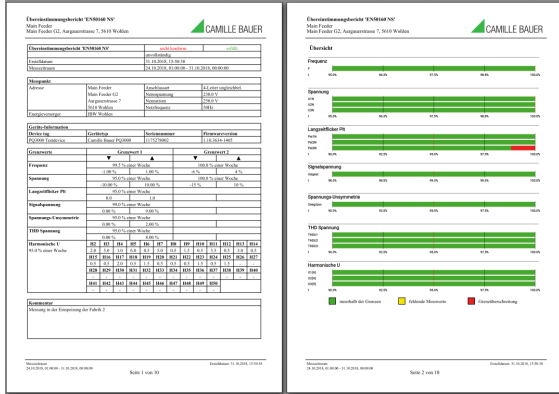

b) Details



c) Events

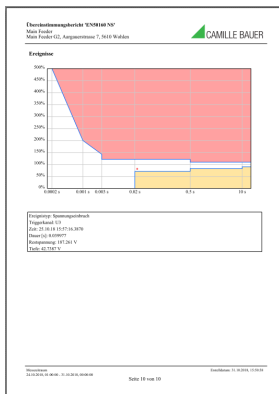

7.9 Measurement information in file format


Using the data export scheduler, measurement information may be provided also in file format. Such files can then:

- periodically or event-driven being sent to a SFTP server
- locally stored in the device and downloaded via webpage

The management and setup of tasks for providing files is done via the item *Data export | Data export scheduler* in the settings menu.

7.9.1 Predefined tasks

The data export scheduler contains two predefined tasks for providing PQDIF files with power quality information:

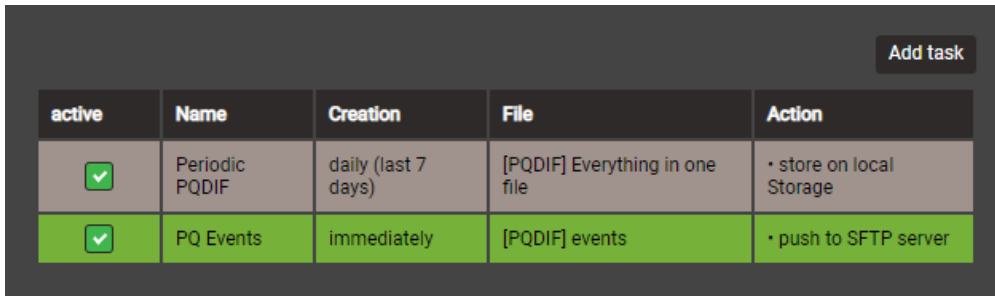


active	Name	Creation	File	Action
<input checked="" type="checkbox"/>	Periodic PQDIF	daily (last 7 days)	[PQDIF] Everything in one file	• store on local Storage
<input checked="" type="checkbox"/>	PQ Events	immediately	[PQDIF] events	• push to SFTP server

These tasks may be activated, deactivated and changed, but not deleted. Local storage and push to SFTP server are possible actions to be defined.

Periodic PQDIF

This task is executed periodically shortly after midnight and saves the file (s) in a hierarchical time structure (year, month, day). The task can be adjusted by selecting the entry. You can choose whether the information should be contained in one file or in up to three files (statistics, histograms, events). The time period can be either one day or seven days, and generation can be daily or weekly. The factory setting is the daily generation of up to 3 files, each for the previous day.

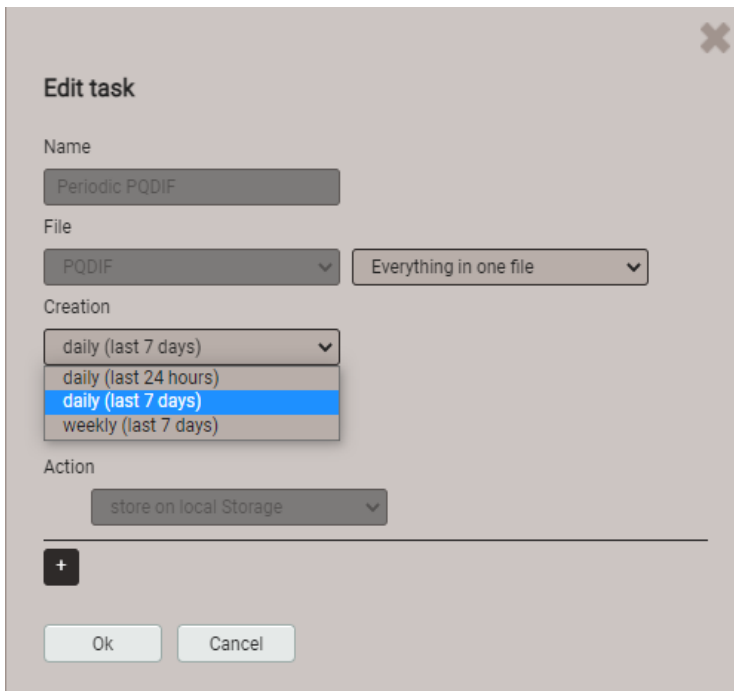

Edit task

Name
Periodic PQDIF

File
PQDIF Everything in one file

Creation
daily (last 7 days)
daily (last 24 hours)
daily (last 7 days)
weekly (last 7 days)

Action
store on local Storage

+
Ok Cancel

PQ Events

If this task is activated a PQDIF file with event data is created as soon as a PQ event has ended. Typically this file is then sent to an SFTP server.

7.9.2 Creating periodic file data

In addition to the predefined tasks new tasks can be setup for creating data files with a specific content at regular intervals. These files may then be stored locally and / or pushed to a SFTP server.

By selecting “Add task” new schedules can be set-up. An example is shown below:

The new task “24h_PowerMeans” will generate daily CSV files containing standard mean-values for the past 24 hours.

The files will be both stored locally and pushed to the subfolder PowerMeans of a SFTP server. The [settings](#) of the SFTP server to be used can be defined via Communication | SFTP in the Settings menu.

The transmission window selected here causes a random transmission of the file to the SFTP server within one hour since creation.


The task list then shows three active tasks. Predefined tasks are marked gray to highlight that they cannot be removed but deactivated. On the other hand, at any time the newly created task “24h_PowerMeans” can be fully modified, deactivated or deleted.

active	Name	Creation	File	Action
<input checked="" type="checkbox"/>	Periodic PQDIF	daily (last 7 days)	[PQDIF] Everything in one file	• store on local Storage
<input checked="" type="checkbox"/>	PQ Events	immediately	[PQDIF] events	• push to SFTP server
<input checked="" type="checkbox"/>	24h_PowerMeans	daily (last 24 hours)	[CSV] mean values	• store on local Storage • push to SFTP server

Via the settings of the local display only the activation / deactivation of the tasks is supported.

CSV settings

CSV files are intended for transmitting statistics of mean values. You may adjust the below parameters to adapt the file format and the content of the created files to your requirements.

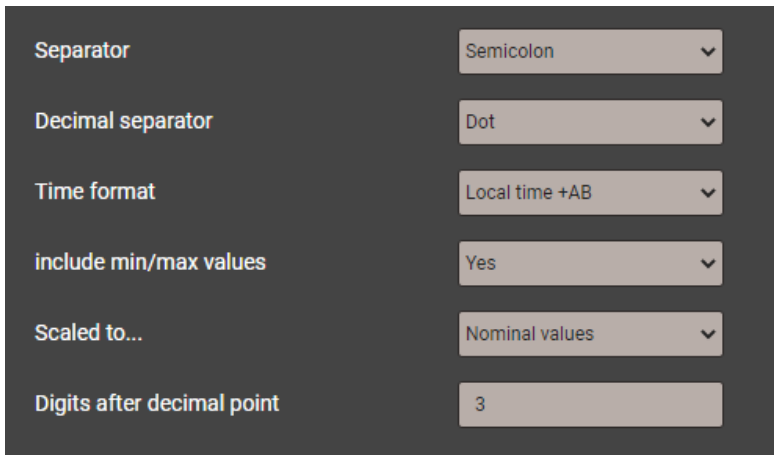

The screenshot shows a settings panel with the following options:

- Separator: Semicolon
- Decimal separator: Dot
- Time format: Local time +AB
- include min/max values: Yes
- Scaled to...: Nominal values
- Digits after decimal point: 3


- The **Separator** separates the individual entries on a text line for later display in table form.
- The **Decimal separator** defines how numbers or measured values are written to the file. The decimal separator must correspond to the country-specific number format of the operating system so that the CSV file can be opened directly in Excel without an import process. Common separators are periods (123.45) or commas (123,45).
- **Time format** defines the time format to be written. With the “local time + AB” time format, the double entries between 2 and 3 AM are supplemented with the letters A and B when switching back from daylight saving time.
- **Include min/max values** defines whether mean values with / without minimum and maximum values are written to the CSV file.
- **Scaled to** specifies whether the numerical value is based on the basic unit (e.g. 1087.65W) or on the units specified according to the nominal values (e.g. 1.0876kW), which are also used in the web interface.
- **Digits after decimal point** defines the number of digits after the decimal separator with which the numbers are written to the file.

7.9.3 Accessing file information via webpage


You can access files stored in the device using the service menu **Local data storage | Download data**. Depending on the tasks defined in the data export scheduler the available file structure may be different:

- **csv**: container for all CSV files to be locally stored
- **pqdif**: container for all PQDIF files to be locally stored

The structure is displayed in a new tab.

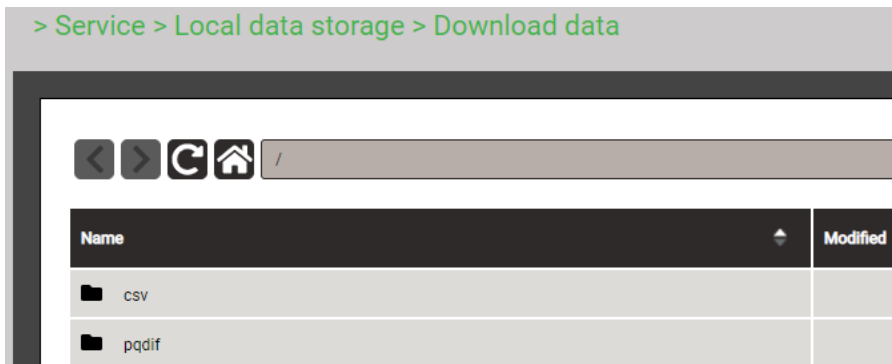

Files in the **pqdif** folder are stored in a hierarchical time structure (year, month, day). By selecting the desired date and double-clicking on the appropriate file, a PQDIF may be easily downloaded.

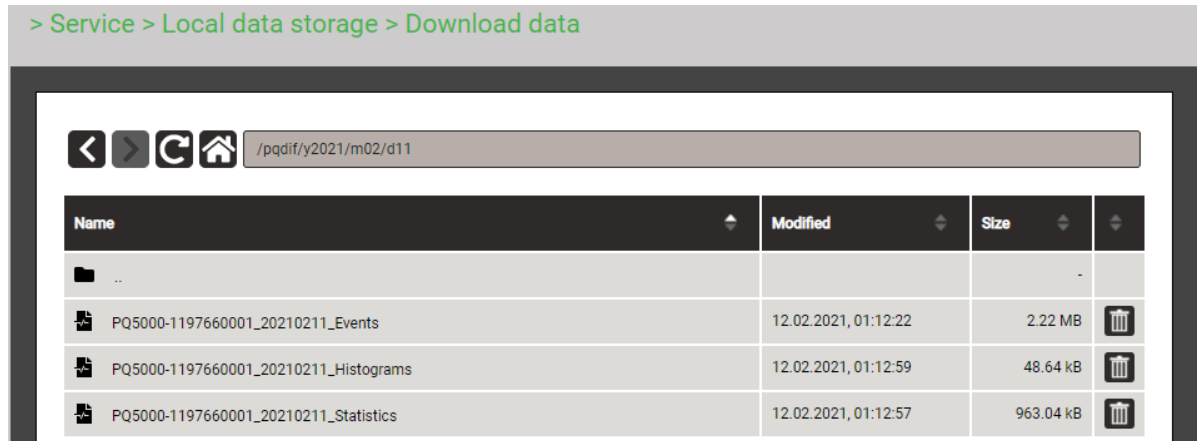


7.9.4 Periodical sending to a SFTP Server

If in the data export scheduler the sending to an SFTP server was selected as action, the appropriate files will be sent periodically to the SFTP server defined in the settings of the communication.

The screenshot shows the SFTP server configuration settings:

- Host: `tenserv.camillebauer.intra`
- Port: `22`
- Username: `sftpuser`
- Password: `....`
- Base directory: `data`
- Only connect to trusted host: `No`


For improving security, you may select that the device connects to trusted hosts only. When activating this setting the host must be present and sends a public key back to the device. If you accept this key the associated host will be added to the list of trusted servers.

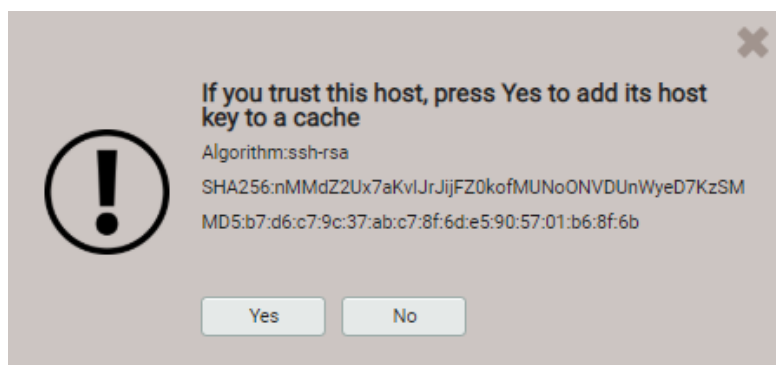

7.9.5 Evaluation of the PQDIF files

For the analysis of the data of the PQDIF files either the SmartCollect PM20 software (not included in the scope of delivery) or a free tool with limited functionality, such as the PQDiffactor from Electrotek Concepts (<http://www.pqview.com/pqdiffactor/>; registration required), or any other software (e.g. Dranview-7) supporting the PQDIF format can be used.

The **SmartCollect PM20** allows a more detailed analysis of the PQ data. Events can be graphically analyzed or displayed in an ITIC curve, which contains all PQ events with their residual voltage and event duration. You may also create compliance reports, e.g. according to EN50150.

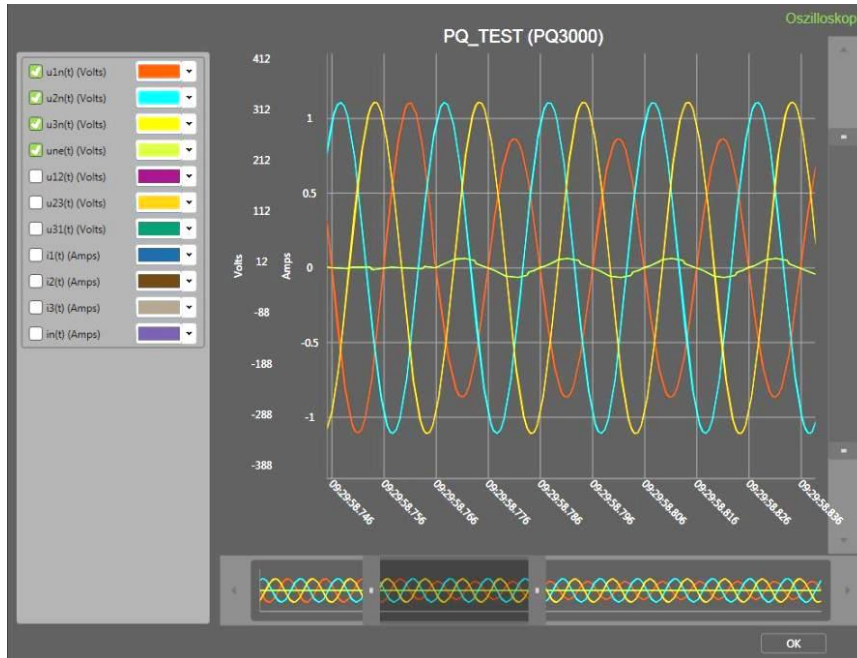

Representation of a voltage dip, using the SmartCollect PM20 software

7.10 Display timeouts

Devices with display are designed for displaying measurements. So, any other procedure will be terminated after a certain time without user interaction and the last active measurement image will be shown again.

Menu timeout

A menu timeout takes effect after 2 min. without changing the present menu selection. It doesn't matter if the currently displayed menu is the main menu or a sub-menu: The menu is closed and the last active measurement image is displayed again.

Configuration timeout

After 5 min. without interaction in a parameter selection or during entering a value in the settings menu, the active configuration step is closed and the associated parameter remains unchanged. The next step depends on what you have done before:

- If the user did not change configuration parameters before the aborted step, the main menu will be displayed and the device starts to monitor a possible menu timeout.
- If the user changed configuration parameters before the aborted step, the query "Store configuration changes?" is shown. If the user does not answer this query within 2 min. this dialogue is closed: The changed configuration will be stored and activated and then the last active measurement image is displayed again.

8. Service, maintenance and disposal

8.1 Calibration and new adjustment

Each device is adjusted and checked before delivery. The condition as supplied to the customer is measured and stored in electronic form.

The uncertainty of measurement devices may be altered during normal operation if, for example, the specified ambient conditions are not met. If desired, in our factory a calibration can be performed, including a new adjustment if necessary, to assure the accuracy of the device.

8.2 Cleaning

The display and the operating keys should be cleaned in regular intervals. Use a dry or slightly moist cloth for this.



Damage due to detergents

Detergents may not only affect the clearness of the display but also can damage the device. Therefore, do not use detergents.

8.3 Battery

The device contains a battery for buffering the internal clock. It cannot be changed by the user. The replacement can be done at the factory only.

If the UPS option is implemented, the associated battery pack needs to be exchanged regularly. For more information see [chapter 5.9](#).

8.4 Disposal

The product must be disposed in compliance with local regulations. This particularly applies to the built-in battery.

9. Technical data

Inputs

Current	(hardware versions: 3 V or 5 A)
• 3V 50/60 Hz	max. 6.0 V (sinusoidal)
• 5A 50/60 Hz	
Nominal current:	adjustable 1...5 A; max. 7.5 A (sinusoidal)
Measurement cat.:	300V CAT III
Consumption:	$\leq I^2 \times 0.01 \Omega$ per phase
Overload capacity:	10 A continuous; 100 A, 5 x 1 s, interval 300 s
Nominal voltage:	57.7...400 V _{LN} (UL: 347V _{LN}), 100...693 V _{LL} (UL: 600V _{LL});
Measurement max.:	520 V _{LN} , 900 V _{LL} (sinusoidal)
Measurement category:	600V CAT III
Consumption:	$\leq U^2 / 1.54 \text{ M}\Omega$ per phase
Impedance:	1.54 M Ω per phase
Overload capacity:	continuous: 520 V _{LN} , 900 V _{LL} 10 x 1 s, interval 10s: 800 V _{LN} , 1386 V _{LL}

Systems:	Single phase Split phase (2-phase system) 3-wire, balanced load 3-wire, unbalanced load 3-wire, unbalanced load, Aron connection 4-wire, unbalanced load
-----------------	---

Nominal frequency:	42... <u>50</u> ...58Hz or 50.5... <u>60</u> ...69.5Hz, configurable
Sampling rate:	18 kHz
Internal data memory:	32 GB

Measurement uncertainty

Reference conditions: Acc. IEC/EN 60688, ambient 15...30°C, sinusoidal input signals (form factor 1.1107), no fixed frequency for sampling, measurement time 200ms (10 cycles at 50Hz, 12 cycles at 60Hz)

Voltage, current:	$\pm 0.1\%$ ¹⁾²⁾
Neutral current:	$\pm 0.2\%$ ¹⁾ (if calculated)
Power:	$\pm 0.2\%$ ¹⁾²⁾
Power factor:	$\pm 0.2^\circ$
Frequency:	$\pm 0.01 \text{ Hz}$
Imbalance U, I:	$\pm 0.5\%$
Harmonics:	$\pm 0.5\%$
THD U, I:	$\pm 0.5\%$
Active energy:	Class 0.2S, EN 62053-22
Reactive energy:	Class 0.5S, EN 62053-24

Measurement with fixed system frequency:

General:	$\pm \text{Basic uncertainty} \times (F_{\text{config}} - F_{\text{actual}}) [\text{Hz}] \times 10$
Imbalance U:	$\pm 2\%$ up to $\pm 0.5 \text{ Hz}$
Harmonics:	$\pm 2\%$ up to $\pm 0.5 \text{ Hz}$
THD, TDD:	$\pm 3.0\%$ up to $\pm 0.5 \text{ Hz}$

¹⁾ Related to the nominal value of the basic quantity

²⁾ Additional uncertainty if neutral wire not connected (3-wire connections)

• Voltage, power: 0.1% of measured value; load factor: 0.1°

• Energy: Voltage influence x 2, angle influence x 2

Power Quality

Type of device: (IEC 62586-1) **PQI-A F11: Power Quality Instrument – Class A; Fixed installation; Indoor environment with uncontrolled temperature variations (1)**

Measurement cycle: 200 ms (50Hz: 10 cycles; 60Hz: 12 cycles)

Flagging concept: Multiphase approach in accordance with IEC 61000-4-30

Certification: According to IEC62586-2 (standard for verifying compliance with IEC 61000-4-30)

Certification body: Federal Institute of Metrology METAS, an independent and accredited laboratory

Conformity assessment against IEC 62586-2:2017

Clause	PQ parameter	Compliance 120 V- 60 Hz	Compliance 230 V – 50 Hz
6.1	Power frequency	Yes	Yes
6.2	Magnitude of the supply voltage	Yes	Yes
6.3	Flicker	Yes (class F1)	Yes (class F1)
6.4	Supply voltage interruptions, dips and swells	Yes	Yes
6.5	Supply voltage unbalance	Yes	Yes
6.6	Voltage harmonics	Yes	Yes
6.7	Voltage interharmonics	Yes	Yes
6.8	Mains signalling voltage of the supply voltage	Yes	Yes
6.9	Measurement of underdeviation / overdeviation parameters	Yes	Yes
6.10	Flagging	Yes	Yes
6.11	Clock uncertainty testing	Yes	Yes
6.12	Variations due to external influence quantities	Yes	Yes
6.13	Rapid voltage changes (RVC)	Yes	Yes
6.14	Magnitude of current	Yes	Yes
6.15	Harmonic current	Yes	Yes
6.16	Interharmonic currents	Yes	Yes
6.17	Current imbalance	Yes	Yes

Zero suppression, range limitations

The measurement of specific quantities is related to a pre-condition which must be fulfilled, that the corresponding value can be determined and sent via interface or displayed. If this condition is not fulfilled, a default value is used for the measurement.

Quantity	Condition	Default
Voltage	$U_x < 1\% U_{xnom}$	0.00
Current	$I_x < 0,1\% I_{xnom}$	0.00
PF	$S_x < 1\% S_{xnom}$	1.00
QF, LF, $\tan\phi$	$S_x < 1\% S_{xnom}$	0.00
Frequency	voltage and/or current input too low ¹⁾	Nominal frequency
Voltage unbalance	$U_x < 5\% U_{xnom}$	0.00
Current unbalance	mean value of phase currents $< 5\% I_{xnom}$	0.00
Phase angle U	at least one voltage $U_x < 5\% U_{xnom}$	120°
Harmonics U, THD-U	fundamental $< 5\% U_{xnom}$	0.00

¹⁾ Specific levels depend on the device configuration

Power supply

Nominal voltage:	100...230V AC 50/60Hz / DC $\pm 15\%$
Oversvoltage category:	OVC III
Consumption:	Single rack: max. 40VA (depends on the device hardware used) Double rack: max. 60VA (depends on the device hardware used)

I/O interface

Analog outputs

Linearization:	Linear, kinked
Range:	± 20 mA (24 mA max.), bipolar
Uncertainty:	$\pm 0.2\%$ of 20 mA
Burden:	$\leq 500 \Omega$ (max. 10 V / 20 mA)
Burden influence:	$\leq 0.2\%$
Residual ripple:	$\leq 0.4\%$
Response time:	220...420 ms

Passive digital inputs

	via plug-in terminal	
Nominal voltage:	24 ÷ 130 V DC (130 V max.)	110 ÷ 220 V DC (-15/+20%)
Input current:	< 5 mA	< 1 mA
Logisch ZERO:	-3 up to +5 V DC	0 up to 12 V DC
Logisch ONE:	11 up to 130 V DC	50 up to 264 V DC

Digital output

	Relay
Load capacity:	250 V AC, 2 A, 500 VA 30 V DC, 2 A, 60 W

Interface

Ethernet

	via RJ45 sockets
Protocol:	Modbus/TCP, NTP, http, https, IPv4, IPv6
Physics:	Ethernet 100BaseTX
Mode:	10/100 Mbit/s, full/half duplex, auto-negotiation

IEC61850

	via RJ45 sockets, 2 equivalent ports
Protocol:	IEC61850, NTP
Physics:	Ethernet 100BaseTX
Mode:	10/100 Mbit/s, full/half duplex, auto-negotiation

Modbus/RTU

	via plug-in terminal (A, B, C/X)
Protocol:	Modbus/RTU
Physics:	RS-485, max. 1200m (4000 ft)
Baud rate:	9'600, 19'200, 38'400, 57'600, 115'200 Baud
Number of participants:	≤ 32

Internal clock (RTC)

Uncertainty:	± 2 minutes / month (15 up to 30°C)
Synchronization:	none, via Ethernet (NTP protocol), GPS or IRIG-B
Running reserve:	> 10 years

Uninterruptible power supply (UPS)

Type:	VARTA Easy Pack EZPackL, UL listed MH16707
Nominal voltage:	3.7V
Capacity:	1150 mAh min., 4.5 Wh
Operating duration:	5 times 3 minutes
Life time:	3 up to 5 years, depending on operating and ambient conditions

Ambient conditions, general information

Operating temperature:	<ul style="list-style-type: none">• Device without UPS: –10 up to <u>15 up to 30</u> up to + 55°C• Device with UPS: 0 up to <u>15 up to 30</u> up to + 35°C (if used outside this operating temperature range, it is not ensured that the UPS battery pack is recharged).
Storage temperature:	Base device: -25 up to + 70°C; Battery pack UPS: -20...60°C (<1 month); -20° ...45°C (< 3 months); -20...30°C (< 1 year)
Temperature influence:	0.5 x measurement uncertainty per 10 K
Long term drift:	0.5 x measurement uncertainty per year
Usage group:	II (acc. EN 60 688)
Relative humidity:	< 95% no condensation
Altitude:	≤ 2000 m max.
Device to be used indoor only!	

Mechanical attributes

Housing material:	Polycarbonate (Makrolon)
Flammability class:	V-0 acc. UL94, non-dripping, free of halogen
Weight:	4.2 kg (single rack), 5.0 kg (double rack)
Dimensions:	Dimensional drawings

Vibration withstand (test according to DIN EN 60 068-2-6)

Acceleration:	Device with display: ± 0.25 g (operating); 1.20 g (storage)
Frequency range:	10 ... 150 ... 10 Hz, rate of frequency sweep: 1 octave/minute
Number of cycles:	10 in each of the 3 axes

Safety

Protection class:	II (protective insulation, voltage inputs via protective impedance)
Pollution degree:	2
Protection:	Front: IP40; Housing: IP30; IP20 (if version without router) Terminals: IP20
Rated voltage (versus earth):	Power supply: 100...230V AC / DC I/O's: 130 / 220 V DC

• Device with 5A 50/60Hz current inputs

The current inputs are galvanically isolated from each other

Test voltages: Test time 60 s, acc. IEC/EN 61010-1 (2011)

- power supply versus inputs U ¹⁾: 3600V AC
- power supply versus inputs I: 3000V AC
- power supply versus bus, I/O's: 3000V AC
- inputs U versus inputs I: 1800V AC
- inputs U versus bus, I/O's ¹⁾: 3600V AC
- inputs I versus bus, I/O's: 3000V AC
- inputs I versus inputs I: 1500V AC

¹⁾ During type test only, with all protective impedances removed

• Device with 3V 50/60Hz current inputs

The connections ↓ of the current inputs are internally connected

Test voltages: Test time 60 s, acc. IEC/EN 61010-1 (2011)

- power supply versus inputs U ¹⁾: 3600V AC
- power supply versus inputs I: 3000V AC
- power supply versus bus, I/O's: 3000V AC
- inputs U versus inputs I, bus, I/O's ¹⁾: 3600V AC

¹⁾ During type test only, with all protective impedances removed

The device uses the principle of protective impedance for the voltage inputs to ensure protection against electric shock. All circuits of the device are tested during final inspection.



Prior to performing high voltage or isolation tests involving the voltage inputs, all output connections of the device, especially analog and digital outputs as well as Modbus and Ethernet interface, must be removed. A possible high-voltage test between input and output circuits must be limited to 500V DC, otherwise electronic components can be damaged.

Applied regulations, standards and directives

IEC/EN 61010-1	Safety regulations for electrical measuring, control and laboratory equipment
IEC/EN 61000-4-30 Ed.3	Power quality measurement methods
IEC/EN 61000-4-7	General guide on harmonics and interharmonics measurements
IEC/EN 61000-4-15	Flickermeter - Functional and design specifications
IEEE 1159.3	Recommended Practice for the Transfer of Power Quality Data
IEC 62586-1 Ed.2	Power quality measurement in power supply systems – Power quality instruments (PQI)
IEC 62586-2 Ed.2	Power quality measurement in power supply systems – Functional tests and uncertainty requirements
EN50160	Voltage characteristics of electricity supplied by public distribution systems
IEC/EN 60688	Electrical measuring transducers for converting AC electrical variables into analog or digital signals
DIN 40 110	AC quantities
IEC/EN 60068-2-1/ -2/-3/-6/-27:	Ambient tests -1 Cold, -2 Dry heat, -3 Damp heat, -6 Vibration, -27 Shock
IEC/EN 60297-3-100	Mechanical structures for electronic equipment - Dimensions of mechanical structures of the 482,6 mm (19 in) series - Part 3-100: Basic dimensions of front panels, subracks, chassis, racks and cabinets.
IEC/EN 60529	Protection type by enclosures
IEC/EN 61000-6-4	Electromagnetic compatibility (EMC): Emission standard for industrial environments
IEC/EN 61000-6-5	Electromagnetic compatibility (EMC): Immunity for equipment used in power station and substation environment
IEC/EN 62053-22	Static meters for active energy (classes 0.2 S and 0.5 S)
IEC/EN 62053-24	Static meters for reactive energy at fundamental frequency (classes 0.5 S, 1 S and 1)
UL94	Tests for flammability of plastic materials for parts in devices and appliances
2011/65/EU (RoHS)	EU directive on the restriction of the use of certain hazardous substances

Warning


This is a class A product. In a domestic environment this product may cause radio interference in which case the user may be required to take adequate measures.

This device complies with part 15 of the FCC:

Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

This Class A digital apparatus complies with Canadian ICES-0003.

10. Dimensional drawings

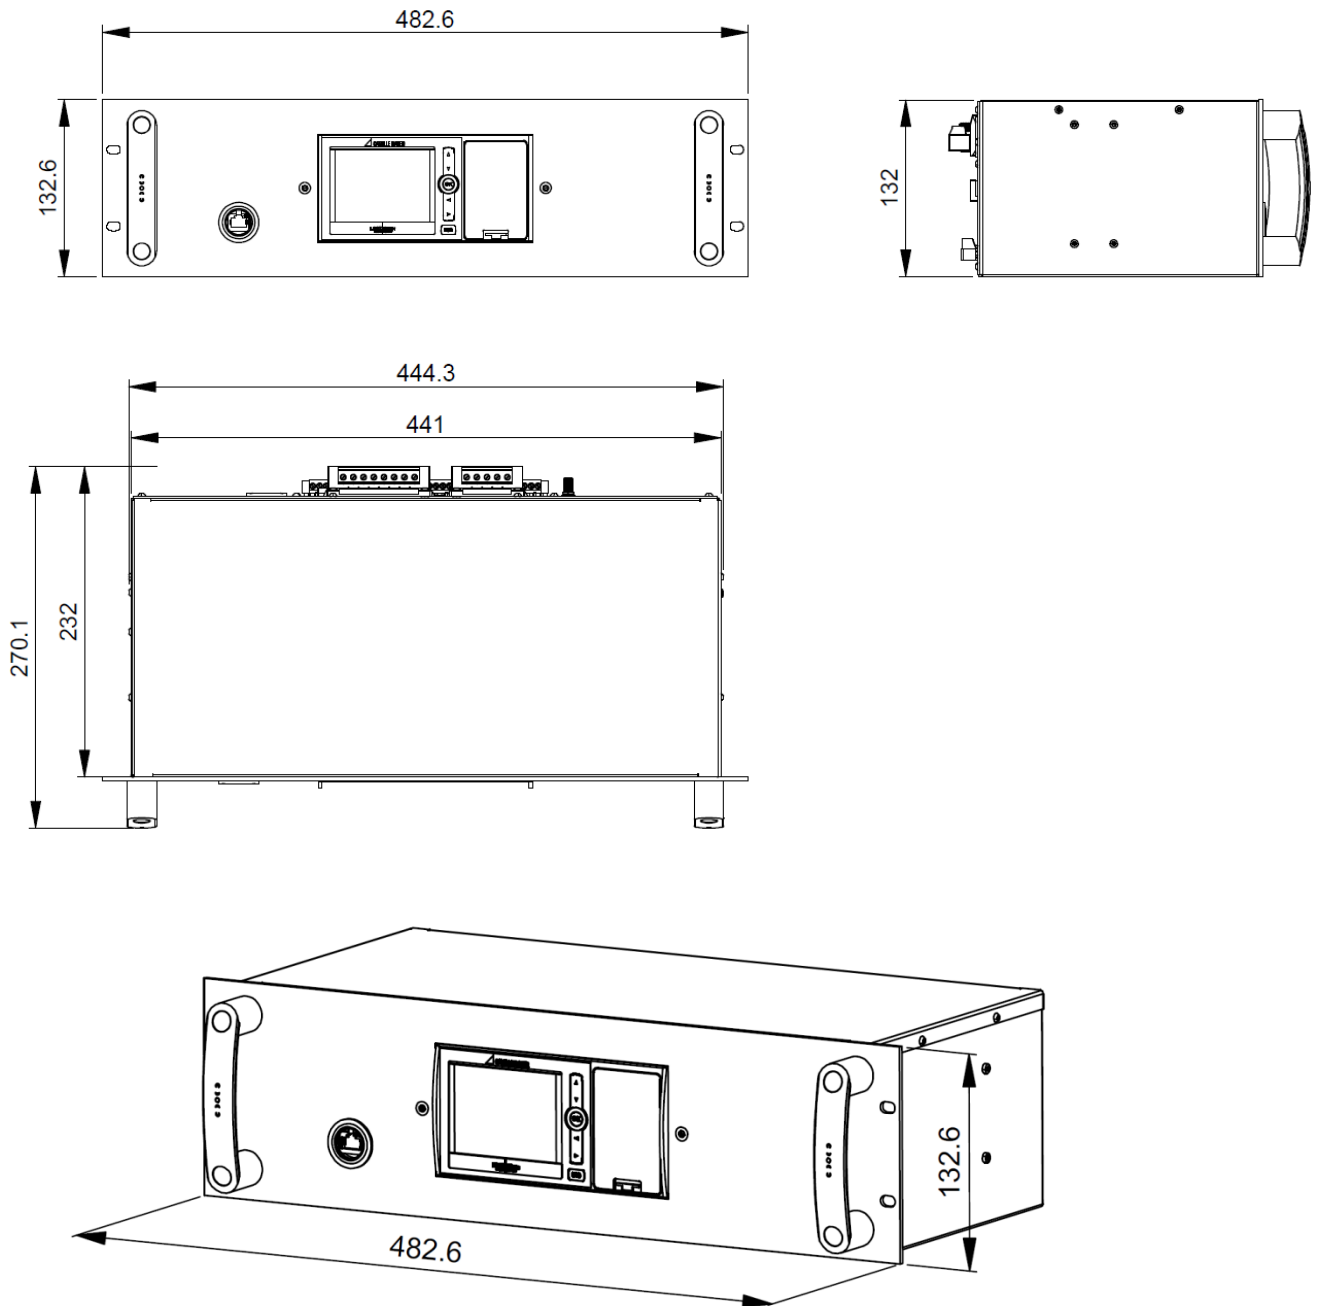

All dimensions in [mm]

Annex

A Description of measured quantities

Used abbreviations

1L	Single phase system
2L	Split phase; system with 2 phases and center tap
3Lb	3-wire system with balanced load
3Lu	3-wire system with unbalanced load
3Lu.A	3-wire system with unbalanced load, Aron connection (only 2 currents connected)
4Lu	4-wire system with unbalanced load

A1 Basic measurements

The basic measured quantities are calculated each 200ms by determining an average over 10 cycles at 50Hz or 12 cycles at 60Hz. If a measurement is available depends on the selected system.

Depending on the measured quantity also minimum and maximum values are determined and non-volatile stored with timestamp. These values may be reset by the user via display or website; see [resetting of measurements](#).

Measurement	present	max	min	1L	2L	3Lb	3Lu	3Lu.A	4Lu
Voltage U	•	•	•	√	√				
Voltage U _{1N}	•	•	•		√				√
Voltage U _{2N}	•	•	•		√				√
Voltage U _{3N}	•	•	•						√
Voltage U ₁₂	•	•	•			√	√	√	√
Voltage U ₂₃	•	•	•			√	√	√	√
Voltage U ₃₁	•	•	•			√	√	√	√
Voltage U _{NE} / U _{4C} ¹⁾	•	•		√	√	√	√	√	√
Current I	•	•		√		√			
Current I1	•	•			√		√	√	√
Current I2	•	•			√		√	√	√
Current I3	•	•					√	√	√
Neutral current I _N	•	•		√	√				√
Earth current I _{PE} (calculated)	•	•							√
Active power P	•	•		√	√	√	√	√	√
Active power P1	•	•			√				√
Active power P2	•	•			√				√
Active power P3	•	•							√
Fundamental active power P(H1)	•	•		√	√	√	√	√	√
Fundamental active power P1(H1)	•	•			√				√
Fundamental active power P2(H1)	•	•			√				√
Fundamental active power P3(H1)	•	•							√
Total reactive power Q	•	•		√	√	√	√	√	√
Total reactive power Q1	•	•			√				√
Total reactive power Q2	•	•			√				√
Total reactive power Q3	•	•							√
Distortion reactive power D	•	•		√	√	√	√	√	√
Distortion reactive power D1	•	•			√				√
Distortion reactive power D2	•	•			√				√
Distortion reactive power D3	•	•							√
Fundamental reactive power Q(H1)	•	•		√	√	√	√	√	√
Fundamental reactive power Q1(H1)	•	•			√				√
Fundamental reactive power Q2(H1)	•	•			√				√
Fundamental reactive power Q3(H1)	•	•							√

¹⁾ U_{4C} for 3-wire systems only if measurement of homopolar voltage has been activated; U_{NE} otherwise


Measurement	present	max	min	1L	2L	3Lb	3Lu	3LuA	4Lu
Apparent power S	•	•		√	√	√	√	√	√
Apparent power S1	•	•			√				√
Apparent power S2	•	•			√				√
Apparent power S3	•	•							√
Fundamental apparent power S(H1)	•	•		√	√	√	√	√	√
Fundamental apparent power S1(H1)	•	•			√				√
Fundamental apparent power S2(H1)	•	•			√				√
Fundamental apparent power S3(H1)	•	•							√
Frequency F	•	•	•	√	√	√	√	√	√
Power factor PF	•			√	√	√	√	√	√
Power factor PF1	•				√				√
Power factor PF2	•				√				√
Power factor PF3	•								√
PF quadrant I			•	√	√	√	√	√	√
PF quadrant II			•	√	√	√	√	√	√
PF quadrant III			•	√	√	√	√	√	√
PF quadrant IV			•	√	√	√	√	√	√
Reactive power factor QF	•			√	√	√	√	√	√
Reactive power factor QF1	•				√				√
Reactive power factor QF2	•				√				√
Reactive power factor QF3	•								√
Load factor LF	•			√	√	√	√	√	√
Load factor LF1	•				√				√
Load factor LF2	•				√				√
Load factor LF3	•								√
cosφ (H1)	•			√	√	√	√	√	√
cosφ L1 (H1)	•				√				√
cosφ L2 (H1)	•				√				√
cosφ L3 (H1)	•								√
cosφ (H1) quadrant I			•	√	√	√	√	√	√
cosφ (H1) quadrant II			•	√	√	√	√	√	√
cosφ (H1) quadrant III			•	√	√	√	√	√	√
cosφ (H1) quadrant IV			•	√	√	√	√	√	√
tanφ (H1)	•			√	√	√	√	√	√
tanφ L1 (H1)	•				√				√
tanφ L2 (H1)	•				√				√
tanφ L3 (H1)	•								√
$U_{mean}=(U1N+U2N)/2$	•				√				
$U_{mean}=(U1N+U2N+U3N)/3$	•								√
$U_{mean}=(U12+U23+U31)/3$	•					√	√	√	
$I_{mean}=(I1+I2)/2$	•				√				
$I_{mean}=(I1+I2+I3)/3$	•						√		√
IMS, Average current with sign of P	•			√	√	√	√	√	√
Phase angle between U1 and U2	•					√	√	√	√
Phase angle between U2 and U3	•					√	√	√	√
Phase angle between U3 and U1	•					√	√	√	√
Angle between U and I	•			√		√	√	√	
Angle between U1 and I1	•				√				√
Angle between U2 and I2	•				√				√
Angle between U3 and I3	•								√
Maximum ΔU <> Um	•	•			√	√	√	√	√
Maximum ΔI <> Im	•	•			√		√		√

• Available via communication interface only

Reactive power

Most of the loads consume a combination of ohmic and inductive current from the power system. Reactive power arises by means of the inductive load. But the number of non-linear loads, such as RPM regulated drives, rectifiers, thyristor controlled systems or fluorescent lamps, is increasing. They cause non-sinusoidal AC currents, which may be represented as a sum of harmonics. Thus the reactive power to transmit increases and leads to higher transmission losses and higher energy costs. This part of the reactive power is called distortion reactive power.

Normally reactive power is unwanted, because there is no usable active component in it. Because the transmission of reactive power over long distances is uneconomic, it makes sense to install compensation systems close to the consumers. So transmission capacities may be used better and losses and voltage drops by means of harmonic currents can be avoided.

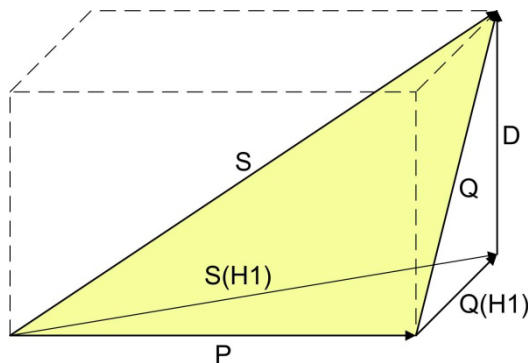

- P: Active power
- S: Apparent power including harmonic components
- S1: Fundamental apparent power
- Q: Total reactive power
- Q(H1): Fundamental reactive power
- D: Distortion reactive power

The reactive power may be divided in a fundamental and a distortion component. Only the fundamental reactive power may be compensated directly by means of the classical capacitive method. The distortion components have to be combated using inductors or active harmonic conditioners.

The **load factor PF** is the relation between active power P and apparent power S, including all possibly existing harmonic parts. This factor is often called $\cos\varphi$, which is only partly correct. The PF corresponds to the **cos φ** only, if there is no harmonic content present in the system. So the **cos φ** represents the relation between the active power P and the fundamental apparent power S(H1).


The **tan φ** is often used as a target quantity for the capacitive reactive power compensation. It corresponds to the relation of the fundamental reactive power Q(H1) and the active power P.

Power factors

The **power factor PF** gives the relation between active and apparent power. If there are no harmonics present in the system, it corresponds to the $\cos\varphi$ or displacement power factor. The PF has a range of -1...0...+1, where the sign gives the direction of energy flow.

The **load factor LF** is a quantity derived from the PF, which allows making a statement about the load type. Only this way it's possible to measure a range like 0.5 capacitive ... 1 ... 0.5 inductive in a non-ambiguous way.

The **reactive power factor QF** gives the relation between reactive and apparent power.

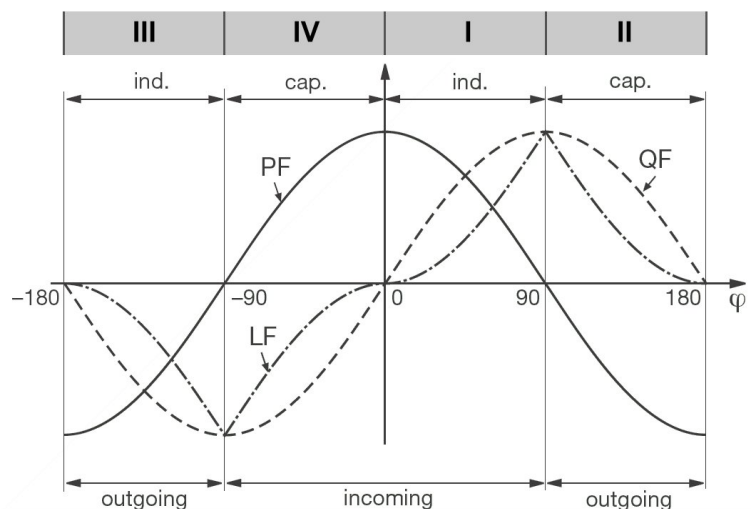


Example from the perspective of an energy consumer

Zero displacement voltage U_{NE}

Starting from the generating system with star point E (which is normally earthed), the star point (N) on load side is shifted in case of unbalanced load. The zero displacement voltage between E and N may be determined by a vector addition of the voltage vectors of the three phases:

$$\underline{U}_{NE} = - (\underline{U}_{1N} + \underline{U}_{2N} + \underline{U}_{3N}) / 3$$

A displacement voltage may also occur due to harmonics of order 3, 9, 15, 21 etc., because the dedicated currents add in the neutral wire.

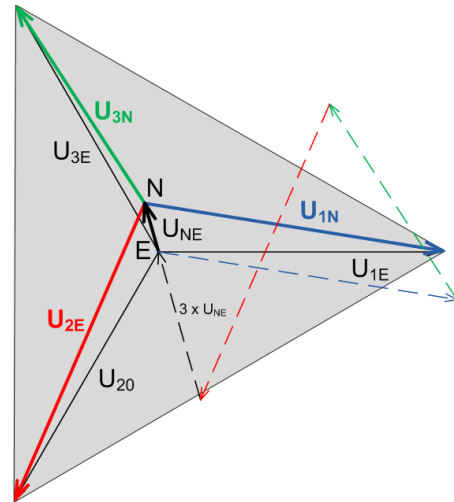

A2 Harmonic analysis

The harmonic analysis is performed according IEC 61000-4-7 over 10 cycles at 50Hz or 12 cycles at 60Hz. If a measured quantity is available depends on the selected system.

Measurement	prese	max	1L	2L	3Lb	3Lu	3Lu.A	4Lu
THD Voltage U1N/U	•	•	√	√				√
THD Voltage U2N	•	•		√				√
THD Voltage U3N	•	•						√
THD Voltage U12	•	•			√	√	√	
THD Voltage U23	•	•			√	√	√	
THD Voltage U31	•	•			√	√	√	
THD Current I1/I	•	•	√	√	√	√	√	√
THD Current I2	•	•		√		√	√	√
THD Current I3	•	•				√	√	√
TDD Current I1/I	•	•	√	√	√	√	√	√
TDD Current I2	•	•		√		√	√	√
TDD Current I3	•	•				√	√	√
Harmonic contents 2 nd ...50 th U1N/U	•	•	√	√				√
Harmonic contents 2 nd ...50 th U2N	•	•		√				√
Harmonic contents 2 nd ...50 th U3N	•	•						√
Harmonic contents 2 nd ...50 th U12	•	•			√	√	√	
Harmonic contents 2 nd ...50 th U23	•	•			√	√	√	
Harmonic contents 2 nd ...50 th U31	•	•			√	√	√	
Harmonic contents 2 nd ...50 th I1/I	•	•	√	√	√	√	√	√
Harmonic contents 2 nd ...50 th I2	•	•		√		√	√	√
Harmonic contents 2 nd ...50 th I3	•	•				√	√	√

Harmonic contents are available up to the 89th (50Hz) or 75th (60Hz) on the Modbus interface

• Available via communication interface only

Harmonics

Harmonics are multiples of the fundamental or system frequency. They arise if non-linear loads, such as RPM regulated drives, rectifiers, thyristor controlled systems or fluorescent lamps are present in the power system. Thus undesired side effects occur, such as additional thermal stress to operational resources or electrical mains, which lead to an advanced aging or even damage. Also the reliability of sensitive loads can be affected and unexplainable disturbances may occur. In industrial networks the image of the harmonics gives good information about the kind of loads connected. See also:

► [Increase of reactive power due to harmonic currents](#)

TDD (Total Demand Distortion)

The complete harmonic content of the currents is calculated additionally as Total Demand Distortion, briefly TDD. This value is scaled to the rated current or rated power. Only this way it's possible to estimate the influence of the current harmonics on the connected equipment correctly.

Maximum values

The maximum values of the harmonic analysis arise from the monitoring of THD and TDD. The maximum values of individual harmonics are not monitored separately, but are stored if a maximum value of THD or TDD is detected. The image of the maximum harmonics therefore always corresponds to the dedicated THD or TDD.



The accuracy of the harmonic analysis strongly depends on the quality of the current and voltage transformers possibly used. In the harmonics range transformers normally change both, the amplitude and the phase of the signals to measure. It's valid: The higher the frequency of the harmonic, the higher its damping or phase shift.

A3 System imbalance

Measured quantity	prese	max	1L	2L	3Lb	3Lu	3Lu.A	4Lu
UR1: Positive sequence [V]	•				√	√	√	√
UR2: Negative sequence [V]	•				√	√	√	√
U0: Zero sequence [V]	•							√
U: Imbalance UR2/UR1	•	•			√	√	√	√
U: Imbalance U0/UR1	•	•						√
IR1: Positive sequence [A]	•					√		√
IR2: Negative sequence [A]	•					√		√
I0: Zero sequence [A]	•							√
I: Imbalance IR2/IR1	•	•				√		√
I: Imbalance I0/IR1	•	•						√

• Available via communication interface only

Imbalance in three-phase systems may occur due to single-phase loads, but also due to failures, such as e.g. the blowing of a fuse, an earth fault, a phase failure or an isolation defect. Also harmonics of the 3rd, 9th, 15th, 21st etc. order, which add in the neutral wire, may lead to imbalance. Operating resources dimensioned to rated values, such as three-phase generators, transformers or motors on load side, may be excessively stressed by imbalance. So a shorter life cycle, a damage or failure due to thermal stress can result. Therefore monitoring imbalance helps to reduce the costs for maintenance and extends the undisturbed operating time of the used resources.

Imbalance or unbalanced load relays use different measurement principles. One of them is the approach of the symmetrical components, the other one calculates the maximum deviation from the mean-value of the three phase values. The results of these methods are not equal and don't have the same intention. Both of these principles are implemented in the device.

Symmetrical components (acc. Fortescue)

The imbalance calculation method by means of the symmetrical components is ambitious and intensive to calculate. The results may be used for disturbance analysis and for protection purposes in three-phase systems. The real existing system is divided in symmetrical system parts: A positive sequence, a negative sequence and (for systems with neutral conductor) a zero sequence system. The approach is easiest to understand for rotating machines. The positive sequence represents a positive rotating field, the negative sequence a negative (braking) rotating field with opposite sense of direction. Therefore the negative sequence prevents that the machine can generate the full turning moment. For e.g. generators the maximum permissible current imbalance is typically limited to a value of 8...12%.

Maximum deviation from the mean value


The calculation of the maximum deviation from the mean value of the phase currents or phase voltages gives the information if a grid or substation is imbalanced loaded. The results are independent of rated values and the present load situation. So a more symmetrical system can be aspired, e.g. by changing loads from one phase to another.

Also failure detection is possible. The capacitors used in compensation systems are wear parts, which fail quite often and then have to be replaced. When using three phase power capacitors all phases will be compensated equally which leads to almost identical currents flowing through the capacitors, if the system load is comparable. By monitoring the current imbalance it's then possible to estimate if a capacitor failure is present.

The maximum deviations are calculated in the same steps as the instantaneous values and therefore are arranged there ([see A1](#)).

A4 Mean values and trend

Measured quantity		Present	Trend	max	min	History
Active power I+IV	10s...60min. ¹⁾	•	•	•	•	5
Active power II+III	10s...60min. ¹⁾	•	•	•	•	5
Reactive power I+II	10s...60min. ¹⁾	•	•	•	•	5
Reactive power III+IV	10s...60min. ¹⁾	•	•	•	•	5
Apparent power	10s...60min. ¹⁾	•	•	•	•	5
Mean value quantity 1	10s...60min. ²⁾	•	•	•	•	1
....						
Mean value quantity 12	10s...60min. ²⁾	•	•	•	•	1



¹⁾ Interval time t1 ²⁾ Interval time t2

Calculating the mean-values

The mean value calculation is performed via integration of the measured instantaneous values over a configurable averaging interval. The interval time may be selected in the range from 10 seconds up to one hour. Possible interim values are set the way that a multiple of it is equal to a minute or an hour. Mean values of power quantities (interval time t1) and free quantities (interval time t2) may have different averaging intervals.

Synchronization

For the synchronization of the averaging intervals the internal clock is used. To be able to compare the mean values of power quantities on generating and demand side it is therefore required to synchronize the clock either via NTP, GPS or IRIG-B.

Trend

The estimated final value (trend) of mean values is determined by weighted addition of measurements of the past and the present interval. It serves for early detection of a possible exceeding of a given maximum value. This can then be avoided, e.g. by switching off an active load.

History

For mean values of system powers the last 5 interval values may be displayed on the device or read via interface. For configurable quantities the value of the last interval is provided via communication interface.

Bimetal current


This measured quantity serves for measuring the long-term effect of the current, e.g. for monitoring the warming of a current-carrying line. To do so, an exponential function is used, similar to the charging curve of a capacitor. The response time of the bimetal function can be freely selected, but normally it corresponds to the interval for determining the power mean-values.

Measured quantity	Present	max	1L	2L	3Lb	3Lu	3Lu.A	4Lu
Bimetal current IB, 1...60min. ³⁾	•	•	√		√			
Bimetal current IB1, 1...60min. ³⁾	•	•		√		√	√	√
Bimetal current IB2, 1...60min. ³⁾	•	•		√		√	√	√
Bimetal current IB3, 1...60min. ³⁾	•	•				√	√	√

³⁾ Interval time t3

A5 Meters

Measured quantity		1L	2L	3Lb	3Lu	3Lu.A	4Lu
Active energy I+IV, high tariff		•	•	•	•	•	•
Active energy II+III, high tariff		•	•	•	•	•	•
Reactive energy I+II, high tariff		•	•	•	•	•	•
Reactive energy III+IV, high tariff		•	•	•	•	•	•
Active energy I+IV, low tariff		•	•	•	•	•	•
Active energy II+III, low tariff		•	•	•	•	•	•
Reactive energy I+II, low tariff		•	•	•	•	•	•
Reactive energy III+IV, low tariff		•	•	•	•	•	•
User configured meter 1	Only basic quantities can be selected which are supported in the present system.						
User configured meter 2							
User configured meter 3							
User configured meter 4							
User configured meter 5							
User configured meter 6							
User configured meter 7							
User configured meter 8							
User configured meter 9							
User configured meter 10							
User configured meter 11							
User configured meter 12							



Standard meters

The meters for active and reactive energy of the system are always active.

User configured meters

To each of these meters the user can freely assign a basic quantity.

Programmable meter resolution


i For all meters the resolution (displayed unit) can be selected almost freely. This way, applications with short measurement times, e.g. energy consumption of a working day or shift, can be realized. The smaller the basic unit is selected, the faster the meter overflow is reached.

B Display matrices

B0 Used abbreviations for the measurements

Instantaneous values

Name	Measurement identification	Unit	Description
U	TRMS	V	Voltage system
U1N	U 1N TRMS	V	Voltage between phase L1 and neutral
U2N	U 2N TRMS	V	Voltage between phase L2 and neutral
U3N	U 3N TRMS	V	Voltage between phase L3 and neutral
U12	U 12 TRMS	V	Voltage between phases L1 and L2
U23	U 23 TRMS	V	Voltage between phases L2 and L3
U31	U 31 TRMS	V	Voltage between phases L3 and L1
UNE	U NE TRMS	V	Zero displacement voltage 4-wire systems
U4C	U NE TRMS	V	Homopolar voltage between U4 and COM
I	TRMS	A	Current system
I1	I 1 TRMS	A	Current phase L1
I2	I 2 TRMS	A	Current phase L2
I3	I 3 TRMS	A	Current phase L3
IN	I N TRMS	A	Neutral current
IPE	I PE TRMS		Earth current
P	P TRMS	W	Active power system (P=P1+P2+P3)
P1	P 1 TRMS	W	Active power phase L1
P2	P 2 TRMS	W	Active power phase L2
P3	P 3 TRMS	W	Active power phase L3
Q	Q TRMS	var	Reactive power system (Q=Q1+Q2+Q3)
Q1	Q 1 TRMS	var	Reactive power phase L1
Q2	Q 2 TRMS	var	Reactive power phase L2
Q3	Q 3 TRMS	var	Reactive power phase L3
S	S TRMS	VA	Apparent power system
S1	S 1 TRMS	VA	Apparent power phase L1
S2	S 2 TRMS	VA	Apparent power phase L2
S3	S 3 TRMS	VA	Apparent power phase L3
F	F TRMS	Hz	System frequency
PF	PF TRMS		Active power factor P/S
PF1	PF 1 TRMS		Active power factor P1/S1
PF2	PF 2 TRMS		Active power factor P2/S2
PF3	PF 3 TRMS		Active power factor P3/S3
QF	QF TRMS		Reactive power factor Q / S
QF1	QF 1 TRMS		Reactive power factor Q1 / S1
QF2	QF 2 TRMS		Reactive power factor Q2 / S2
QF3	QF 3 TRMS		Reactive power factor Q3 / S3
LF	LF TRMS		Load factor system
LF1	LF 1 TRMS		Load factor phase L1
LF2	LF 2 TRMS		Load factor phase L2
LF3	LF 3 TRMS		Load factor phase L3
UR1	U pos SEQ	V	Positive sequence voltage
UR2	U neg SEQ	V	Negative sequence voltage
U0	U zero SEQ	V	Zero sequence voltage
IR1	I pos SEQ	A	Positive sequence current
IR2	I neg SEQ	A	Negative sequence current
I0	I zero SEQ	A	Zero sequence current
UR2R1	U neg/pos UNB	%	Unbalance factor voltage UR2/UR1
IR2R1	I neg/pos UNB	%	Unbalance factor current IR2/IR1
U0R1	U zero/pos UNB	%	Unbalance factor voltage U0/UR1
I0R1	I zero/pos UNB	%	Unbalance factor current I0/IR1















Name	Measurement identification	Unit	Description	
IMS	I \emptyset 	TRMS	A	Average current with sign of P
Pst1N	Pst 1N	10min		Short term flicker U1N, Averaging time 10min.
Pst2N	Pst 2N	10min		Short term flicker U2N, Averaging time 10min.
Pst3N	Pst 3N	10min		Short term flicker U3N, Averaging time 10min.
Pst12	Pst 12	10min		Short term flicker U12, Averaging time 10min.
Pst23	Pst 23	10min		Short term flicker U23, Averaging time 10min.
Pst31	Pst 31	10min		Short term flicker U31, Averaging time 10min.
UD	$U \leq$ 1N	TRMS	V	Underdeviation system voltage
UD1N	$U \leq$ 1N	TRMS	V	Underdeviation voltage U1N
UD2N	$U \leq$ 2N	TRMS	V	Underdeviation voltage U2N
UD3N	$U \leq$ 3N	TRMS	V	Underdeviation voltage U3N
UD12	$U \leq$ 12	TRMS	V	Underdeviation voltage U12
UD23	$U \leq$ 23	TRMS	V	Underdeviation voltage U23
UD31	$U \leq$ 31	TRMS	V	Underdeviation voltage U31
OD	$U \geq$ 1N	TRMS	V	Overdeviation system voltage
OD1N	$U \geq$ 1N	TRMS	V	Overdeviation voltage U1N
OD2N	$U \geq$ 2N	TRMS	V	Overdeviation voltage U2N
OD3N	$U \geq$ 3N	TRMS	V	Overdeviation voltage U3N
OD12	$U \geq$ 12	TRMS	V	Overdeviation voltage U12
OD23	$U \geq$ 23	TRMS	V	Overdeviation voltage U23
OD31	$U \geq$ 31	TRMS	V	Overdeviation voltage U31

Minimum and maximum of instantaneous values










Name	Measurement identification	Unit	Description
U_MM	U TRMS ▲TS ▼TS	V	Minimum and maximum value of U
U1N_MM	U 1N TRMS ▲TS ▼TS	V	Minimum and maximum value of U1N
U2N_MM	U 2N TRMS ▲TS ▼TS	V	Minimum and maximum value of U2N
U3N_MM	U 3N TRMS ▲TS ▼TS	V	Minimum and maximum value of U3N
U12_MM	U 12 TRMS ▲TS ▼TS	V	Minimum and maximum value of U12
U23_MM	U 23 TRMS ▲TS ▼TS	V	Minimum and maximum value of U23
U31_MM	U 31 TRMS ▲TS ▼TS	V	Minimum and maximum value of U31
UNE_MAX	U NE TRMS ▲TS	V	Maximum value of UNE
U4C_MAX	U 4C TRMS ▲TS	V	Maximum value of U4C
I_MAX	I TRMS ▲TS	A	Maximum value of I
I1_MAX	I 1 TRMS ▲TS	A	Maximum value of I1
I2_MAX	I 2 TRMS ▲TS	A	Maximum value of I2
I3_MAX	I 3 TRMS ▲TS	A	Maximum value of I3
IN_MAX	I N TRMS ▲TS	A	Maximum value of IN
IPE_MAX	I PE TRMS ▲TS	A	Maximum value of IPE
P_MAX	P TRMS ▲TS	W	Maximum value of P
P1_MAX	P 1 TRMS ▲TS	W	Maximum value of P1
P2_MAX	P 2 TRMS ▲TS	W	Maximum value of P2
P3_MAX	P 3 TRMS ▲TS	W	Maximum value of P3
Q_MAX	Q TRMS ▲TS	var	Maximum value of Q
Q1_MAX	Q 1 TRMS ▲TS	var	Maximum value of Q1
Q2_MAX	Q 2 TRMS ▲TS	var	Maximum value of Q2
Q3_MAX	Q 3 TRMS ▲TS	var	Maximum value of Q3
S_MAX	S TRMS ▲TS	VA	Maximum value of S
S1_MAX	S 1 TRMS ▲TS	VA	Maximum value of S1
S2_MAX	S 2 TRMS ▲TS	VA	Maximum value of S2
S3_MAX	S 3 TRMS ▲TS	VA	Maximum value of S3
F_MM	F TRMS ▲TS	Hz	Minimum and maximum value of F
UR21_MAX	U neg/pos UNB ▲TS	%	Maximum value of UR2/UR1
IR21_MAX	I neg/pos UNB ▲TS	%	Maximum value of IR2/IR1
THD_U_MAX	U THD ▲TS	%	Max. Total Harmonic Distortion of U
THD_U1N_MAX	U 1N THD ▲TS	%	Max. Total Harmonic Distortion of U1N
THD_U2N_MAX	U 2N THD ▲TS	%	Max. Total Harmonic Distortion of U2N
THD_U3N_MAX	U 3N THD ▲TS	%	Max. Total Harmonic Distortion of U3N
THD_U12_MAX	U 12 THD ▲TS	%	Max. Total Harmonic Distortion of U12
THD_U23_MAX	U 23 THD ▲TS	%	Max. Total Harmonic Distortion of U23
THD_U31_MAX	U 31 THD ▲TS	%	Max. Total Harmonic Distortion of U31
TDD_I_MAX	I TDD ▲TS	%	Max. Total Demand Distortion of I
TDD_I1_MAX	I 1 TDD ▲TS	%	Max. Total Demand Distortion of I1
TDD_I2_MAX	I 2 TDD ▲TS	%	Max. Total Demand Distortion of I2
TDD_I3_MAX	I 3 TDD ▲TS	%	Max. Total Demand Distortion of I3

TS: Timestamp of occurrence, e.g. 2014/09/17 11:12:03









Mean-values, trend and bimetal current

Name	Measurement identification	Unit	Description
M1	(m) (p) (q)  (t2)	(mu)	Mean-value 1
M2	(m) (p) (q)  (t2)	(mu)	Mean-value 2
....	(m) (p) (q)  (t2)	(mu)
M11	(m) (p) (q)  (t2)	(mu)	Mean-value 11
M12	(m) (p) (q)  (t2)	(mu)	Mean-value 12
TR_M1	(m) (p) (q)  (t2)	(mu)	Trend mean-value 1
TR_M2	(m) (p) (q)  (t2)	(mu)	Trend mean-value 2
....	(m) (p) (q)  (t2)	(mu)
TR_M11	(m) (p) (q)  (t2)	(mu)	Trend mean-value 11
TR_M12	(m) (p) (q)  (t2)	(mu)	Trend mean-value 12
IB	IB  (t3)	A	Bimetal current, system
IB1	IB 1  (t3)	A	Bimetal current, phase L1
IB2	IB 2  (t3)	A	Bimetal current, phase L2
IB3	IB 3  (t3)	A	Bimetal current, phase L3

Minimum and maximum of mean-values and bimetal-current

Name	Measurement identification	Unit	Description
M1_MM	(m) (p) (q)  (t2) ▲ TS ▼ TS	..	Min/Max mean-value 1
M2_MM	(m) (p) (q)  (t2) ▲ TS ▼ TS	..	Min/Max mean-value 2
....	(m) (p) (q)  (t2) ▲ TS ▼ TS
M11_MM	(m) (p) (q)  (t2) ▲ TS ▼ TS	..	Min/Max mean-value 11
M12_MM	(m) (p) (q)  (t2) ▲ TS ▼ TS	..	Min/Max mean-value 12
IB_MAX	IB  (t3) ▲ TS	A	Maximum bimetal current, system
IB1_MAX	IB 1  (t3) ▲ TS	A	Maximum Bimetal current, phase L1
IB2_MAX	IB 2  (t3) ▲ TS	A	Maximum Bimetal current, phase L2
IB3_MAX	IB 3  (t3) ▲ TS	A	Maximum Bimetal current, phase L3


Meters

Name	Measurement identification	Unit	Description
ΣP_I_IV_HT	P  ΣHT	Wh	Meter P I+IV, high tariff
ΣP_II_III_HT	P  ΣHT	Wh	Meter P II+III, high tariff
ΣQ_I_II_HT	Q  ΣHT	varh	Meter Q I+II, high tariff
ΣQ_III_IV_HT	Q  ΣHT	varh	Meter Q III+IV, high tariff
ΣP_I_IV_LT	P  ΣLT	Wh	Meter P I+IV, low tariff
ΣP_II_III_LT	P  ΣLT	Wh	Meter P II+III, low tariff
ΣQ_I_II_LT	Q  ΣLT	varh	Meter Q I+II, low tariff
ΣQ_III_IV_LT	Q  ΣLT	varh	Meter Q III+IV, low tariff
ΣMETER1	(m) (p) (qg) Σ(T)	(mu)	User meter 1, tariff HT or LT
ΣMETER2	(m) (p) (qg) Σ(T)	(mu)	User meter 2, tariff HT or LT
.....	(m) (p) (qg) Σ(T)	(mu)
ΣMETER11	(m) (p) (qg) Σ(T)	(mu)	User meter 11, tariff HT or LT
ΣMETER12	(m) (p) (qg) Σ(T)	(mu)	User meter 12, tariff HT or LT

(m): Short description of basic quantity, e.g. „P“

(p): Phase reference of the selected quantity, e.g. „1“





(q): Quadrant information, e.g. „I+IV“


(qg): Graphical quadrant information, e.g. 

(T): Associated tariff, e.g. „HT“ or „LT“



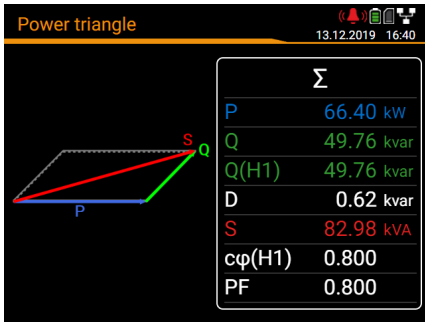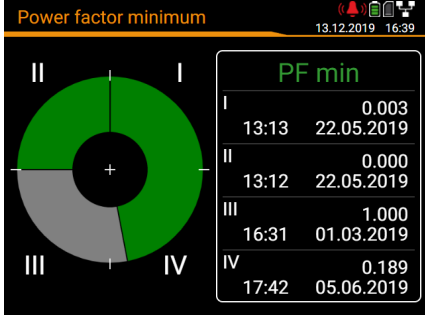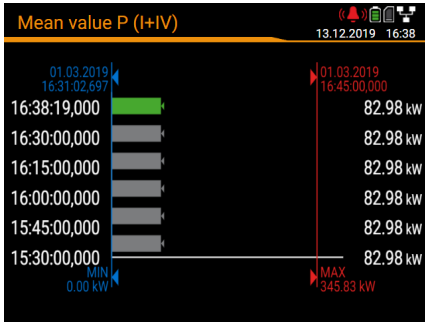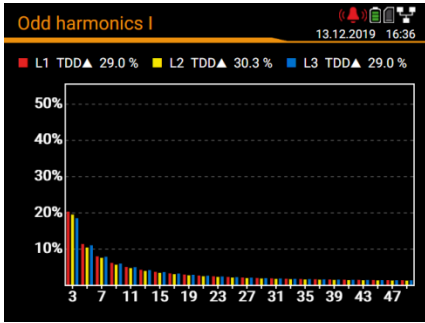


(mu): Unit of basic quantity

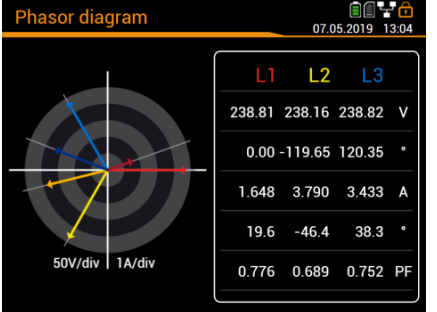Graphical measurement displays







Name	Presentation	Description																
Px_TRIANGLE	 <p>Power triangle</p> <p>13.12.2019 16:40</p> <table border="1"> <tr><td>Σ</td><td></td></tr> <tr><td>P</td><td>66.40 kW</td></tr> <tr><td>Q</td><td>49.76 kvar</td></tr> <tr><td>Q(H1)</td><td>49.76 kvar</td></tr> <tr><td>D</td><td>0.62 kvar</td></tr> <tr><td>S</td><td>82.98 kVA</td></tr> <tr><td>cϕ(H1)</td><td>0.800</td></tr> <tr><td>PF</td><td>0.800</td></tr> </table>	Σ		P	66.40 kW	Q	49.76 kvar	Q(H1)	49.76 kvar	D	0.62 kvar	S	82.98 kVA	c ϕ (H1)	0.800	PF	0.800	<p>Graphic of the power triangle consisting of:</p> <ul style="list-style-type: none"> Active, reactive and apparent power Px, Qx, Sx Distortion reactive power Dx Fundamental reactive power Qx(H1) cos(ϕ) of fundamental Active power factor PFx
Σ																		
P	66.40 kW																	
Q	49.76 kvar																	
Q(H1)	49.76 kvar																	
D	0.62 kvar																	
S	82.98 kVA																	
c ϕ (H1)	0.800																	
PF	0.800																	
PF_MIN	 <p>Power factor minimum</p> <p>13.12.2019 16:39</p> <p>PF min</p> <table border="1"> <tr><td>I</td><td>0.003</td></tr> <tr><td>13:13</td><td>22.05.2019</td></tr> <tr><td>II</td><td>0.000</td></tr> <tr><td>13:12</td><td>22.05.2019</td></tr> <tr><td>III</td><td>1.000</td></tr> <tr><td>16:31</td><td>01.03.2019</td></tr> <tr><td>IV</td><td>0.189</td></tr> <tr><td>17:42</td><td>05.06.2019</td></tr> </table>	I	0.003	13:13	22.05.2019	II	0.000	13:12	22.05.2019	III	1.000	16:31	01.03.2019	IV	0.189	17:42	05.06.2019	<p>Graphic: Minimum active power factor PF in all 4 quadrants</p>
I	0.003																	
13:13	22.05.2019																	
II	0.000																	
13:12	22.05.2019																	
III	1.000																	
16:31	01.03.2019																	
IV	0.189																	
17:42	05.06.2019																	
C ϕ _MIN	(as PF_MIN)	Graphic: Minimum cos(ϕ) in all 4 quadrants																
MT_P_I_IV	 <p>Mean value P (I+IV)</p> <p>13.12.2019 16:38</p> <p>01.03.2019 16:31:02,697</p> <p>16:38:19,000</p> <p>16:30:00,000</p> <p>16:15:00,000</p> <p>16:00:00,000</p> <p>15:45:00,000</p> <p>15:30:00,000</p> <p>MIN 0.00 kW</p> <p>MAX 345.83 kW</p> <p>01.03.2019 16:45:00,000</p> <p>82.98 kW</p> <p>82.98 kW</p> <p>82.98 kW</p> <p>82.98 kW</p> <p>82.98 kW</p> <p>82.98 kW</p>	<p>Graphic mean-value P (I+IV)</p> <p>Trend, last 5 interval values, minimum and maximum</p>																
MT_P_II_III	(as MT_P_I_IV)	Graphic mean-value P (II+III) Trend, last 5 interval values, minimum and maximum																
MT_Q_I_II	(as MT_P_I_IV)	Graphic mean-value Q (I+II) Trend, last 5 interval values, minimum and maximum																
MT_Q_III_IV	(as MT_P_I_IV)	Graphic mean-value Q (III+IV) Trend, last 5 interval values, minimum and maximum																
MT_S	(as MT_P_I_IV)	Graphic mean-value S: Trend, last 5 interval values, minimum and maximum																
HO_IX	 <p>Odd harmonics I</p> <p>13.12.2019 16:36</p> <p>L1 TDD▲ 29.0% L2 TDD▲ 30.3% L3 TDD▲ 29.0%</p> <p>50%</p> <p>40%</p> <p>30%</p> <p>20%</p> <p>10%</p> <p>3 7 11 15 19 23 27 31 35 39 43 47</p>	<p>Graphic: Odd harmonics 3rd up to 49th + Total Harmonic Distortion of all currents</p>																
HO_UX	(as HO_IX)	Graphic: Odd harmonics 3 rd up to 49 th + Total Harmonic Distortion of all voltages																
HE_IX	(as HO_IX)	Graphic: Even harmonics 2 nd up to 50 th + Total Harmonic Distortion of all currents																
HE_UX	(as HO_IX)	Graphic: Even harmonics 2 nd up to 50 th + Total Harmonic Distortion of all voltages																
HO_UX_MAX	(as HO_IX)	Graphic: Maximum values odd harmonics 3 rd up to 49 th + Total Harmonic Distortion of all voltages																
HO_IX_MAX	(as HO_IX)	Graphic: Maximum values odd harmonics 3 rd up to 49 th + Total Harmonic Distortion of all currents																
Name	Presentation	Description																

HE_UX_MAX	(as HO_IX)	Graphic: Maximum values even harmonics 2 nd up to 50 th + Total Harmonic Distortion of all voltages																														
HE_IX_MAX	(as HO_IX)	Graphic: Maximum values even harmonics 2 nd up to 50 th + Total Harmonic Distortion of all currents																														
PHASOR	 <table border="1" data-bbox="632 293 839 539"> <thead> <tr> <th></th> <th>L1</th> <th>L2</th> <th>L3</th> <th></th> </tr> </thead> <tbody> <tr> <td></td> <td>238.81</td> <td>238.16</td> <td>238.82</td> <td>V</td> </tr> <tr> <td></td> <td>0.00</td> <td>-119.65</td> <td>120.35</td> <td>°</td> </tr> <tr> <td></td> <td>1.648</td> <td>3.790</td> <td>3.433</td> <td>A</td> </tr> <tr> <td></td> <td>19.6</td> <td>-46.4</td> <td>38.3</td> <td>°</td> </tr> <tr> <td></td> <td>0.776</td> <td>0.689</td> <td>0.752</td> <td>PF</td> </tr> </tbody> </table>		L1	L2	L3			238.81	238.16	238.82	V		0.00	-119.65	120.35	°		1.648	3.790	3.433	A		19.6	-46.4	38.3	°		0.776	0.689	0.752	PF	Graphic: All current and voltage phasors with present load situation
	L1	L2	L3																													
	238.81	238.16	238.82	V																												
	0.00	-119.65	120.35	°																												
	1.648	3.790	3.433	A																												
	19.6	-46.4	38.3	°																												
	0.776	0.689	0.752	PF																												






B1 Display matrices for single phase system

Display menu	Corresponding matrix																				
 Instantaneous values	<table border="1"> <tr> <td>U UNE F</td> <td>U_MM UNE_MAX F_MM</td> <td>Pst1N</td> <td>UD OD</td> </tr> <tr> <td>I IN IMS</td> <td>I_MAX IN_MAX</td> <td></td> <td></td> </tr> <tr> <td>P Q S PF</td> <td>P_MAX Q_MAX S_MAX</td> <td></td> <td></td> </tr> <tr> <td>P_TRIANGLE</td> <td></td> <td></td> <td></td> </tr> <tr> <td>PF_MIN</td> <td>Cφ_MIN</td> <td></td> <td></td> </tr> </table>	U UNE F	U_MM UNE_MAX F_MM	Pst1N	UD OD	I IN IMS	I_MAX IN_MAX			P Q S PF	P_MAX Q_MAX S_MAX			P_TRIANGLE				PF_MIN	Cφ_MIN		
U UNE F	U_MM UNE_MAX F_MM	Pst1N	UD OD																		
I IN IMS	I_MAX IN_MAX																				
P Q S PF	P_MAX Q_MAX S_MAX																				
P_TRIANGLE																					
PF_MIN	Cφ_MIN																				
 Energy Meter contents Standard meters	<table border="1"> <tr> <td> ΣP_I_IV_HT ΣP_I_IV_NT ΣP_II_III_NT ΣP_II_III_HT ΣQ_I_II_HT ΣQ_I_II_NT ΣQ_III_IV_HT ΣQ_I_II_NT </td> </tr> </table>	ΣP_I_IV_HT ΣP_I_IV_NT ΣP_II_III_NT ΣP_II_III_HT ΣQ_I_II_HT ΣQ_I_II_NT ΣQ_III_IV_HT ΣQ_I_II_NT																			
ΣP_I_IV_HT ΣP_I_IV_NT ΣP_II_III_NT ΣP_II_III_HT ΣQ_I_II_HT ΣQ_I_II_NT ΣQ_III_IV_HT ΣQ_I_II_NT																					
 Energy Meter contents User meters	<table border="1"> <tr> <td> ΣMETER1 ΣMETER2 ΣMETER3 ΣMETER4 ΣMETER5 ΣMETER6 ΣMETER7 ΣQ_I ΣQ_II ΣQ_III ΣQ_IV ΣS </td> </tr> </table>	ΣMETER1 ΣMETER2 ΣMETER3 ΣMETER4 ΣMETER5 ΣMETER6 ΣMETER7 ΣQ_I ΣQ_II ΣQ_III ΣQ_IV ΣS																			
ΣMETER1 ΣMETER2 ΣMETER3 ΣMETER4 ΣMETER5 ΣMETER6 ΣMETER7 ΣQ_I ΣQ_II ΣQ_III ΣQ_IV ΣS																					
 Energy Mean-values Power mean-values + trend	<table border="1"> <tr> <td>MT_P_I_IV</td> <td>MT_P_II_III</td> <td>MT_Q_I_II</td> <td>MT_Q_III_IV</td> <td>MT_S</td> </tr> </table>	MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S															
MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																	
 Energy Mean-values User mean-values + trend	<table border="1"> <tr> <td>M1 M2 M3 M4</td> <td>TR_M1 TR_M2 TR_M3 TR_M4</td> <td>M1_MM M2_MM M3_MM M4_MM</td> </tr> <tr> <td>M5 M6 M7 M8</td> <td>TR_M5 TR_M6 TR_M7 TR_M8</td> <td>M5_MM M6_MM M7_MM M8_MM</td> </tr> <tr> <td>M9 M10 M11 M12</td> <td>TR_M9 TR_M10 TR_M11 TR_M12</td> <td>M9_MM M10_MM M11_MM M12_MM</td> </tr> </table>	M1 M2 M3 M4	TR_M1 TR_M2 TR_M3 TR_M4	M1_MM M2_MM M3_MM M4_MM	M5 M6 M7 M8	TR_M5 TR_M6 TR_M7 TR_M8	M5_MM M6_MM M7_MM M8_MM	M9 M10 M11 M12	TR_M9 TR_M10 TR_M11 TR_M12	M9_MM M10_MM M11_MM M12_MM											
M1 M2 M3 M4	TR_M1 TR_M2 TR_M3 TR_M4	M1_MM M2_MM M3_MM M4_MM																			
M5 M6 M7 M8	TR_M5 TR_M6 TR_M7 TR_M8	M5_MM M6_MM M7_MM M8_MM																			
M9 M10 M11 M12	TR_M9 TR_M10 TR_M11 TR_M12	M9_MM M10_MM M11_MM M12_MM																			
 Energy Bimetal current	<table border="1"> <tr> <td>IB IB_MAX</td> </tr> </table>	IB IB_MAX																			
IB IB_MAX																					







B2 Display matrices for split-phase (two-phase) systems

Display menu	Corresponding matrix																									
 Instantaneous values	<table border="1"> <tr> <td>U1N U2N U UNE</td> <td>U1N_MM U2N_MM U_MM UNE_MAX</td> <td>Pst1N Pst2N</td> <td>UD12 UD1N UD2N</td> <td>OD12 OD1N OD2N</td> </tr> <tr> <td>I1 I2 IN IPE</td> <td>I1_MAX I2_MAX IN_MAX IPE_MAX</td> <td></td> <td></td> <td></td> </tr> <tr> <td>P Q S PF</td> <td>P1 P2 Q1 Q2</td> <td>P_MAX Q_MAX S_MAX F_MM</td> <td>P1_MAX P2_MAX Q1_MAX Q2_MAX</td> <td></td> </tr> <tr> <td>P_TRIANGLE</td> <td>P1_TRIANGLE</td> <td>P2_TRIANGLE</td> <td></td> <td></td> </tr> <tr> <td>PF_MIN</td> <td>Cφ_MIN</td> <td></td> <td></td> <td></td> </tr> </table>	U1N U2N U UNE	U1N_MM U2N_MM U_MM UNE_MAX	Pst1N Pst2N	UD12 UD1N UD2N	OD12 OD1N OD2N	I1 I2 IN IPE	I1_MAX I2_MAX IN_MAX IPE_MAX				P Q S PF	P1 P2 Q1 Q2	P_MAX Q_MAX S_MAX F_MM	P1_MAX P2_MAX Q1_MAX Q2_MAX		P_TRIANGLE	P1_TRIANGLE	P2_TRIANGLE			PF_MIN	Cφ_MIN			
U1N U2N U UNE	U1N_MM U2N_MM U_MM UNE_MAX	Pst1N Pst2N	UD12 UD1N UD2N	OD12 OD1N OD2N																						
I1 I2 IN IPE	I1_MAX I2_MAX IN_MAX IPE_MAX																									
P Q S PF	P1 P2 Q1 Q2	P_MAX Q_MAX S_MAX F_MM	P1_MAX P2_MAX Q1_MAX Q2_MAX																							
P_TRIANGLE	P1_TRIANGLE	P2_TRIANGLE																								
PF_MIN	Cφ_MIN																									
 Energy Meter contents Standard meters	<table border="1"> <tr> <td> ΣP_I_IV_HT ΣP_I_IV_NT ΣP_II_III_NT ΣP_II_III_HT ΣQ_I_II_HT ΣQ_I_II_NT ΣQ_III_IV_HT ΣQ_I_II_NT </td> </tr> </table>	ΣP_I_IV_HT ΣP_I_IV_NT ΣP_II_III_NT ΣP_II_III_HT ΣQ_I_II_HT ΣQ_I_II_NT ΣQ_III_IV_HT ΣQ_I_II_NT																								
ΣP_I_IV_HT ΣP_I_IV_NT ΣP_II_III_NT ΣP_II_III_HT ΣQ_I_II_HT ΣQ_I_II_NT ΣQ_III_IV_HT ΣQ_I_II_NT																										
 Energy Meter contents User meters	<table border="1"> <tr> <td> ΣMETER1 ΣMETER2 ΣMETER3 ΣMETER4 ΣMETER5 ΣMETER6 ΣMETER7 ΣQ_I ΣQ_II ΣQ_III ΣQ_IV ΣS </td> </tr> </table>	ΣMETER1 ΣMETER2 ΣMETER3 ΣMETER4 ΣMETER5 ΣMETER6 ΣMETER7 ΣQ_I ΣQ_II ΣQ_III ΣQ_IV ΣS																								
ΣMETER1 ΣMETER2 ΣMETER3 ΣMETER4 ΣMETER5 ΣMETER6 ΣMETER7 ΣQ_I ΣQ_II ΣQ_III ΣQ_IV ΣS																										
 Energy Mean-values Power mean-values + trend	<table border="1"> <tr> <td>MT_P_I_IV</td> <td>MT_P_II_III</td> <td>MT_Q_I_II</td> <td>MT_Q_III_IV</td> <td>MT_S</td> </tr> </table>	MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																				
MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																						
 Energy Mean-values User mean-values + trend	<table border="1"> <tr> <td>M1 M2 M3 M4</td> <td>TR_M1 TR_M2 TR_M3 TR_M4</td> <td>M1_MM M2_MM M3_MM M4_MM</td> </tr> <tr> <td>M5 M6 M7 M8</td> <td>TR_M5 TR_M6 TR_M7 TR_M8</td> <td>M5_MM M6_MM M7_MM M8_MM</td> </tr> <tr> <td>M9 M10 M11 M12</td> <td>TR_M9 TR_M10 TR_M11 TR_M12</td> <td>M9_MM M10_MM M11_MM M12_MM</td> </tr> </table>	M1 M2 M3 M4	TR_M1 TR_M2 TR_M3 TR_M4	M1_MM M2_MM M3_MM M4_MM	M5 M6 M7 M8	TR_M5 TR_M6 TR_M7 TR_M8	M5_MM M6_MM M7_MM M8_MM	M9 M10 M11 M12	TR_M9 TR_M10 TR_M11 TR_M12	M9_MM M10_MM M11_MM M12_MM																
M1 M2 M3 M4	TR_M1 TR_M2 TR_M3 TR_M4	M1_MM M2_MM M3_MM M4_MM																								
M5 M6 M7 M8	TR_M5 TR_M6 TR_M7 TR_M8	M5_MM M6_MM M7_MM M8_MM																								
M9 M10 M11 M12	TR_M9 TR_M10 TR_M11 TR_M12	M9_MM M10_MM M11_MM M12_MM																								
 Energy Bimetal current	<table border="1"> <tr> <td>IB1 IB2 IB1_MAX IB2_MAX</td> </tr> </table>	IB1 IB2 IB1_MAX IB2_MAX																								
IB1 IB2 IB1_MAX IB2_MAX																										





B3 Display matrices for 3-wire system, balanced load

Display menu	Corresponding matrix																																						
 Instantaneous values	<table border="1"> <tr> <td>U12</td> <td>U4C</td> <td>U12_MM</td> <td>UR1</td> <td>Pst12</td> <td>UD12</td> <td>OD12</td> </tr> <tr> <td>U23</td> <td>U4C_MAX</td> <td>U23_MM</td> <td>UR2</td> <td>Pst23</td> <td>UD23</td> <td>OD23</td> </tr> <tr> <td>U31</td> <td></td> <td>U31_MM</td> <td>UR2R1</td> <td>Pst31</td> <td>UD31</td> <td>OD31</td> </tr> <tr> <td>F</td> <td>¹⁾</td> <td>F_MM</td> <td>UR21_MAX</td> <td></td> <td></td> <td></td> </tr> </table> <p>I I_MAX IMS</p> <p>¹⁾ Only if measurement of homopolar voltage has been activated</p> <table border="1"> <tr> <td>P</td> <td>P_MAX</td> </tr> <tr> <td>Q</td> <td>Q_MAX</td> </tr> <tr> <td>S</td> <td>S_MAX</td> </tr> </table> <table border="1"> <tr> <td>P_TRIANGLE</td> <td></td> </tr> </table> <table border="1"> <tr> <td>PF_MIN</td> <td>Cφ_MIN</td> </tr> </table>	U12	U4C	U12_MM	UR1	Pst12	UD12	OD12	U23	U4C_MAX	U23_MM	UR2	Pst23	UD23	OD23	U31		U31_MM	UR2R1	Pst31	UD31	OD31	F	¹⁾	F_MM	UR21_MAX				P	P_MAX	Q	Q_MAX	S	S_MAX	P_TRIANGLE		PF_MIN	Cφ_MIN
U12	U4C	U12_MM	UR1	Pst12	UD12	OD12																																	
U23	U4C_MAX	U23_MM	UR2	Pst23	UD23	OD23																																	
U31		U31_MM	UR2R1	Pst31	UD31	OD31																																	
F	¹⁾	F_MM	UR21_MAX																																				
P	P_MAX																																						
Q	Q_MAX																																						
S	S_MAX																																						
P_TRIANGLE																																							
PF_MIN	Cφ_MIN																																						
 Energy Meter contents Standard meters	<table border="1"> <tr> <td>ΣP_I_IV_HT</td> </tr> <tr> <td>ΣP_I_IV_NT</td> </tr> <tr> <td>ΣP_II_III_NT</td> </tr> <tr> <td>ΣP_II_III_HT</td> </tr> <tr> <td>ΣQ_I_II_HT</td> </tr> <tr> <td>ΣQ_I_II_NT</td> </tr> <tr> <td>ΣQ_III_IV_HT</td> </tr> <tr> <td>ΣQ_I_II_NT</td> </tr> </table>	ΣP_I_IV_HT	ΣP_I_IV_NT	ΣP_II_III_NT	ΣP_II_III_HT	ΣQ_I_II_HT	ΣQ_I_II_NT	ΣQ_III_IV_HT	ΣQ_I_II_NT																														
ΣP_I_IV_HT																																							
ΣP_I_IV_NT																																							
ΣP_II_III_NT																																							
ΣP_II_III_HT																																							
ΣQ_I_II_HT																																							
ΣQ_I_II_NT																																							
ΣQ_III_IV_HT																																							
ΣQ_I_II_NT																																							
 Energy Meter contents User meters	<table border="1"> <tr> <td>ΣMETER1</td> </tr> <tr> <td>ΣMETER2</td> </tr> <tr> <td>ΣMETER3</td> </tr> <tr> <td>ΣMETER4</td> </tr> <tr> <td>ΣMETER5</td> </tr> <tr> <td>ΣMETER6</td> </tr> <tr> <td>ΣMETER7</td> </tr> <tr> <td>ΣQ_I</td> </tr> <tr> <td>ΣQ_II</td> </tr> <tr> <td>ΣQ_III</td> </tr> <tr> <td>ΣQ_IV</td> </tr> <tr> <td>ΣS</td> </tr> </table>	ΣMETER1	ΣMETER2	ΣMETER3	ΣMETER4	ΣMETER5	ΣMETER6	ΣMETER7	ΣQ_I	ΣQ_II	ΣQ_III	ΣQ_IV	ΣS																										
ΣMETER1																																							
ΣMETER2																																							
ΣMETER3																																							
ΣMETER4																																							
ΣMETER5																																							
ΣMETER6																																							
ΣMETER7																																							
ΣQ_I																																							
ΣQ_II																																							
ΣQ_III																																							
ΣQ_IV																																							
ΣS																																							
 Energy Mean-values Power mean-values + trend	<table border="1"> <tr> <td>MT_P_I_IV</td> <td>MT_P_II_III</td> <td>MT_Q_I_II</td> <td>MT_Q_III_IV</td> <td>MT_S</td> </tr> </table>	MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																	
MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																			
 Energy Mean-values User mean-values + trend	<table border="1"> <tr> <td>M1</td> <td>TR_M1</td> <td>M1_MM</td> </tr> <tr> <td>M2</td> <td>TR_M2</td> <td>M2_MM</td> </tr> <tr> <td>M3</td> <td>TR_M3</td> <td>M3_MM</td> </tr> <tr> <td>M4</td> <td>TR_M4</td> <td>M4_MM</td> </tr> <tr> <td>M5</td> <td>TR_M5</td> <td>M5_MM</td> </tr> <tr> <td>M6</td> <td>TR_M6</td> <td>M6_MM</td> </tr> <tr> <td>M7</td> <td>TR_M7</td> <td>M7_MM</td> </tr> <tr> <td>M8</td> <td>TR_M8</td> <td>M8_MM</td> </tr> <tr> <td>M9</td> <td>TR_M9</td> <td>M9_MM</td> </tr> <tr> <td>M10</td> <td>TR_M10</td> <td>M10_MM</td> </tr> <tr> <td>M11</td> <td>TR_M11</td> <td>M11_MM</td> </tr> <tr> <td>M12</td> <td>TR_M12</td> <td>M12_MM</td> </tr> </table>	M1	TR_M1	M1_MM	M2	TR_M2	M2_MM	M3	TR_M3	M3_MM	M4	TR_M4	M4_MM	M5	TR_M5	M5_MM	M6	TR_M6	M6_MM	M7	TR_M7	M7_MM	M8	TR_M8	M8_MM	M9	TR_M9	M9_MM	M10	TR_M10	M10_MM	M11	TR_M11	M11_MM	M12	TR_M12	M12_MM		
M1	TR_M1	M1_MM																																					
M2	TR_M2	M2_MM																																					
M3	TR_M3	M3_MM																																					
M4	TR_M4	M4_MM																																					
M5	TR_M5	M5_MM																																					
M6	TR_M6	M6_MM																																					
M7	TR_M7	M7_MM																																					
M8	TR_M8	M8_MM																																					
M9	TR_M9	M9_MM																																					
M10	TR_M10	M10_MM																																					
M11	TR_M11	M11_MM																																					
M12	TR_M12	M12_MM																																					
 Energy Bimetal current	<table border="1"> <tr> <td>IB</td> </tr> <tr> <td>IB_MAX</td> </tr> </table>	IB	IB_MAX																																				
IB																																							
IB_MAX																																							







B4 Display matrices for 3-wire systems, unbalanced load

Display menu	Corresponding matrix																																																				
 Instantaneous values	<table border="1"> <tr> <td>U12</td> <td>U4C</td> <td>U12_MM</td> <td>UR1</td> <td>Pst12</td> <td>UD12</td> <td>OD12</td> </tr> <tr> <td>U23</td> <td>U4C_MAX</td> <td>U23_MM</td> <td>UR2</td> <td>Pst23</td> <td>UD23</td> <td>OD23</td> </tr> <tr> <td>U31</td> <td></td> <td>U31_MM</td> <td>UR2R1</td> <td>Pst31</td> <td>UD31</td> <td>OD31</td> </tr> <tr> <td>F</td> <td></td> <td>F_MM</td> <td>UR21_MAX</td> <td></td> <td></td> <td></td> </tr> </table> <table border="1"> <tr> <td>I1</td> <td>I1_MAX</td> <td>IR1</td> </tr> <tr> <td>I2</td> <td>I2_MAX</td> <td>IR2</td> </tr> <tr> <td>I3</td> <td>I3_MAX</td> <td>IR2R1</td> </tr> <tr> <td>IPE</td> <td>IPE_MAX</td> <td>IR21_MAX</td> </tr> </table> <table border="1"> <tr> <td>P</td> <td>P_MAX</td> </tr> <tr> <td>Q</td> <td>Q_MAX</td> </tr> <tr> <td>S</td> <td>S_MAX</td> </tr> <tr> <td>PF</td> <td></td> </tr> </table> <table border="1"> <tr> <td>P_TRIANGLE</td> <td></td> </tr> </table> <table border="1"> <tr> <td>PF_MIN</td> <td>Cφ_MIN</td> </tr> </table> <p>²⁾ Only if measurement of homopolar voltage has been activated</p>	U12	U4C	U12_MM	UR1	Pst12	UD12	OD12	U23	U4C_MAX	U23_MM	UR2	Pst23	UD23	OD23	U31		U31_MM	UR2R1	Pst31	UD31	OD31	F		F_MM	UR21_MAX				I1	I1_MAX	IR1	I2	I2_MAX	IR2	I3	I3_MAX	IR2R1	IPE	IPE_MAX	IR21_MAX	P	P_MAX	Q	Q_MAX	S	S_MAX	PF		P_TRIANGLE		PF_MIN	Cφ_MIN
U12	U4C	U12_MM	UR1	Pst12	UD12	OD12																																															
U23	U4C_MAX	U23_MM	UR2	Pst23	UD23	OD23																																															
U31		U31_MM	UR2R1	Pst31	UD31	OD31																																															
F		F_MM	UR21_MAX																																																		
I1	I1_MAX	IR1																																																			
I2	I2_MAX	IR2																																																			
I3	I3_MAX	IR2R1																																																			
IPE	IPE_MAX	IR21_MAX																																																			
P	P_MAX																																																				
Q	Q_MAX																																																				
S	S_MAX																																																				
PF																																																					
P_TRIANGLE																																																					
PF_MIN	Cφ_MIN																																																				
 Energy Meter contents Standard meters	<table border="1"> <tr><td>ΣP_I_IV_HT</td></tr> <tr><td>ΣP_I_IV_NT</td></tr> <tr><td>ΣP_II_III_NT</td></tr> <tr><td>ΣP_II_III_HT</td></tr> <tr><td>ΣQ_I_II_HT</td></tr> <tr><td>ΣQ_I_II_NT</td></tr> <tr><td>ΣQ_III_IV_HT</td></tr> <tr><td>ΣQ_I_II_NT</td></tr> </table>	ΣP_I_IV_HT	ΣP_I_IV_NT	ΣP_II_III_NT	ΣP_II_III_HT	ΣQ_I_II_HT	ΣQ_I_II_NT	ΣQ_III_IV_HT	ΣQ_I_II_NT																																												
ΣP_I_IV_HT																																																					
ΣP_I_IV_NT																																																					
ΣP_II_III_NT																																																					
ΣP_II_III_HT																																																					
ΣQ_I_II_HT																																																					
ΣQ_I_II_NT																																																					
ΣQ_III_IV_HT																																																					
ΣQ_I_II_NT																																																					
 Energy Meter contents User meters	<table border="1"> <tr><td>ΣMETER1</td></tr> <tr><td>ΣMETER2</td></tr> <tr><td>ΣMETER3</td></tr> <tr><td>ΣMETER4</td></tr> <tr><td>ΣMETER5</td></tr> <tr><td>ΣMETER6</td></tr> <tr><td>ΣMETER7</td></tr> <tr><td>ΣQ_I</td></tr> <tr><td>ΣQ_II</td></tr> <tr><td>ΣQ_III</td></tr> <tr><td>ΣQ_IV</td></tr> <tr><td>ΣS</td></tr> </table>	ΣMETER1	ΣMETER2	ΣMETER3	ΣMETER4	ΣMETER5	ΣMETER6	ΣMETER7	ΣQ_I	ΣQ_II	ΣQ_III	ΣQ_IV	ΣS																																								
ΣMETER1																																																					
ΣMETER2																																																					
ΣMETER3																																																					
ΣMETER4																																																					
ΣMETER5																																																					
ΣMETER6																																																					
ΣMETER7																																																					
ΣQ_I																																																					
ΣQ_II																																																					
ΣQ_III																																																					
ΣQ_IV																																																					
ΣS																																																					
 Energy Mean-values Power mean-values + trend	<table border="1"> <tr> <td>MT_P_I_IV</td> <td>MT_P_II_III</td> <td>MT_Q_I_II</td> <td>MT_Q_III_IV</td> <td>MT_S</td> </tr> </table>	MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																															
MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																																	
 Energy Mean-values User mean-values + trend	<table border="1"> <tr> <td>M1</td> <td>TR_M1</td> <td>M1_MM</td> </tr> <tr> <td>M2</td> <td>TR_M2</td> <td>M2_MM</td> </tr> <tr> <td>M3</td> <td>TR_M3</td> <td>M3_MM</td> </tr> <tr> <td>M4</td> <td>TR_M4</td> <td>M4_MM</td> </tr> <tr> <td>M5</td> <td>TR_M5</td> <td>M5_MM</td> </tr> <tr> <td>M6</td> <td>TR_M6</td> <td>M6_MM</td> </tr> <tr> <td>M7</td> <td>TR_M7</td> <td>M7_MM</td> </tr> <tr> <td>M8</td> <td>TR_M8</td> <td>M8_MM</td> </tr> <tr> <td>M9</td> <td>TR_M9</td> <td>M9_MM</td> </tr> <tr> <td>M10</td> <td>TR_M10</td> <td>M10_MM</td> </tr> <tr> <td>M11</td> <td>TR_M11</td> <td>M11_MM</td> </tr> <tr> <td>M12</td> <td>TR_M12</td> <td>M12_MM</td> </tr> </table>	M1	TR_M1	M1_MM	M2	TR_M2	M2_MM	M3	TR_M3	M3_MM	M4	TR_M4	M4_MM	M5	TR_M5	M5_MM	M6	TR_M6	M6_MM	M7	TR_M7	M7_MM	M8	TR_M8	M8_MM	M9	TR_M9	M9_MM	M10	TR_M10	M10_MM	M11	TR_M11	M11_MM	M12	TR_M12	M12_MM																
M1	TR_M1	M1_MM																																																			
M2	TR_M2	M2_MM																																																			
M3	TR_M3	M3_MM																																																			
M4	TR_M4	M4_MM																																																			
M5	TR_M5	M5_MM																																																			
M6	TR_M6	M6_MM																																																			
M7	TR_M7	M7_MM																																																			
M8	TR_M8	M8_MM																																																			
M9	TR_M9	M9_MM																																																			
M10	TR_M10	M10_MM																																																			
M11	TR_M11	M11_MM																																																			
M12	TR_M12	M12_MM																																																			
 Energy Bimetal current	<table border="1"> <tr> <td>IB1</td> <td>IB1_MAX</td> </tr> <tr> <td>IB2</td> <td>IB2_MAX</td> </tr> <tr> <td>IB3</td> <td>IB3_MAX</td> </tr> </table>	IB1	IB1_MAX	IB2	IB2_MAX	IB3	IB3_MAX																																														
IB1	IB1_MAX																																																				
IB2	IB2_MAX																																																				
IB3	IB3_MAX																																																				

B5 Display matrices for 3-wire systems, unbalanced load, Aron

Display menu	Corresponding matrix																																																
 Instantaneous values	<table border="1"> <tr> <td>U12</td> <td>U4C</td> <td>U12_MM</td> <td>UR1</td> <td>Pst12</td> <td>UD12</td> <td>OD12</td> </tr> <tr> <td>U23</td> <td>U4C_MAX</td> <td>U23_MM</td> <td>UR2</td> <td>Pst23</td> <td>UD23</td> <td>OD23</td> </tr> <tr> <td>U31</td> <td></td> <td>U31_MM</td> <td>UR2R1</td> <td>Pst31</td> <td>UD31</td> <td>OD31</td> </tr> <tr> <td>F</td> <td></td> <td>F_MM</td> <td>UR21_MAX</td> <td></td> <td></td> <td></td> </tr> </table> <table border="1"> <tr> <td>I1</td> <td>I1_MAX</td> </tr> <tr> <td>I2</td> <td>I2_MAX</td> </tr> <tr> <td>I3</td> <td>I3_MAX</td> </tr> <tr> <td>IMS</td> <td></td> </tr> </table> <table border="1"> <tr> <td>P</td> <td>P_MAX</td> </tr> <tr> <td>Q</td> <td>Q_MAX</td> </tr> <tr> <td>S</td> <td>S_MAX</td> </tr> <tr> <td>PF</td> <td></td> </tr> </table> <table border="1"> <tr> <td>P_TRIANGLE</td> <td></td> </tr> </table> <table border="1"> <tr> <td>PF_MIN</td> <td>Cφ_MIN</td> </tr> </table> <p>³⁾ Only if measurement of homopolar voltage has been activated</p>	U12	U4C	U12_MM	UR1	Pst12	UD12	OD12	U23	U4C_MAX	U23_MM	UR2	Pst23	UD23	OD23	U31		U31_MM	UR2R1	Pst31	UD31	OD31	F		F_MM	UR21_MAX				I1	I1_MAX	I2	I2_MAX	I3	I3_MAX	IMS		P	P_MAX	Q	Q_MAX	S	S_MAX	PF		P_TRIANGLE		PF_MIN	Cφ_MIN
U12	U4C	U12_MM	UR1	Pst12	UD12	OD12																																											
U23	U4C_MAX	U23_MM	UR2	Pst23	UD23	OD23																																											
U31		U31_MM	UR2R1	Pst31	UD31	OD31																																											
F		F_MM	UR21_MAX																																														
I1	I1_MAX																																																
I2	I2_MAX																																																
I3	I3_MAX																																																
IMS																																																	
P	P_MAX																																																
Q	Q_MAX																																																
S	S_MAX																																																
PF																																																	
P_TRIANGLE																																																	
PF_MIN	Cφ_MIN																																																
 Energy Meter contents Standard meters	<table border="1"> <tr> <td>ΣP_I_IV_HT</td> </tr> <tr> <td>ΣP_I_IV_NT</td> </tr> <tr> <td>ΣP_II_III_NT</td> </tr> <tr> <td>ΣP_II_III_HT</td> </tr> <tr> <td>ΣQ_I_II_HT</td> </tr> <tr> <td>ΣQ_I_II_NT</td> </tr> <tr> <td>ΣQ_III_IV_HT</td> </tr> <tr> <td>ΣQ_I_II_NT</td> </tr> </table>	ΣP_I_IV_HT	ΣP_I_IV_NT	ΣP_II_III_NT	ΣP_II_III_HT	ΣQ_I_II_HT	ΣQ_I_II_NT	ΣQ_III_IV_HT	ΣQ_I_II_NT																																								
ΣP_I_IV_HT																																																	
ΣP_I_IV_NT																																																	
ΣP_II_III_NT																																																	
ΣP_II_III_HT																																																	
ΣQ_I_II_HT																																																	
ΣQ_I_II_NT																																																	
ΣQ_III_IV_HT																																																	
ΣQ_I_II_NT																																																	
 Energy Meter contents User meters	<table border="1"> <tr> <td>ΣMETER1</td> </tr> <tr> <td>ΣMETER2</td> </tr> <tr> <td>ΣMETER3</td> </tr> <tr> <td>ΣMETER4</td> </tr> <tr> <td>ΣMETER5</td> </tr> <tr> <td>ΣMETER6</td> </tr> <tr> <td>ΣMETER7</td> </tr> <tr> <td>ΣQ_I</td> </tr> <tr> <td>ΣQ_II</td> </tr> <tr> <td>ΣQ_III</td> </tr> <tr> <td>ΣQ_IV</td> </tr> <tr> <td>ΣS</td> </tr> </table>	ΣMETER1	ΣMETER2	ΣMETER3	ΣMETER4	ΣMETER5	ΣMETER6	ΣMETER7	ΣQ_I	ΣQ_II	ΣQ_III	ΣQ_IV	ΣS																																				
ΣMETER1																																																	
ΣMETER2																																																	
ΣMETER3																																																	
ΣMETER4																																																	
ΣMETER5																																																	
ΣMETER6																																																	
ΣMETER7																																																	
ΣQ_I																																																	
ΣQ_II																																																	
ΣQ_III																																																	
ΣQ_IV																																																	
ΣS																																																	
 Energy Mean-values Power mean-values + trend	<table border="1"> <tr> <td>MT_P_I_IV</td> <td>MT_P_II_III</td> <td>MT_Q_I_II</td> <td>MT_Q_III_IV</td> <td>MT_S</td> </tr> </table>	MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																											
MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																													
 Energy Mean-values User mean-values + trend	<table border="1"> <tr> <td>M1</td> <td>TR_M1</td> <td>M1_MM</td> </tr> <tr> <td>M2</td> <td>TR_M2</td> <td>M2_MM</td> </tr> <tr> <td>M3</td> <td>TR_M3</td> <td>M3_MM</td> </tr> <tr> <td>M4</td> <td>TR_M4</td> <td>M4_MM</td> </tr> <tr> <td>M5</td> <td>TR_M5</td> <td>M5_MM</td> </tr> <tr> <td>M6</td> <td>TR_M6</td> <td>M6_MM</td> </tr> <tr> <td>M7</td> <td>TR_M7</td> <td>M7_MM</td> </tr> <tr> <td>M8</td> <td>TR_M8</td> <td>M8_MM</td> </tr> <tr> <td>M9</td> <td>TR_M9</td> <td>M9_MM</td> </tr> <tr> <td>M10</td> <td>TR_M10</td> <td>M10_MM</td> </tr> <tr> <td>M11</td> <td>TR_M11</td> <td>M11_MM</td> </tr> <tr> <td>M12</td> <td>TR_M12</td> <td>M12_MM</td> </tr> </table>	M1	TR_M1	M1_MM	M2	TR_M2	M2_MM	M3	TR_M3	M3_MM	M4	TR_M4	M4_MM	M5	TR_M5	M5_MM	M6	TR_M6	M6_MM	M7	TR_M7	M7_MM	M8	TR_M8	M8_MM	M9	TR_M9	M9_MM	M10	TR_M10	M10_MM	M11	TR_M11	M11_MM	M12	TR_M12	M12_MM												
M1	TR_M1	M1_MM																																															
M2	TR_M2	M2_MM																																															
M3	TR_M3	M3_MM																																															
M4	TR_M4	M4_MM																																															
M5	TR_M5	M5_MM																																															
M6	TR_M6	M6_MM																																															
M7	TR_M7	M7_MM																																															
M8	TR_M8	M8_MM																																															
M9	TR_M9	M9_MM																																															
M10	TR_M10	M10_MM																																															
M11	TR_M11	M11_MM																																															
M12	TR_M12	M12_MM																																															
 Energy Bimetal current	<table border="1"> <tr> <td>IB1</td> <td>IB1_MAX</td> </tr> <tr> <td>IB2</td> <td>IB2_MAX</td> </tr> <tr> <td>IB3</td> <td>IB3_MAX</td> </tr> </table>	IB1	IB1_MAX	IB2	IB2_MAX	IB3	IB3_MAX																																										
IB1	IB1_MAX																																																
IB2	IB2_MAX																																																
IB3	IB3_MAX																																																

B6 Display matrices for 4-wire systems, unbalanced load

Display menu	Corresponding matrix																																																																																																																																												
<p> Instantaneous values</p>	<table border="1"> <tr> <td>U1N</td><td>U12</td><td>U1N_MM</td><td>U12_MM</td><td>UR1</td><td>Pst1N</td><td>UD1N</td><td>UD12</td><td>OD1N</td><td>OD12</td> </tr> <tr> <td>U2N</td><td>U23</td><td>U2N_MM</td><td>U23_MM</td><td>UR2</td><td>Pst2N</td><td>UD2N</td><td>UD23</td><td>OD2N</td><td>OD23</td> </tr> <tr> <td>U3N</td><td>U31</td><td>U3N_MM</td><td>U31_MM</td><td>U0</td><td>Pst3N</td><td>UD3N</td><td>UD31</td><td>OD3N</td><td>OD31</td> </tr> <tr> <td>UNE</td><td>F</td><td>F_MM</td><td>UR21_MAX</td><td>UNB_UR2_UR1</td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td>I1</td><td>IN</td><td>I1_MAX</td><td>I_N_MAX</td><td>IR1</td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td>I2</td><td>IPE</td><td>I2_MAX</td><td>IPE_MAX</td><td>IR2</td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td>I3</td><td>IMS</td><td>I3_MAX</td><td>IR21_MAX</td><td>IO</td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td>F</td><td></td><td></td><td></td><td>UNB_IR2_IR1</td><td></td><td></td><td></td><td></td><td></td> </tr> <tr> <td>P</td><td>P1</td><td>Q1</td><td>S1</td><td>P1_MAX</td><td>Q1_MAX</td><td>S1_MAX</td><td></td><td></td><td></td> </tr> <tr> <td>Q</td><td>P2</td><td>Q2</td><td>S2</td><td>P2_MAX</td><td>Q2_MAX</td><td>S2_MAX</td><td></td><td></td><td></td> </tr> <tr> <td>S</td><td>P3</td><td>Q3</td><td>S3</td><td>P3_MAX</td><td>Q3_MAX</td><td>S3_MAX</td><td></td><td></td><td></td> </tr> <tr> <td>PF</td><td>P</td><td>Q</td><td>S</td><td>P_MAX</td><td>Q_MAX</td><td>S_MAX</td><td></td><td></td><td></td> </tr> <tr> <td colspan="2">P_TRIANGLE</td><td colspan="2">P1_TRIANGLE</td><td colspan="2">P2_TRIANGLE</td><td colspan="4">P3_TRIANGLE</td> </tr> <tr> <td colspan="2">PF_MIN</td><td colspan="2">Cφ_MIN</td><td colspan="6"></td> </tr> </table>	U1N	U12	U1N_MM	U12_MM	UR1	Pst1N	UD1N	UD12	OD1N	OD12	U2N	U23	U2N_MM	U23_MM	UR2	Pst2N	UD2N	UD23	OD2N	OD23	U3N	U31	U3N_MM	U31_MM	U0	Pst3N	UD3N	UD31	OD3N	OD31	UNE	F	F_MM	UR21_MAX	UNB_UR2_UR1						I1	IN	I1_MAX	I_N_MAX	IR1						I2	IPE	I2_MAX	IPE_MAX	IR2						I3	IMS	I3_MAX	IR21_MAX	IO						F				UNB_IR2_IR1						P	P1	Q1	S1	P1_MAX	Q1_MAX	S1_MAX				Q	P2	Q2	S2	P2_MAX	Q2_MAX	S2_MAX				S	P3	Q3	S3	P3_MAX	Q3_MAX	S3_MAX				PF	P	Q	S	P_MAX	Q_MAX	S_MAX				P_TRIANGLE		P1_TRIANGLE		P2_TRIANGLE		P3_TRIANGLE				PF_MIN		Cφ_MIN							
U1N	U12	U1N_MM	U12_MM	UR1	Pst1N	UD1N	UD12	OD1N	OD12																																																																																																																																				
U2N	U23	U2N_MM	U23_MM	UR2	Pst2N	UD2N	UD23	OD2N	OD23																																																																																																																																				
U3N	U31	U3N_MM	U31_MM	U0	Pst3N	UD3N	UD31	OD3N	OD31																																																																																																																																				
UNE	F	F_MM	UR21_MAX	UNB_UR2_UR1																																																																																																																																									
I1	IN	I1_MAX	I_N_MAX	IR1																																																																																																																																									
I2	IPE	I2_MAX	IPE_MAX	IR2																																																																																																																																									
I3	IMS	I3_MAX	IR21_MAX	IO																																																																																																																																									
F				UNB_IR2_IR1																																																																																																																																									
P	P1	Q1	S1	P1_MAX	Q1_MAX	S1_MAX																																																																																																																																							
Q	P2	Q2	S2	P2_MAX	Q2_MAX	S2_MAX																																																																																																																																							
S	P3	Q3	S3	P3_MAX	Q3_MAX	S3_MAX																																																																																																																																							
PF	P	Q	S	P_MAX	Q_MAX	S_MAX																																																																																																																																							
P_TRIANGLE		P1_TRIANGLE		P2_TRIANGLE		P3_TRIANGLE																																																																																																																																							
PF_MIN		Cφ_MIN																																																																																																																																											
<p> Energy</p> <p>Meter contents</p> <p>Standard meters</p>	<table border="1"> <tr><td>ΣP_I_IV_HT</td></tr> <tr><td>ΣP_I_IV_NT</td></tr> <tr><td>ΣP_II_III_NT</td></tr> <tr><td>ΣP_II_III_HT</td></tr> <tr><td>ΣQ_I_II_HT</td></tr> <tr><td>ΣQ_I_II_NT</td></tr> <tr><td>ΣQ_III_IV_HT</td></tr> <tr><td>ΣQ_I_II_NT</td></tr> </table>	ΣP_I_IV_HT	ΣP_I_IV_NT	ΣP_II_III_NT	ΣP_II_III_HT	ΣQ_I_II_HT	ΣQ_I_II_NT	ΣQ_III_IV_HT	ΣQ_I_II_NT																																																																																																																																				
ΣP_I_IV_HT																																																																																																																																													
ΣP_I_IV_NT																																																																																																																																													
ΣP_II_III_NT																																																																																																																																													
ΣP_II_III_HT																																																																																																																																													
ΣQ_I_II_HT																																																																																																																																													
ΣQ_I_II_NT																																																																																																																																													
ΣQ_III_IV_HT																																																																																																																																													
ΣQ_I_II_NT																																																																																																																																													
<p> Energy</p> <p>Meter contents</p> <p>User meters</p>	<table border="1"> <tr><td>ΣMETER1</td></tr> <tr><td>ΣMETER2</td></tr> <tr><td>ΣMETER3</td></tr> <tr><td>ΣMETER4</td></tr> <tr><td>ΣMETER5</td></tr> <tr><td>ΣMETER6</td></tr> <tr><td>ΣMETER7</td></tr> <tr><td>ΣQ_I</td></tr> <tr><td>ΣQ_II</td></tr> <tr><td>ΣQ_III</td></tr> <tr><td>ΣQ_IV</td></tr> <tr><td>ΣS</td></tr> </table>	ΣMETER1	ΣMETER2	ΣMETER3	ΣMETER4	ΣMETER5	ΣMETER6	ΣMETER7	ΣQ_I	ΣQ_II	ΣQ_III	ΣQ_IV	ΣS																																																																																																																																
ΣMETER1																																																																																																																																													
ΣMETER2																																																																																																																																													
ΣMETER3																																																																																																																																													
ΣMETER4																																																																																																																																													
ΣMETER5																																																																																																																																													
ΣMETER6																																																																																																																																													
ΣMETER7																																																																																																																																													
ΣQ_I																																																																																																																																													
ΣQ_II																																																																																																																																													
ΣQ_III																																																																																																																																													
ΣQ_IV																																																																																																																																													
ΣS																																																																																																																																													
<p> Energy</p> <p>Mean-values</p> <p>Power mean-values + trend</p>	<table border="1"> <tr> <td>MT_P_I_IV</td> <td>MT_P_II_III</td> <td>MT_Q_I_II</td> <td>MT_Q_III_IV</td> <td>MT_S</td> </tr> </table>	MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																																																																																																																							
MT_P_I_IV	MT_P_II_III	MT_Q_I_II	MT_Q_III_IV	MT_S																																																																																																																																									
<p> Energy</p> <p>Mean-values</p> <p>User mean-values + trend</p>	<table border="1"> <tr> <td>M1</td><td>TR_M1</td><td>M1_MM</td> </tr> <tr> <td>M2</td><td>TR_M2</td><td>M2_MM</td> </tr> <tr> <td>M3</td><td>TR_M3</td><td>M3_MM</td> </tr> <tr> <td>M4</td><td>TR_M4</td><td>M4_MM</td> </tr> <tr> <td>M5</td><td>TR_M5</td><td>M5_MM</td> </tr> <tr> <td>M6</td><td>TR_M6</td><td>M6_MM</td> </tr> <tr> <td>M7</td><td>TR_M7</td><td>M7_MM</td> </tr> <tr> <td>M8</td><td>TR_M8</td><td>M8_MM</td> </tr> <tr> <td>M9</td><td>TR_M9</td><td>M9_MM</td> </tr> <tr> <td>M10</td><td>TR_M10</td><td>M10_MM</td> </tr> <tr> <td>M11</td><td>TR_M11</td><td>M11_MM</td> </tr> <tr> <td>M12</td><td>TR_M12</td><td>M12_MM</td> </tr> </table>	M1	TR_M1	M1_MM	M2	TR_M2	M2_MM	M3	TR_M3	M3_MM	M4	TR_M4	M4_MM	M5	TR_M5	M5_MM	M6	TR_M6	M6_MM	M7	TR_M7	M7_MM	M8	TR_M8	M8_MM	M9	TR_M9	M9_MM	M10	TR_M10	M10_MM	M11	TR_M11	M11_MM	M12	TR_M12	M12_MM																																																																																																								
M1	TR_M1	M1_MM																																																																																																																																											
M2	TR_M2	M2_MM																																																																																																																																											
M3	TR_M3	M3_MM																																																																																																																																											
M4	TR_M4	M4_MM																																																																																																																																											
M5	TR_M5	M5_MM																																																																																																																																											
M6	TR_M6	M6_MM																																																																																																																																											
M7	TR_M7	M7_MM																																																																																																																																											
M8	TR_M8	M8_MM																																																																																																																																											
M9	TR_M9	M9_MM																																																																																																																																											
M10	TR_M10	M10_MM																																																																																																																																											
M11	TR_M11	M11_MM																																																																																																																																											
M12	TR_M12	M12_MM																																																																																																																																											
<p> Energy</p> <p>Bimetal current</p>	<table border="1"> <tr> <td>IB1</td><td>IB1_MAX</td> </tr> <tr> <td>IB2</td><td>IB2_MAX</td> </tr> <tr> <td>IB3</td><td>IB3_MAX</td> </tr> </table>	IB1	IB1_MAX	IB2	IB2_MAX	IB3	IB3_MAX																																																																																																																																						
IB1	IB1_MAX																																																																																																																																												
IB2	IB2_MAX																																																																																																																																												
IB3	IB3_MAX																																																																																																																																												

C Logic functions

The principal function of the logical gates is given in the following table, for simplicity shown for gates with two inputs only.

function	symbol	older symbols		truth table	plain text
		ANSI 91-1984	DIN 40700 (alt)		
AND				A B Y	Function is true if all input conditions are fulfilled
				0 0 0	
				0 1 0	
				1 0 0	
				1 1 1	
NAND				A B Y	Function is true if at least one of the input conditions is not fulfilled
				0 0 1	
				0 1 1	
				1 0 1	
				1 1 0	
OR				A B Y	Function is true if at least one of the input conditions is fulfilled
				0 0 0	
				0 1 1	
				1 0 1	
				1 1 1	
NOR				A B Y	Function is true if none of the input conditions is fulfilled
				0 0 1	
				0 1 0	
				1 0 0	
				1 1 0	

Using DIRECT or INVERT the input is directly connected to the output of a monitoring function, without need for a logical combination. For these functions only one input is used.

DIRECT		<table border="1"> <thead> <tr> <th>A</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>0</td> </tr> <tr> <td>1</td> <td>1</td> </tr> </tbody> </table>	A	Y	0	0	1	1	The monitoring function is reduced to one input only. The state of the output corresponds to the input.
A	Y								
0	0								
1	1								
INVERT		<table border="1"> <thead> <tr> <th>A</th> <th>Y</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>1</td> </tr> <tr> <td>1</td> <td>0</td> </tr> </tbody> </table>	A	Y	0	1	1	0	The monitoring function is reduced to one input only. The state of the output corresponds to the inverted input.
A	Y								
0	1								
1	0								

D FCC statement

The following statement applies to the products covered in this manual, unless otherwise specified herein. The statement for other products will appear in the accompanying documentation.

NOTE: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to Part 15 of the FCC Rules and meets all requirements of the Canadian Interference-Causing Equipment Standard ICES-003 for digital apparatus. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/T.V. technician for help.

Camille Bauer AG is not responsible for any radio television interference caused by unauthorized modifications of this equipment or the substitution or attachment of connecting cables and equipment other than those specified by Camille Bauer AG. The correction of interference caused by such unauthorized modification, substitution or attachment will be the responsibility of the user.

INDEX

A		Bimetal current.....	82
Alarming	49	harmonic analysis	80
C		Load factors	78
Commissioning	23	mean values and trend	82
Configuration		meters	83
menu	41	system imbalance	81
Conformity report	61	zero displacement voltage	79
cosφ	77	Measurement displays	39
D		Measurements	
Device overview	6	reset	40
Dimensional drawing	75	Mechanical mounting	9
Display matrices	84	Menu operation	38
E		Monitoring functions	50
Electrical connections		N	
Aron connection	16	NTP	27
cross sections	11	O	
digital input	19	Operating elements	38
digital output	19	P	
inputs	11	PQ event recordings	56
Modbus interface	20	PQ monitoring	45
power supply	11	PQ statistic	59
split phase	18	PQDIF	63
Elektrische Anschlüsse		PQ-Easy Report	61
Analogausgang	19	R	
Ethernet installation	25	Reactive power	78
F		Resetting measurements	40
FCC statement	97	Roman numbers	39
Firewall	28	S	
G		Safety notes	6
GPS	21	Scope of supply	5
H		Security system	30
HTTPS	35	Service and maintenance	68
I		Simulation	29
I, II, III, IV	39	Summary alarm	51
IEC61850	29	Symbols	40
Installation check	23	Symmetrical components	81
IRIG-B	22	SYSLOG	36
L		T	
Logic components		Technical data	69
AND	96	Time synchronization	
DIRECT	96	GPS	21
INVERT	96	IRIG-B	22
NAND	96	NTP	27
NOR	96	U	
OR	96	UPS (Uninterruptible power supply)	20
Logic functions	96	W	
M		Whitelist	35
Measured quantities	76	Z	
Basic measurements	76	Zero suppression	70